

Standard

Batch Control
Part 1: Models and Terminology
Update Working Group Draft 7_04Apr2008

NOTE: THIS DOCUMENT IS PROVIDED FOR REFERENCE ONLY TO MEMBERS OF THE ISA SP88.01 UPDATE WORKING GROUP. NO PARTS OF THIS DOCUMENT MAY BE REPRODUCED OR DISTRIBUTED OUTSIDE OF THE SP88 WORKING GROUP. COPYRIGHT ISA, 1995.



NOTE: THIS DOCUMENT IS PROVIDED FOR REFERENCE ONLY TO MEMBERS OF THE ISA SP88.01 UPDATE WORKING GROUP. NO PARTS OF THIS DOCUMENT MAY BE REPRODUCED OR DISTRIBUTED OUTSIDE OF THE SP88 WORKING GROUP. COPYRIGHT ISA, 1995.

Editors Note:

1. **The master figures are in a companion PowerPoint file. When inserting a figure into this document use Edit | Paste Special | Past as a Windows Metafile. Then set Text Wrapping In Line with Text. Doing this avoids**
 - **use of the anchor which can cause the figure to move as text is added/deleted**
 - **allows the figure to be resized as desired**
 - **prevents the figure from being edited inside the document which can cause confusion over where the master is for a figure. The master should always be the PowerPoint figure.**
2. The outline of section 5 has been changed to make it promote items previously buried in the outline. The new outline:
 - 5.1 Types of Control - use this to briefly introduce however many types of control we declare.
 - 5.2 Procedural elements - much of this section was buried in the procedural control section. This has been elevated to be one of the major batch control concepts. This section includes the introduction of the procedural control model, Procedural Element's structures, what collapsing and expanding mean, and how Procedural Element's are used in recipe and equipment. This section defines items that will be referenced in the recipe-equipment linkage section.
 - 5.3 Equipment entities - this section is unchanged
 - 5.4 Recipes - this is now a smaller section, the linkage discussion has been moved to its own level 2 section. The content has been re-organized so recipe contents common to all recipe types are discussed then the 4 recipe types are introduced with a discussion of how the common contents are different for each type. Recipe entity material from Part 2 has been brought into this so there would be parity at the entity level between recipes and equipment. This plays into the diagrams in section 5.5
 - 5.5 Connecting recipe entities and equipment entities. This section describes how the recipe-equipment linkage can be done, both using the full procedural control model and collapsing it. There are substantial changes from draft 2.

ISA-S88.01, Batch Control, Part 1: Models and Terminology

ISBN: 1-55617-562-0

Copyright © 1995 by the Instrument Society of America. All rights reserved. Printed in the United States of America. No part of this publication may be reproduced, stored in a retrieval system, or transmitted, in any form or by any means (electronic, mechanical, photocopying, recording, or otherwise), without the prior written permission of the Publisher.

ISA

67 Alexander Drive

P. O. Box 12277

Research Triangle Park, NC

Preface

Editor's Note – let the ISA edit the next 3 paragraphs when the final edits are done after approval of the update.
--

This standard has been prepared as part of the service of the ISA — The International Society for Measurement and Control — toward a goal of uniformity in the field of instrumentation. To be of real value, this document should not be static but should be subject to periodic review. Toward this end, the Society welcomes all comments and criticisms and asks that they be addressed to the Secretary, Standards and Practices Board; ISA; 67 Alexander Drive; P. O. Box 12277; Research Triangle Park, NC 27709; Telephone (919) 990-9227; Fax (919) 549-8288; Internet: INFO@ISA.ORG.

The ISA Standards and Practices Department is aware of the growing need for attention to the metric system of units in general, and the International System of Units (SI) in particular, in the preparation of instrumentation standards, recommended practices, and technical reports. The Department is further aware of the benefits to USA users of ISA standards of incorporating suitable references to the SI (and the metric system) in their business and professional dealings with other countries. Toward this end, this Department will endeavor to introduce SI-acceptable metric units in all new and revised standards to the greatest extent possible. The Metric Practice Guide, which has been published by the Institute of Electrical and Electronics Engineers as ANSI/IEEE Std. 268-1992, and future revisions, will be the reference guide for definitions, symbols, abbreviations, and conversion factors.

It is the policy of ISA to encourage and welcome the participation of all concerned individuals and interests in the development of ISA standards, recommended practices, and technical reports. Participation in the ISA standards-making process by an individual in no way constitutes endorsement by the employer of that individual, of ISA, or of any of the standards, recommended practices, and technical reports that ISA develops.

This part of the standard is structured to follow the IEC (International Electrotechnical Commission) guidelines. Therefore, the first three clauses discuss the Scope of the standard, Normative References, and Definitions, in that order.

Clause 4 is entitled *Batch Processes and Equipment* and is normative. The intent of this clause is to describe batch processes and the equipment used to perform them. This clause provides a foundation for understanding the application of batch control to the batch manufacturing plant as described in Clauses 5 and 6.

Clause 5 is entitled *Batch Control Concepts* and is normative. The intent of this clause is to describe key aspects of batch control with emphasis on procedural control, recipes, and the separation of recipe and equipment.

Clause 6 is entitled *Batch Control Activities and Functions* and is normative. The intent of this clause is to describe the control activities that are needed to address the diverse control requirements of batch manufacturing.

Clause 7 is entitled *Completeness, compliance and conformance* and is normative. The intent of this clause is to state the completeness, compliance and conformance requirements for this part of the standard.

Annex A is informative. It defines the data modeling techniques used in this part of the standard.

Annex B is informative. It presents a bibliography.

Annex C is informative. It provides answers to typical questions that may arise in applying this standard.

This standard (Part 1, Models and Terminology) is intended for people who are

- involved in designing and/or operating batch manufacturing plants;
- responsible for specifying controls and the associated application programs for batch manufacturing plants; or
- involved in the design and marketing of products in the area of batch control.

The following people served as active members of the ISA Committee SP88 Part 1 Update Working Group:

Name	Company
P. Nowicki, WG Chairman/Editor	Rockwell Automation
R. Dwiggins, WG Secretary	Maverick Technologies
M. Albano	Honeywell
D. Brandl	DB Consulting
D. Chappell	P&G
L. Charpentier	NovaTech
L. Craig	consultant
E. Delahostria	Rockwell Automation
D. Emerson	Yokogawa
G. Finucci	EnteGreat
A. Ghosh	ARC Advisory
A. Gillanders	DynoChem Inc
M. Hakes	Colt Engineering
B. Lightle	Rockwell Automation
E. Lynche	Pfizer
P. Martin	ABB
T. Müller-Heinzerling	Siemens
S. Murray	Emerson Process
A. Pampel	consultant
H. Salomons	Dow
T. Tom	Siemens
K. Unger	Stonetek
F. Vinther	NNE Pharmaplan
K. Waters	Genentech
K. Yuen	GE Fanuc

The following people served as active members of the original ISA Committee SP88:

Name	Company
. Craig, Chairman	Rohm and Haas Company
*R. Mergen, Past Chairman	The Lubrizol Corporation
*T. Fisher, Past Chairman/Editor	The Lubrizol Corporation
C. Gross, Past Managing Director	Dow Chemical Company
*M. Albano	Honeywell, Inc.
A. Aujesky	ICI Australia Engineering
*J. Barrault	Siemens
G. Barron	John Brown Engineers & Constructors BV
R. Baxter	Eastman Kodak Company
*D. Brandl	Groupe Schneider
B. Braunstein	Exxon Chemical Company
*E. Bristol	The Foxboro Company
M. Bruns	Hoechst AG
R. Bullotta	WonderWare
*H. Burns	Fisher•Rosemount
G. Carlo-Stella	Batch Systems International
*B. Casey	Groupe Schneider
D. Chappell	Procter & Gamble Company
*L. Charpentier	Texas Instruments, Inc.
*T. Cowl	Moore Products Company
*B. Cubizolles	Siemens
M. Dawson	Smith-Kline Beecham
*K. Dittman	Johnson Yokogawa
*D. Dodd	The Foxboro Company
*S. Duff	Moore Products Company
*C. Eaves	Intellution, Inc.
*D. Edwards	Johnson Yokogawa
*D. Emerson	Texas Instruments, Inc.
*S. Farmer	ABB Process Automation, Inc.
G. Felton	Ashland Chemical
H. Fittler	Honeywell Regelsysteme
*A. Ghosh	The Foxboro Company

*P. Gustafson	Hartmann & Braun
*R. Hall	PID, Inc.
*W. Hawkins	Fisher•Rosemount
N. Haxthausen	Novo-Nordisk Engineering
*C. Hertz	Bailey Controls Company
S. Hjelmager	CRI Industrial Systems A/S
T. Hoekstra	Yokogawa Europe
*T. Hollowell	Fisher•Rosemount
*D. Hornbeck	Allen-Bradley Co.
*D. Imming	Fisher•Rosemount
*S. Jayanthi	Intellution, Inc.
*B. Jensen	Johnson Yokogawa
T. Jonsson	ABB Automation AB
H. Kayser	Consultant
G. Klipfel	Upjohn Company
*D. Leach	Air Products & Chemicals Company
T. Leffert	3M
*B. Lightle	Allen-Bradley Company
*W. Loner	Bailey Controls Company
R. Lotz	Consultant
B. Lozier	Pacific Access Computer
*D. Macias	Fisher•Rosemount
S. Mallaband	Bass Brewers, Ltd.
*E. Massey	Honeywell, Inc.
W. McFarlane	Valmet Automation, Inc.
*N. Meierhoefer	Hartmann & Braun
*T. Müller-Heinzerling	Siemens AUT 38V5
L. Natiello	Kraft General Foods
K. Ng	Office of Naval Research
*P. Nowicki	ABB Process Automation, Inc.
A. Pampel	A. F. Pampel Consulting
*A. Pawlus	Honeywell, Inc.
*S. Prichard	Fisher•Rosemount
A. Rabinowitz	Consultant

H. Rosenof	Gensym Corporation
*J. Ruhe	Bailey Controls Company
P. Saebye	CRI Industrial Systems A/S
*M. Saucier	PID, Inc.
*C. Schmidt	Siemens
*J. Schwatmann	Siemens
J. Shaffer	Consultant
R. Shilts	Modicon AEG
E. Smith	Good Manufacturing Practices, Inc.
*K. Spencer	ABB Process Automation, Inc.
*J. Sten	E. I. du Pont de Nemours & Company (Ret.)
*F. Sutter	Fisher•Rosemount
*B. Sykes	Johnson Yokogawa
R. Thome	Merck
T. Tom	Fischer & Porter Company
J. Unger	Chesebrough-Pond's (Unilever)
*J. Vardy	The Foxboro Company
J. Verhulst	Biogen, Inc.
J. Via III	Alcon Labs
*N. Vroom	Honeywell, Inc.
*H. Wähler	Hartmann & Braun
*M. Warburton	ABB Process Automation, Inc.
R. Watson	Mettler-Toledo, Inc.
*A. Webster	E. I. du Pont de Nemours & Company
A. Weidenbach	Eastman Chemical Company
*S. Whitman	Johnson Yokogawa
*E. Whitmer	Honeywell, Inc.
*G. Wilcox	Air Products & Chemicals Company

* One vote per company

This published standard was approved for publication by the ISA Standards and Practices Board in February 1995.

Name	Company
M. Widmeyer, Vice President	The Supply System
H. Baumann	H. D. Baumann & Associates, Ltd.
D. Bishop	Chevron USA Production Company
P. Brett	Honeywell, Inc.
W. Calder III	Foxboro Company
H. Dammeyer	The Ohio State University
R. Dieck	Pratt & Whitney
H. Hopkins	Utility Products of Arizona
A. Iverson	Lyondell Petrochemical Company
K. Lindner	Endress + Hauser GmbH + Company
T. McAviney	Metro Wastewater Reclamation District
A. McCauley, Jr.	Chagrin Valley Controls, Inc.
G. McFarland	Consultant
J. Mock	Consultant
E. Montgomery	Fluor Daniel, Inc.
D. Rapley	Rapley Engineering Services
R. Reimer	Allen-Bradley Company
R. Webb	Pacific Gas & Electric Company
W. Weidman	Consultant
J. Weiss	Electric Power Research Institute
J. Whetstone	National Institute of Standards & Technology
C. Williams	Eastman Kodak Company
G. Wood	Graeme Wood Consulting
M. Zielinski	Fisher•Rosemount

Contents

Preface	4
FOREWORD	15
FOREWORD	15

INTRODUCTION	16
1. Scope.....	18
2. Normative references	18
3. Definitions	19
4. Batch processes and equipment	27
4.1 Processes, batches, and batch processes	27
4.1.1 Continuous processes.....	27
4.1.2 Discrete parts manufacturing processes	27
4.1.3 Batch processes.....	27
4.1.4 Process stages	28
4.1.5 Process operations	28
4.1.6 Process actions.....	28
4.2 Physical model.....	29
4.2.1 Enterprise level	31
4.2.2 Site level	32
4.2.3 Area level.....	32
4.2.4 Process cell level.....	32
4.2.5 Unit level	33
4.2.6 Equipment module level	33
4.2.7 Control module level.....	34
4.2.8 Physical Model Examples	34
4.3 Process cell classification	35
4.3.1 Classification by number of products.....	35
4.3.2 Classification by physical structure.....	36
5. Batch control concepts.....	38
5.1 Types of control.....	38
5.1.1 Basic control	38
5.1.2 Procedural control.....	39
5.1.3 Coordination control	39
5.2 Procedural elements.....	40
5.2.1 Process Cell Procedure	40
5.2.2 Unit procedure	40
5.2.3 Operation	41
5.2.4 Phase	41
5.2.5 Collapsing and Expanding the Procedural Control Model.....	42
5.2.6 Procedural Element Structure	42
5.2.7 Recipe Procedural Elements and Equipment Procedural Elements	44
5.3 Equipment entities	46
5.3.1 Procedural control model/physical model/process model relationship	47
5.3.2 Equipment control in equipment entities.....	47
5.3.3 Structuring of equipment entities	51
5.4 Recipes	53
5.4.1 Recipe contents	53
5.4.2 Recipe types.....	55
5.4.3 Recipe entity	62
5.4.4 Recipe transportability	63
5.5 Connecting recipe entities and equipment entities	64
5.5.1 Connecting recipe procedural elements, equipment procedural elements and basic control.....	65
5.5.2 Using recipe procedural elements in master recipes	67

5.5.3	Connecting recipe procedural elements, equipment procedural elements and equipment control when the control recipe uses a collapsed procedural control model	68
5.5.4	Connecting recipe procedural elements, equipment procedural elements and equipment control when the control recipe uses an expanded procedural control model	75
5.6	Production plans and schedules	75
5.6.1	Campaign	76
5.7	Production information	76
5.7.1	Batch-specific information	77
5.7.2	Common (non-batch specific) batch information	77
5.7.3	Batch history	78
5.7.4	Batch reports	78
5.8	Allocation and arbitration	79
5.8.1	Allocation	79
5.8.2	Arbitration	80
5.9	Modes and states	80
5.9.1	Modes	80
5.9.2	States	81
5.10	Exception handling	85
6.	Batch control activities and functions	87
6.1	Control activities	87
6.1.1	Control activity model	87
6.1.2	Information handling	88
6.1.3	Process and control engineering	90
6.2	Recipe management	92
6.2.1	Manage general recipes	92
6.2.2	Define general recipe procedural elements	92
6.2.3	Manage site recipes	94
6.2.4	Manage master recipes	94
6.2.5	Define master recipe procedural elements	95
6.3	Production planning and scheduling	96
6.4	Production information management	96
6.4.1	Receiving and storing batch history information	97
6.4.2	Manipulating historical data	100
6.4.3	Producing batch reports	100
6.5	Process Cell Management	102
6.5.1	Manage batches	102
6.5.2	Track and allocate process cell resources	104
6.5.3	Collect batch and process cell information	106
6.6	Unit supervision	106
6.6.1	Acquire and execute procedural elements	107
6.6.2	Manage unit resources	108
6.6.3	Collect batch and unit information	108
6.7	Process control	109
6.7.1	Execute equipment phases	109
6.7.2	Execute basic control	110
6.7.3	Collect Data	111
6.8	Personnel and environmental protection	111
Annex A	(informative) Bibliography	113
Annex B	(informative) Frequently asked questions	114
Annex C	(informative) Assessment of Conformance to ISA-88 Part 1	117

Figures

FIGURE 1 — PROCESS MODEL (ENTITY - RELATIONSHIP DIAGRAM).....	29
FIGURE 2 — PHYSICAL MODEL	31
FIGURE 3 — PHYSICAL MODEL EXAMPLES	35
FIGURE 4 — SINGLE-PATH STRUCTURE.....	36
FIGURE 5 — MULTIPLE-PATH STRUCTURE	36
FIGURE 6 — NETWORK STRUCTURE	37
FIGURE 7 — PROCEDURAL CONTROL MODEL	40
FIGURE 8 — EQUIPMENT ENTITIES	46
FIGURE 9 — PROCEDURAL CONTROL/EQUIPMENT MAPPING TO ACHIEVE PROCESS FUNCTIONALITY	48
FIGURE 10 — RECIPE TYPES	56
FIGURE 11 — GENERAL/SITE RECIPE PROCEDURE LEVELS	58
FIGURE 12 — MASTER RECIPE PROCEDURE LEVELS	60
FIGURE 13 — PROCEDURAL ELEMENT RELATIONSHIPS IN THE SITE RECIPE AND MASTER RECIPE.....	61
FIGURE 14- RECIPE ENTITY ENCAPSULATION	63
FIGURE 15 - INFORMATION FLOW FROM GENERAL RECIPE TO EQUIPMENT ENTITY	64
FIGURE 16 — SEPARATION OF THE TYPES OF PROCEDURAL ELEMENTS AND EXTERNAL PROCEDURAL ELEMENT TAST STRATEGY	66
FIGURE 17 — CONTROL RECIPE PROCEDURE/EQUIPMENT CONTROL SEPARATION.....	69
FIGURE 18 — REFERENCING EQUIPMENT ENTITIES AT DIFFERENT LEVELS WITHIN A CONTROL RECIPE PROCESS CELL PROCEDURE	70
FIGURE 19 — CONTROL RECIPE PROCEDURE EXAMPLE WITH UNIT PROCEDURES AND OPERATIONS	71
FIGURE 20 — CONTROL RECIPE PROCEDURE EXAMPLE WITH UNIT PROCEDURES.....	72
FIGURE 21 — CONTROL RECIPE PROCEDURE EXAMPLE WITH ONLY A PROCESS CELL PROCEDURE.....	73
FIGURE 22 — CONTROL RECIPE PROCEDURE/EQUIPMENT CONTROL COLLAPSIBILITY EXAMPLES.....	74
FIGURE 23 — STATE TRANSITION DIAGRAM FOR EXAMPLE STATES FOR PROCEDURAL ELEMENTS	86
FIGURE 24 — CONTROL ACTIVITY MODEL	88
FIGURE 25 — SIMULTANEOUS DEFINITION/SELECTION OF PROCEDURAL ELEMENTS AND EQUIPMENT ENTITIES	91
FIGURE 26 — RECIPE MANAGEMENT	93
FIGURE 27 — PROCESS CELL MANAGEMENT	103
FIGURE 28 — UNIT SUPERVISION.....	107
FIGURE 29 — PROCESS CONTROL	110

Tables

TABLE 1 — MINIMUM PROCEDURAL ELEMENT ATTRIBUTES	43
TABLE 2 — RECIPE AND EQUIPMENT PROCEDURAL ELEMENT LEVELS	44
TABLE 3 — RECIPE AND EQUIPMENT PROCEDURAL ELEMENT STRATEGY CONTENTS.....	44
TABLE 4 — POSSIBLE IMPLEMENTATIONS OF EXAMPLE MODES	81
TABLE 5 — STATE TRANSITION MATRIX FOR EXAMPLE STATES FOR PROCEDURAL ELEMENTS	84

FOREWORD

- (1) The formal decisions or agreements of the IEC on technical matters, prepared by technical committees on which all the National Committees having a special interest therein are represented, express, as nearly as possible, an international consensus of opinion on the subjects dealt with.
- (2) They have the form of recommendations for international use and they are accepted by the National Committees in that sense.
- (3) In order to promote international unification, the IEC expresses the wish that all National Committees should adopt the text of the IEC recommendation for their national rules insofar as national conditions will permit. Any divergence between the IEC recommendation and the corresponding national rules should, as far as possible, be clearly indicated in the latter.
- (4) The IEC has not laid down any procedure concerning marking as an indication of approval and has no responsibility when an item of equipment is declared to comply with one of its recommendations.

This part of this International Standard has been prepared by IEC/SC65A/WG11 and ISA SP88.

It forms part 1 of a series, the other part being Part 2: Data structures and guidelines for languages.

Annex A forms an integral part of this part of this international standard. Refer to Annex A for an explanation of the format and general associations used in creating the diagrams in this international standard. Annex B is for information only.

INTRODUCTION

This part of the international standard on Batch Control provides standard models and terminology for defining the control requirements for batch manufacturing plants. The models and terminology defined in this standard

- emphasize good practices for the design and operation of batch manufacturing plants;
- can be used to improve control of batch manufacturing plants; and
- can be applied regardless of the degree of automation.

This standard provides a standard terminology and a consistent set of concepts and models for batch manufacturing plants and batch control that will improve communications between all parties involved; and that will

- reduce the user's time to reach full production levels for new products;
- enable vendors to supply appropriate tools for implementing batch control;
- enable users to better identify their needs;
- make recipe development straightforward enough to be accomplished without the services of a control systems engineer;
- reduce the cost of automating batch processes; and
- reduce life-cycle engineering efforts.

It is not the intent of this standard to

- suggest that there is only one way to implement or apply batch control;
- force users to abandon their current way of dealing with their batch processes; or
- restrict development in the area of batch control.

The key concepts defined in this standard are:

- structure and format for recipes and procedures;
- levels of recipes and procedures;
- separation of product specific recipes from process oriented equipment;
- identification of a hierarchy of manufacturing equipment;
- recognition of equipment capabilities that are utilized during recipe and procedure driven production
- modular and re-usable control functionality.

The models presented in this standard are presumed to be complete as indicated. However, they may be collapsed and expanded as described in the explanation of each model. The master

recipe and the control recipe may not be omitted from the recipe types model. Specific rules for collapsing and expanding these models are covered in clauses 4 and 5 of this standard.

- Collapsing: Elements in the models may be omitted as long as the model remains consistent, and the functions of the element removed are taken into account.
- Expanding: Elements may be added to the models. When they are added between related elements, the integrity of the original relationship must be maintained.

1. Scope

This part of the standard on Batch Control defines reference models for batch control as used in the process industries and terminology that helps explain the relationships between these models and terms.

2. Normative references

The following normative documents contain provisions, which through reference in this text, constitute provisions of this part of this standard. At the time of publication, the editions indicated were valid. All normative documents are subject to revision, and parties to agreements based on this part of this standard are encouraged to investigate the possibility of applying the most recent editions of the normative documents indicated below. Members of ANSI/ISA, IEC and ISO maintain registers of currently valid normative documents.

— IEC 848: 1988, Preparation of function charts for control systems

NOTE — Structures defined in IEC 848 may be useful in the definition of procedural control, and in particular in the definition of a phase.

— IEC 902: 1987, Industrial-process measurement and control — Terms and definitions

NOTE — Definitions found in IEC 902 were used as a basis for definitions in this standard. Where necessary, the specific connotation of terms used in batch control were included as definitions in this standard.

— ANSI/ISA 95.00.01-2000, Enterprise/Control System Integration – Part 1: Models and Terminology

— ANSI/ISA 95.00.02-2001, Enterprise/Control System Integration – Part 2: Object Model Attributes

— IEC/ISO 62264-1, Enterprise/Control System Integration - Part 1: Models and Terminology

— IEC/ISO 62264-2, Enterprise/Control System Integration - Part 2: Object Model Attributes

3. Definitions

For the purposes of this part of this international standard, the following definitions apply.

3.1 allocation:

A form of coordination control that assigns a resource to a batch or unit.

NOTE — An allocation can be for the entire resource or for portions of a resource.

3.2 arbitration:

A form of coordination control that determines how a resource should be allocated when there are more requests for the resource than can be accommodated at one time.

3.3 area:

A component of a batch manufacturing site that is identified by physical, geographical, or logical segmentation within the site.

NOTE — An area may contain process cells, units, equipment modules, and control modules.

3.4 basic control:

Basic control comprises the control dedicated to establishing and maintaining a specific state or behavior of equipment and process

NOTE — Basic control may include regulatory control, interlocking, monitoring, exception handling, and discrete or sequential control necessary for establishing or maintaining a specific state or behavior.

3.5 batch:

1.) The material that is being produced or that has been produced by a single execution of a batch process. 2.) An entity that represents the production of a material at any point in the process.

NOTE — Batch means both the material made by and during the process and also an entity that represents the production of that material. Batch is used as an abstract contraction of the words "the production of a batch."

3.6 batch control:

Control activities and control functions that provide a means to process finite quantities of input materials by subjecting them to an ordered set of processing activities over a finite period of time using one or more pieces of equipment.

3.7 batch process:

A process that leads to the production of finite quantities of material by subjecting quantities of input materials to an ordered set of processing activities over a finite period of time using one or more pieces of equipment.

3.8 batch schedule:

A list of batches to be produced in a specific process cell.

NOTE — The batch schedule typically contains such information as what is to be produced, how much is to be produced, when or in what order the batches are to be produced, and what equipment is to be used..

3.9 batch unit

A unit performing a batch production role.

NOTE 1 — This term applies to both the physical equipment and the equipment entity.

NOTE 2 — The unit level may not be omitted from the physical model.

NOTE 3 — Examples of major processing activities are react, crystallize, and make a solution.

3.10 common resource:

A resource that can provide services to more than one requester.

NOTE — Common resources are identified as either exclusive-use resources or shared-use resources (3.22 and 3.54).

3.11 control module:

The lowest level grouping of equipment in the physical model that can carry out basic control.

NOTE 1 — This term applies to both the physical equipment and the equipment entity.

NOTE 2 — The control module level may not be omitted from the physical model.

3.12 control recipe:

A type of recipe which, through its execution, defines the manufacture of a single batch of a specific product.

NOTE 1 — The control recipe may not be omitted from the recipe types model.

3.13 coordination control:

A type of control that directs, initiates, and/or modifies the execution of procedural control and the utilization of equipment entities.

3.14 enterprise:

An organization that coordinates the operation of one or more sites.

3.15 equipment control:

The equipment-specific functionality that provides the actual control capability for an equipment entity, including procedural, basic, and coordination control, and that is not part of the recipe.

3.16 equipment entity:

A collection of physical processing and control equipment and equipment control grouped together to perform a certain control function or set of control functions.

3.17 equipment module:

A functional group of equipment that can carry out a finite number of specific minor processing activities.

NOTE 1 — An equipment module is typically centered around a piece of process equipment (a weigh tank, a process heater, a scrubber, etc.). This term applies to both the physical equipment and the equipment entity.

NOTE 2 — Examples of minor process activities are dosing and weighing.

3.18 equipment operation:

An operation that is part of equipment control.

3.19 equipment phase:

A phase that is part of equipment control.

3.20 equipment procedure:

A procedure that is part of equipment control.

3.21 equipment unit procedure:

A unit procedure that is part of equipment control.

3.22 equipment phase procedure

The part of an equipment phase that directs one or more equipment task strategies.

3.23 equipment process cell procedure

The part of an equipment process cell procedure that defines the sequencing and ordering of equipment unit procedures.

3.24 equipment operation procedure

The part of an equipment operation that defines the sequencing and ordering of equipment phases.

NOTE: An equipment operation procedure does not direct equipment task strategies.

Editor note: Need to add comment to Table 4 or to the collapsibility discussion on how operations might direct task strategies if we have collapsed to have no phases.

3.25 equipment unit procedure procedure (the procedure part of a unit procedure)

The part of an equipment unit procedure that defines the sequencing and ordering of equipment operations.

3.26 exception handling:

Those functions that deal with plant or process contingencies and other events which occur outside the normal or desired behavior of batch control.

3.27 exclusive-use resource:

A common resource that only one user can use at any given time.

3.28 formula:

A category of recipe information that includes process inputs, process parameters, and process outputs.

3.29 general recipe:

A type of recipe that expresses equipment and site independent processing requirements.

3.30 header:

Information about the purpose, source and version of the recipe such as recipe and product identification, creator, and issue date.

3.31 ID:

A unique identifier for batches, lots, operators, technicians, and raw materials.

3.32 line; train:

See definition for train.

3.33 lot:

A unique amount of material having a set of common traits.

NOTE — Some examples of common traits are material source, the master recipe used to produce the material, and distinct physical properties.

3.34 master recipe:

A type of recipe that accounts for equipment capabilities and may include process cell-specific information.

NOTE 1 — The master recipe may not be omitted from the recipe types model.

3.35 mode:

The manner in which the transition of sequential functions are carried out within a procedural element or the accessibility for manipulating the states of equipment entities manually or by other types of control.

3.36 operation:

A procedural element defining an independent processing activity consisting of the algorithm necessary for the initiation, organization, and control of phases.

3.37 path; stream:

The order of equipment within a process cell that is used, or is expected to be used, in the production of a specific batch.

3.38 personnel and environmental protection:

The control activity that

- (1) prevents events from occurring that would cause the process to react in a manner that would jeopardize personnel safety and/or harm the environment; and/or
- (2) takes additional measures, such as starting standby equipment, to prevent an abnormal condition from proceeding to a more undesirable state that would jeopardize personnel safety and/or harm the environment.

3.39 phase:

The lowest level of procedural element in the procedural control model.

3.40 procedural control:

The type of control that executes a procedure.

3.41 procedural element:

A building block for procedural control that is defined by the procedural control model.

3.42 procedure:

A specification of a sequence of steps, actions or activities with a defined beginning and end that is intended to accomplish a specific objective or task.

NOTE - The strategy for making a batch within a process cell is generally described by a procedure called a process cell procedure. Such a procedure may also define a process that does not result in the production of product, such as a clean-in-place procedure.

NOTE: This general definition is applied to all levels of the procedural hierarchy in the definitions for process cell procedure, unit procedure procedure, operation procedure, and phase procedure.

3.43 process:

A sequence of chemical, physical, or biological activities for the conversion, transport, or storage of material or energy.

3.44 process action:

Minor processing activities that are combined to make up a process operation.

NOTE — Process actions are the lowest level of processing activity within the process model.

3.45 process cell:

A logical grouping of equipment that includes the equipment required for production of one or more batches. It defines the span of logical control of one set of process equipment within an area.

NOTE — This term applies to both the physical equipment and the equipment entity.

3.46 process control:

The control activity that includes the control functions needed to provide sequential, regulatory, and discrete control and to gather and display data.

3.47 process input:

The identification and quantity of a raw material or other resource required to make a product.

3.48 Process Cell Management:

The control activity that includes the control functions needed to manage batch production within a process cell.

3.49 process operation:

A major processing activity that usually results in a chemical or physical change in the material being processed and that is defined without consideration of the actual target equipment configuration.

3.50 process output:

An identification and quantity of material or energy expected to result from one execution of a control recipe.

3.51 process parameter:

Information that is needed to manufacture a material but does not fall into the classification of process input or process output.

NOTE — Examples of process parameter information are temperature, pressure, and time.

3.52 process stage:

A part of a process that usually operates independently from other process stages and that usually results in a planned sequence of chemical or physical changes in the material being processed.

3.53 recipe:

The necessary set of information that uniquely defines the production requirements for a specific product or operational procedure.

NOTE — There are four types of recipes defined in this standard: general, site, master, and control.

3.54 recipe management:

The control activity that includes the control functions needed to create, store, and maintain general, site, and master recipes.

Editor note: Need to go back and define full recipe phase, operation, unit procedure, recipe (not just the procedure part).

3.55 recipe procedure

General classification of a procedure applied in the recipe.

NOTE: A recipe procedure is intended to provide product specific flexibility beyond parameter and formula changes, without making equipment modifications.

3.56 recipe operation procedure:

The part of a recipe which either defines the sequencing and ordering of recipe phases, or references an equipment operation.

3.57 recipe phase procedure:

The part of a recipe which defines the references the equipment phase.

3.58 recipe process cell procedure:

The part of a recipe which either defines the sequencing and ordering of recipe unit procedures, or references an equipment cell procedure.

3.59 recipe unit procedure procedure: (the procedure part of a unit procedure)

The part of a recipe which either defines the sequencing and ordering of recipe operations, or references an equipment unit procedure.

3.60 shared-use resource:

A common resource that can be used by more than one user at a time.

3.61 site:

A component of a batch manufacturing enterprise that is identified by physical, geographical, or logical segmentation within the enterprise.

NOTE — A site may contain areas, process cells, units, equipment modules, and control modules.

3.62 site recipe:

A type of recipe that is site specific.

NOTE — Site recipes may be derived from general recipes recognizing local constraints, such as language and available raw materials.

NOTE — Site recipes may include routing information necessary for coordinating manufacturing across process cells and production scheduling activities.

3.63 state:

The condition of an equipment entity or of a procedural element at a given time.

NOTE — The number of possible states and their names vary for equipment and for procedural elements.

3.64 stream; path:

See definition for path.

3.65 train; line:

A collection of one or more units and associated lower level equipment groupings that has the ability to be used to make a batch of material.

3.66 unit:

A collection of associated control modules and/or equipment modules and other process equipment in which one or more major processing activities can be conducted. See batch unit.

3.67 unit procedure:

A strategy for carrying out a contiguous process within a unit. It consists of contiguous operations and the algorithm necessary for the initiation, organization, and control of those operations.

3.68 unit recipe:

The part of a control recipe that uniquely defines the contiguous production requirements for a unit.

NOTE — The unit recipe contains the unit procedure and its related formula, header, equipment requirements, and other information.

3.69 unit supervision:

The control activity that includes control functions needed to supervise the unit and the unit's resources.

4. Batch processes and equipment

This section provides an overview of batch processing and the batch manufacturing plant. The models and terminology defined in this section provide a foundation for understanding the application of batch control to the batch manufacturing plant in Sections 5 and 6. Specifically, this section discusses batch processes, a physical model, and process cell classification.

4.1 Processes, batches, and batch processes

A process is a sequence of chemical, physical or biological activities for the conversion, transport or storage of material or energy. Industrial manufacturing processes can generally be classified as continuous, discrete parts manufacturing, or batch. How a process is classified depends on whether the output from the process appears in a continuous flow (continuous), in finite quantities of parts (discrete parts manufacturing), or in finite quantities of material (batches). Although aspects of this standard may apply to discrete parts manufacturing or continuous processes, this standard does not specifically address these types of processes.

4.1.1 Continuous processes

In a continuous process, materials are passed in a continuous flow through processing equipment. Once established in a steady operating state, the nature of the process is not dependent on the length of time of operation. Start-ups, transitions, and shutdowns do not usually contribute to achieving the desired processing.

The concepts of batch processing in this standard may be applied to continuous processing for such control as startups, grade changes, and shutdowns. Some modifications would be needed to address these unique processing needs. For example, when a grade change occurs, a new product or recipe may need to be started without stopping material flows. However, a full discussion of such applications is beyond the scope of this standard.

4.1.2 Discrete parts manufacturing processes

In a discrete parts manufacturing process, products are classified into production lots that are based on common raw materials, production requirements, and production histories. In a discrete parts manufacturing process, a specified quantity of product moves as a unit (group of parts) between workstations, and each part maintains its unique identity.

The concepts of batch processing in this standard may be applied to discrete parts processing for such control as startups, change-overs, and shutdowns. However, a full discussion of such applications is beyond the scope of this standard.

4.1.3 Batch processes

The batch processes addressed in this standard lead to the production of finite quantities of material (batches) by subjecting quantities of input materials to a defined order of processing actions using one or more pieces of equipment. The product produced by a batch process is

called a batch. Batch processes are discontinuous processes. Batch processes are neither discrete nor continuous; however, they have characteristics of both.

The defined order of processing for a batch is called the process definition. The subdivisions of a batch process definition can be organized in a hierarchical fashion as shown in Figure 1. The example batch process used in this section is the production of polyvinyl chloride by the polymerization of vinyl chloride monomer.

4.1.4 Process stages

The process definition consists of one or more process stages which are organized as an ordered set, which can be serial, parallel, or both. A process stage is a part of a process definition that usually operates independently from other process stages. It usually results in a planned sequence of chemical or physical changes in the material being processed. Typical process stages in the polyvinyl chloride process might be the following:

- Polymerize: Polymerize vinyl chloride monomer into polyvinyl chloride.
- Recover: Recover residual vinyl chloride monomer.
- Dry: Dry polyvinyl chloride.

4.1.5 Process operations

Each process stage consists of an ordered set of one or more process operations. Process operations represent major processing activities. A process operation usually results in a chemical or physical change in the material being processed. Typical process operations for the polymerization of vinyl chloride monomer into polyvinyl chloride process stage might be the following:

- Prepare reactor: Evacuate the reactor to remove oxygen.
- Charge: Add demineralized water and surfactants.
- React: Add vinyl chloride monomer and catalyst, heat to 55 - 60°C, and hold at this temperature until the reactor pressure decreases.

4.1.6 Process actions

Each process operation consists of an ordered set of one or more process actions that carry out the processing required by the process operation. Process actions describe minor processing activities that are combined to make up a process operation. Typical process actions for the react process operation might be the following:

- Add: Add the required amount of catalyst to the reactor.
- Add: Add the required amount of vinyl chloride monomer to the reactor.
- Heat: Heat the reactor contents to 55 - 60°C.
- Hold: Hold the reactor contents at 55 - 60°C until the reactor pressure decreases.

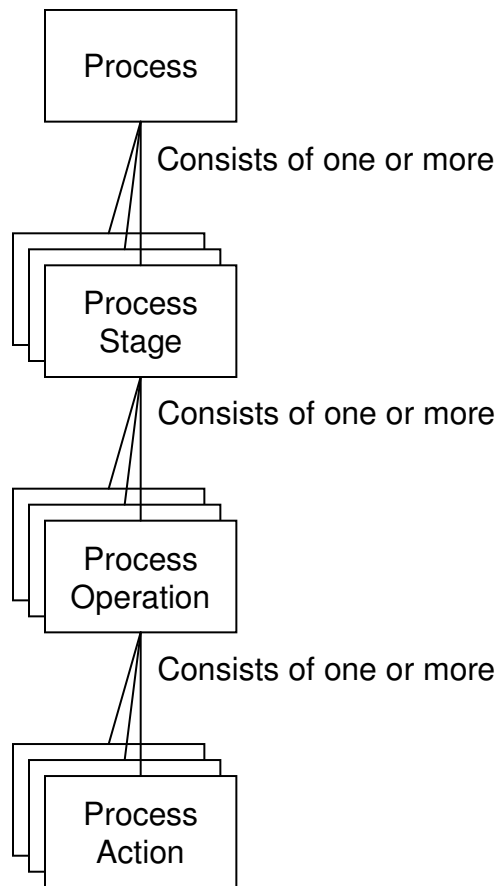


Figure 1 — Process model (Entity - Relationship diagram)

4.2 Physical model

This section discusses a physical model that can be used to describe the physical assets of an enterprise in terms of enterprises, sites, areas, process cells, units, equipment modules, and control modules.

The physical assets of an enterprise involved in batch manufacturing are usually organized in a hierarchical fashion as described in [Figure 2 — Physical model](#). Lower level groupings are combined to form higher levels in the hierarchy. In some cases, a grouping within one level may be incorporated into another grouping at that same level.

The model has seven levels, starting at the top with an enterprise, a site, and an area. These three levels are frequently defined by business considerations and are not modeled further in this document. The three higher levels are part of the model to properly identify the relationship of the lower level equipment to the manufacturing enterprise and are more precisely defined in the IEC/ISO 62264 and ANSI/ISA 95 standards.

The lower four levels of this model refer to specific equipment types. An equipment type in Figure 2 is a collection of physical processing and control equipment grouped together for a specific purpose. The lower levels in the model are specific to technically defined and bounded groupings of equipment. The four lower equipment levels (process cells, units, equipment modules, and control modules) are defined by engineering activities (see 5.2.3 and 6.1.3).

During these engineering activities, the equipment at lower levels is grouped together to form a new higher level equipment grouping. This is done to simplify operation of that equipment by treating it as a single larger piece of equipment. Once created, the equipment cannot be split up except by re-engineering the equipment in that level.

The physical model presented is complete as indicated, but may be collapsed or expanded. However, the unit and the control module levels may not be omitted from the physical model.

The enterprise is responsible for determining what products will be manufactured, at which sites they will be manufactured, and in general how they will be manufactured.

There are many factors other than batch control that affect the boundaries of an enterprise. Therefore, the criteria for configuring the boundaries of an enterprise are not covered in this standard.

4.2.2 Site level

A site is a physical, geographical, or logical grouping determined by the enterprise. It may contain areas, process cells, units, equipment modules, and control modules.

The boundaries of a site are usually based on organizational or business criteria as opposed to technical criteria. There are many factors other than batch control that affect these boundaries. Therefore, the criteria for configuring the boundaries of a site are not covered in this standard.

4.2.3 Area level

An area is a physical, geographical, or logical grouping determined by the site. It may contain process cells, units, equipment modules, and control modules.

The boundaries of an area are usually based on organizational or business criteria as opposed to technical criteria. There are many factors other than batch control that affect these boundaries. Therefore, the criteria for configuring the boundaries of an area are not covered in this standard.

4.2.4 Process cell level

The Process Cell as described in this standard corresponds to the Work Center as described in IEC/ISO 62264 and ANSI/ISA 95. While the Work Center may be specialized for many different types of manufacturing, the Work Center defined as a Process Cell is described only in batch processing terms and examples in this standard.

A process cell is a logical grouping of equipment that includes the equipment required for production of one or more batches. It defines the span of logical control of one set of process equipment within an area. The existence of the process cell allows for production scheduling on a process cell basis, and also allows for process cell-wide control strategies to be designed. These process cell-wide control strategies might be particularly useful in emergency situations.

A process cell contains all of the units, equipment modules, and control modules required to make one or more batches.

Process control activities must respond to a combination of control requirements using a variety of methods and techniques. Requirements that cause physical control actions may include responses to process conditions or to comply with administrative requirements.

A frequently recognized subdivision of a process cell is the train. A train is composed of all units and other equipment that may be utilized by a specific batch. A batch does not always use all the equipment in a train. Furthermore, more than one batch and more than one product may use a train simultaneously. The order of equipment actually used or expected to be used by a batch is called the path. Although a process cell may contain more than one train, no train may contain equipment outside the boundaries of the process cell.

4.2.5 Unit level

A unit is made up of equipment modules and control modules. The modules that make up the unit may be configured as part of the unit or may be acquired temporarily to carry out specific tasks.

One or more major processing activities — such as react, crystallize, and make a solution — can be conducted in a unit. It combines all necessary physical processing and control equipment required to perform those activities as an independent equipment grouping. It is usually centered on a major piece of processing equipment, such as a mixing tank or reactor. Physically, it includes or can acquire the services of all logically related equipment necessary to complete the major processing task(s) required of it. Units operate relatively independently of each other.

A batch unit frequently contains or operates on a complete batch of material at some point in the processing sequence of that batch. However, in other circumstances it may contain or operate on only a portion of a batch. A batch unit does not operate on more than one batch at the same time.

Typically a batch unit contains only one batch at a time and in these cases physical separation between batches is common, and usually a business requirement. However, in some processes the separation is not as clear and a logical boundary between batches is used. This is often found in hybrid batch/continuous processes. In hybrid batch/continuous processes both types of process equipment are used within a process cell. In continuous process units it is common for two or more batches to be within the unit at the same time.

Editors note: include text concerning the other types of S95 units....eg: The <S95 standard> defines four types of units; batch, continuous, discrete, and storage. The batch unit is unique in that it does not operate on more than one batch at the same time.

The unit as described in this standard corresponds to a type of Work Unit defined in IEC/ISO 62264 and ANSI/ISA 95. A Work Unit may be specialized for different manufacturing types and functions. More than one type of Work Unit, such as a Storage Unit or a (Continuous Process) Unit may even be required in a batch oriented Process Cell. Unless specifically identified otherwise, the Work Unit referred to in this standard as a “unit” is a batch processing unit and does not refer to the other types of work units identified in IEC/ISO 62264 and ANSI/ISA 95.

4.2.6 Equipment module level

Physically, the equipment module may be made up of control modules and subordinate equipment modules. An equipment module may be part of a unit or a stand-alone equipment grouping within a process cell. If engineered as a stand-alone equipment grouping, it can be an exclusive-use resource or a shared-use resource.

An equipment module can carry out a finite number of specific minor processing activities such as dosing and weighing. It combines all necessary physical processing and control equipment required to perform those activities. It is usually centered on a piece of processing equipment, such as a filter. Functionally, the scope of the equipment module is defined by the finite tasks it is designed to carry out.

4.2.7 Control module level

A control module is typically a collection of sensors, actuators, other control modules, and associated processing equipment that, from the point of view of control, is operated as a single entity. A control module can also be made up of other control modules. For example, a header control module could be defined as a combination of several on/off automatic block valve control modules.

NOTE: When a control module contains another control module, it is often referred to as a compound control module. The term compound control module is not considered an additional level in the physical hierarchy.

Control modules may be part of an equipment module or may be directly subordinate to units or a process cell. The Physical Model does not imply that a control module can be both directly part of a unit and part of an equipment module at the same time. When an individual control module is directly part of a unit, it is not then also part of any equipment module.

Some examples of control modules are

- a regulating device consisting of a transmitter, a controller, and a control valve that is operated via the set point of the device;
- a state-oriented device that consists of an on/off automatic block valve with position feedback switches, that is operated via the set point of the device; or
- a header that contains several on/off automatic block valves and that coordinates the valves to direct flow to one or several destinations based upon the set point directed to the header control module.
- A flow control module which regulates material in a circulated header supply system may be part of a process cell and not any specific unit.

4.2.8 Physical Model Examples

Since the physical assets of batch processing facilities vary greatly, the application of the Physical Model must be flexible. Figure 3 illustrates some expected physical architectures that could be found in typical batch environments. The example shows that in some cases the equipment module level may be collapsed (i.e. Unit 2 contains Control Module 5 directly).

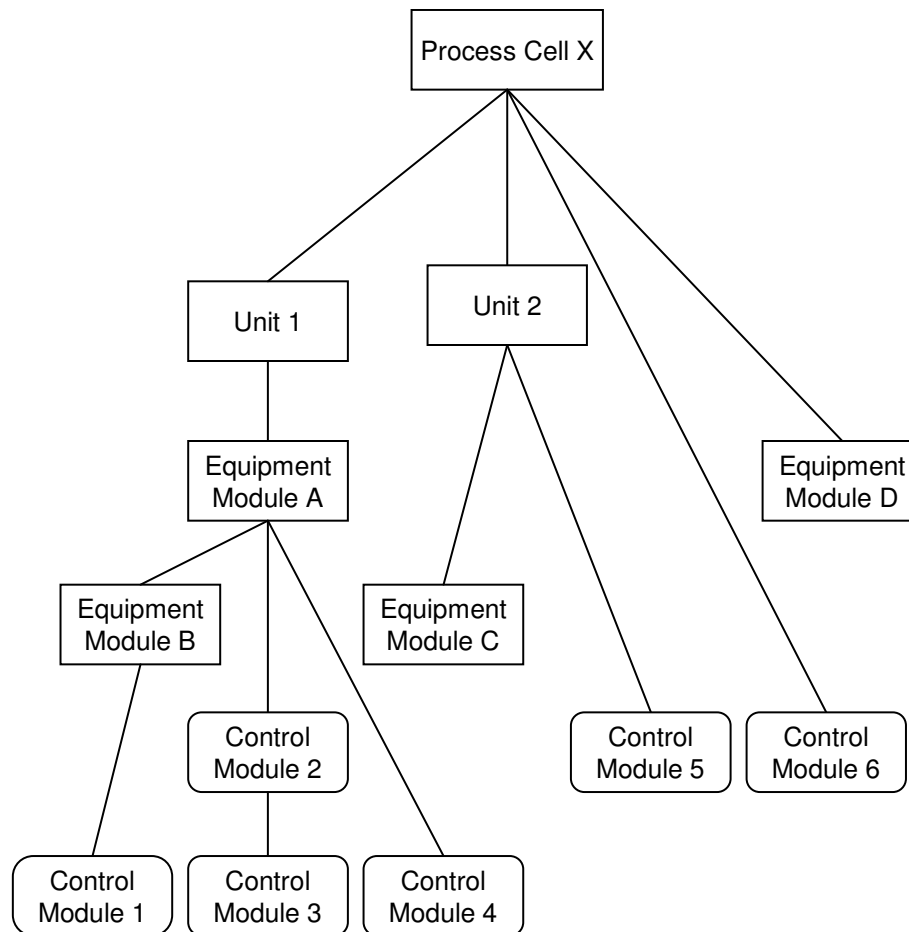


Figure 3 — Physical model examples

4.3 Process cell classification

This section discusses the classification of process cells by the number of different products manufactured in the process cell and by the physical structure of the equipment used in the manufacturing.

4.3.1 Classification by number of products

A process cell is classified as single-product or multi-product based on the number of products planned for production in that process cell.

A single product process cell produces the same product in each batch. Variations in process cell procedures and parameters are possible. For example, variations may occur in order to compensate for differences in equipment, to compensate for substitute raw materials, to compensate for changes in environmental conditions, or to optimize the process.

A multi-product process cell produces different products utilizing different methods of production or control. There are two possibilities:

- All products are produced with the same process cell procedure using different formula values (varying materials and/or process parameters).

— The products are produced using different process cell procedures.

4.3.2 Classification by physical structure

The basic types of physical structures discussed here are single path, multiple path, and network.

A single-path structure is a group of units through which a batch passes sequentially (see Figure 4). A single-path structure could be a single unit, such as a reactor, or several units in sequence. Multiple input materials are typically used; multiple finished materials may be generated. Several batches may be in progress at the same time.




Figure 4 — Single-path structure

A multiple-path structure is shown in Figure 5. It consists of multiple single-path structures in parallel with no product transfer between them. The units may share raw material sources and product storage. Several batches may be in progress at the same time. Although units within a multi-path structure may be physically similar, it is possible to have paths and units within a multi-path structure that are of radically different physical design.

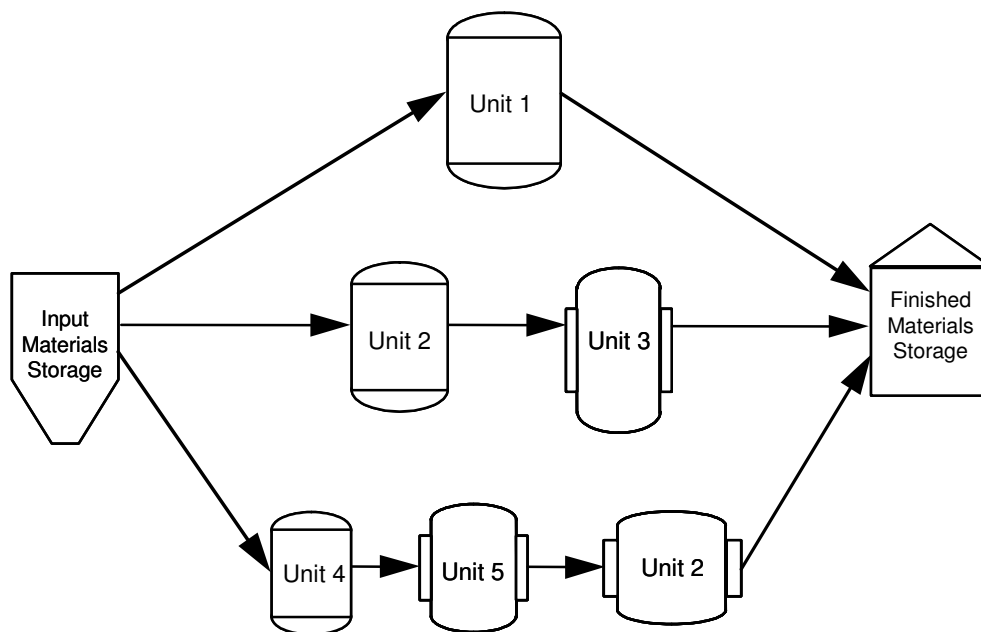


Figure 5 — Multiple-path structure

A network structure is shown in Figure 6. The paths may be either fixed or variable. When the paths are fixed, the same units are used in the same sequence. When the path is variable, the sequence may be determined at the beginning of the batch or it may be determined as the batch is

being produced. The path could also be totally flexible. For example, a batch would not have to start at either Unit 1 or Unit 3; it could start with any unit and take multiple paths through the process cell. The units themselves may be portable within the process cell. In this case, verification of the process connections may be an important part of the process cell procedures. Note that several batches may be in production at the same time. The units may share raw material sources and product storage.

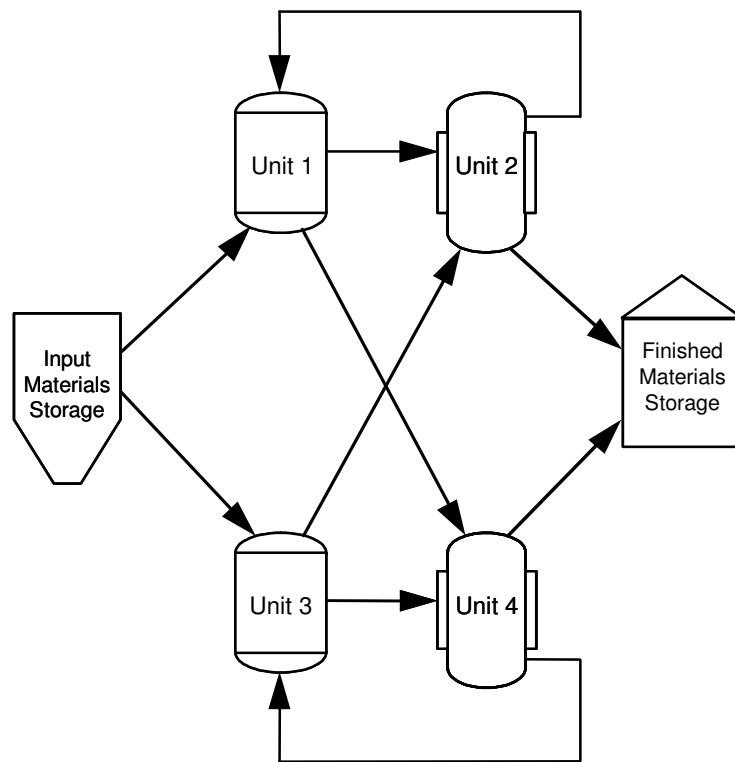


Figure 6 — Network structure

5. Batch control concepts

This section discusses the batch control concepts needed to address the batch processing/batch manufacturing needs presented in the preceding section and to define a consistent way of operating a batch manufacturing plant. A structure for batch control is discussed that introduces three types of control needed for batch manufacturing. When these control types are applied to equipment, the resulting equipment entities provide process functionality and control capability.

The concept of recipes is discussed, including the contents of recipes (in terms of the information categories used to describe a recipe) and the four types of recipes with a description of how recipe contents differ between them. Recipe transportability criteria are introduced for the four types of recipes. Relationships are established among procedural elements found in recipes and in equipment entities. The concept of collapsibility of the recipe process cell procedure and of equipment control is discussed.

Production plans and schedules, reference information, production information, allocation and arbitration, modes and states, and exception handling are other batch control concepts discussed in this section.

The intent of the models and terminology introduced in this section is to establish the necessary batch control understanding so that the control functions that are needed to address the diverse control requirements of batch manufacturing can be discussed in Section 6.

5.1 Types of control

This section describes three types of control (basic control, procedural control, and coordination control) typically needed in batch manufacturing.

5.1.1 Basic control

Basic control comprises the control dedicated to establishing and maintaining a specific state or behavior of equipment and process. Basic control

- includes regulatory control, interlocking, monitoring, exception handling, and discrete or sequential control necessary for establishing or maintaining a specific state or behavior;
- may respond to process conditions that could influence the control outputs or trigger corrective actions;
- may be activated, deactivated, or modified by operator commands or by procedural or coordination control;
- expose equipment and process condition information.

Basic control in a batch environment is in principle no different from the control of continuous processes. However, in the batch environment, there may be higher requirements on the ability for basic control to receive commands and to modify its behavior based on these commands.

NOTE: Basic control is discussed further in Annex C.

5.1.2 Procedural control

The type of control that executes a procedure. Procedural control directs actions to take place in an ordered sequence to carry out a process-oriented task. It is a form of control that is sequential in nature and consists of steps and transitions. Procedural control implements the procedure defined in recipes or equipment.

Procedural control is a characteristic of batch processes. It is the control that orchestrates basic control to take place according to a planned and explicitly ordered sequence of steps. It is the order and content of the procedural sequence that enables equipment to perform a batch process.

There is a difference between implicit sequences in basic control and explicit sequences in procedural control. In basic control, the sequence is primarily equipment oriented, is implicit in the design of the basic control element, usually does not vary from one execution of the basic control element to another and is an inseparable part of the function of setting and maintaining a state or condition in the process.

Examples of basic control sequences include the sequence in which valves must open and shut in order to change a double block and bleed valve assembly from open to closed or the sequence of actions necessary to properly change the speed of a two-speed motor. In procedural control, the sequence causes the execution of a series of planned state or condition changes or a planned and ordered series of process oriented task to take place.

Examples of procedural control would include the order in which raw material is charged to a reactor or sequence of actions necessary to carry out a process oriented task such as charge different amounts and types of raw materials as needed under a variety of conditions.

5.1.3 Coordination control

Coordination control directs, initiates, and/or modifies the execution of procedural control and the utilization of resources for batch processing. It is time varying in nature, like procedural control, but it is not structured along specific process-oriented or equipment-oriented tasks.

Examples of coordination control are algorithms for

- supervising availability and capability (including capacity) of equipment;
- allocating equipment to batches;
- arbitrating requests for allocation;
- coordinating common resource equipment;
- selecting procedural elements to be executed;
- managing modes and states which includes propagating modes and states.

The control functions that are needed to implement coordination control are discussed in more detail in Section 6 under the topic of control activities.

5.2 Procedural elements

Procedural control for process oriented tasks is made up of procedural elements that are combined in a hierarchical manner to accomplish the task of a complete process as defined by the process model. The hierarchy of identified and named procedural elements is illustrated in Figure 7 and consists of a process cell procedure, unit procedures, operations, and phases.

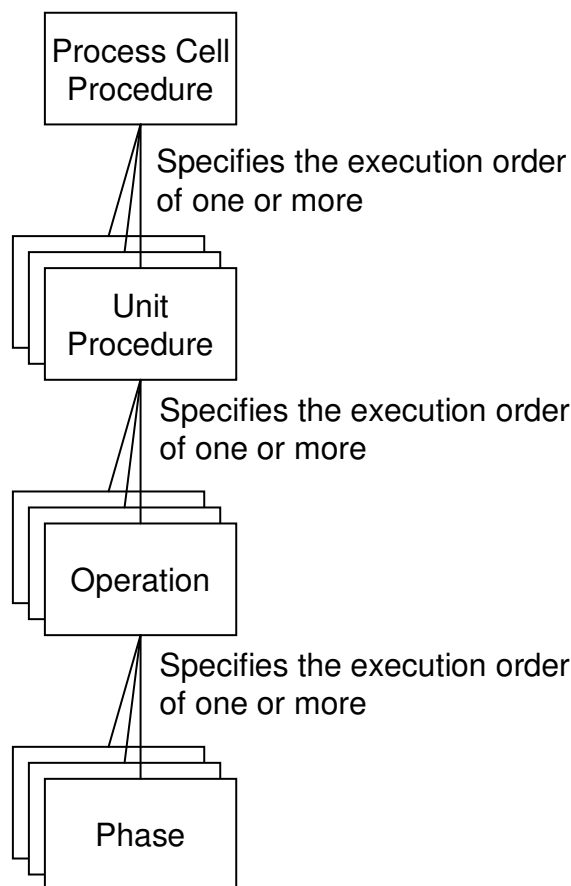


Figure 7 — Procedural control model

5.2.1 Process Cell Procedure

The process cell procedure is the highest level in the hierarchy and defines the strategy for carrying out a major processing action such as making a batch. It is defined in terms of an ordered set of unit procedures. An example of a process cell procedure is "Make PVC."

5.2.2 Unit procedure

A unit procedure consists of an ordered set of operations that cause a contiguous production sequence to take place within a unit. Only one unit procedure may be active in a unit at any time. An unit procedure is carried to completion in a single unit. However, multiple unit procedures of one process cell procedure may run concurrently, each in different units. Examples of unit procedures include the following:

- Polymerize VCM.

- Recover residual VCM.
- Dry PVC.

5.2.3 Operation

An operation is an ordered set of phases that defines a major processing sequence that takes the material being processed from one state to another, usually involving a chemical or physical change.

Operation boundaries should be located at points in the procedure where normal processing can safely be suspended. Only one operation should be active in a unit at any time. An operation is carried to completion in a single unit. However, operations of one process cell procedure may run concurrently, each in different units.

Examples of operations include the following:

- Preparation: Pull a vacuum on the reactor and coat the walls with antifoulant.
- Charge: Add demineralized water and surfactants.
- React: Add VCM and catalyst, heat, and wait for the reactor pressure to drop.

5.2.4 Phase

A phase is the smallest element of procedural control that can accomplish a process-oriented task.

A phase can be used to issue one or more commands or cause one or more actions, such as

- Enabling and disabling regulating and state-oriented types of basic control and specifying their set points and initial output values
- Setting, clearing, and changing alarm and other limits
- Setting and changing controller constants, controller modes, and types of algorithms
- Reading process variables, such as the gas density, gas temperature, and volumetric flow rate from a flowmeter, and calculating the mass flow rate through the flowmeter
- Conducting operator authorization checks.

The execution of a phase may result in

- commands to basic control;
- commands to other phases (either in the same or another equipment entity); and/or
- the collection of data.

The intent of the phase is to cause or define a process oriented action, while the set of steps that make up a phase are equipment specific. Examples of phases include the following:

- Add VCM.
- Add catalyst.
- Ramp and Soak.

5.2.5 Collapsing and Expanding the Procedural Control Model

The procedural control model shown in Figure 7 may be collapsed or expanded to suit different automation requirements. This section describes the principles of collapsing and expanding this model. In an implementation, the procedural control model may be collapsed by omitting one or more of the four procedural element levels defined in this standard.

- When a procedural element level is taken out, the next higher level must take over its functions and contain ordering logic controlling the next lower level and any other information that would have been stated in the collapsed level, including equipment requirements and other information.
- The lowest level of the equipment procedural control must have the functionality to command equipment through basic control.

The procedural control model may be expanded by adding new levels of procedural elements. The addition of new levels shall be restricted to insertion between the following levels:

- Between process cell procedure and unit procedure
- Between unit procedure and operation
- Between operation and phase.

New levels shall not be added above the process cell procedure or below the phase procedural elements.

New levels shall not use the same name as procedural elements defined in Figure 7.

When new levels are introduced they shall conform to the procedural element structures defined in section 5.2.6. and be associated with either a recipe or equipment.

The order of procedural elements defined in Figure 7 shall not be rearranged.

5.2.6 Procedural Element Structure

Procedural elements contain the following components:

- States,
- Modes,
- Attributes,
- Strategy

Coordination control is used to direct the internal operation of the various components of procedural elements. Human and machine interfaces may be provided to communicate a procedural element's overall and internal conditions and to provide a means to externally direct the procedural element.

Procedural element states indicate the status of a procedural element and are driven by a state model that defines the states, state transitions and commands associated with the procedural element.

Procedural element modes provide rules for execution of the state model. The modes, their meanings and how they impact execution of the state model must be stated for each procedural element.

Procedural element attributes are data about the procedural element. The minimum set of attributes for a procedural element is in [Table 1](#)[Table 2](#).

Table 1 – Minimum procedural element attributes

NAME	DESCRIPTION
ID	Provides unique identification.
Version	Identifies the version of the procedural element.
Version Date	Identifies the date and time that this version was created or modified.
Approval Date	Identifies the date and time that this version was approved.
Expiry Date	Identifies the date and time that this version expires and should no longer be used.
Author	Identifies the person or system that authored this version. (e.g., J. Smith).
Approved By	Identifies the person or system that approved this version.
Description	Describes the function that is achieved through execution of the procedural element.
Level	Indicates the level of the procedural element. For example process cell procedure, unit procedure, operation or phase.
Mode	Indicates the current mode of the procedural element.
State	Indicates the current state of the procedural element.

The procedural element strategy specifies the desired operational behavior of a procedural element when the element is executed. The procedural element strategy may be complex or simple in nature. It may contain one of three items:

- (1) Instructions on how lower level procedural elements are to be executed, or
- (2) A single reference to another procedural element, or
- (3) Commands and/or instructions for basic control.

When the procedural element strategy contains instructions on how lower level procedural elements are to be executed the procedural element strategy may contain one or more subsets of procedural element strategies, each with their own state models, modes, attributes and procedural element strategy. Coordination control is used to implement constraints between multiple procedural elements. This type of procedural element strategy content is engineered and may monitor any process or system value required by automation requirements, but must operate within the constraints of the state model and mode definitions

Editor's Note: this needs work.

When the procedural element strategy references another procedural element this is a simple reference and is covered in the next section.

When the procedural element strategy commands or instructs basic control, it points to equipment control functions, this is covered in a later section.

Each procedural element has one procedural element strategy. The procedural element strategy may be modular and contain conditional strategy definitions based upon states, modes or process conditions. For example there may be a main strategy used for normal operation and a different strategy used when the procedural element is aborting or holding.

5.2.7 Recipe Procedural Elements and Equipment Procedural Elements

Each of the four procedural elements defined in the procedural control model may be part of a recipe or of equipment. When part of a recipe they are called recipe procedural elements (RPE), when part of equipment they are called equipment procedural elements (EPE).

Recipe procedural elements are typically defined by the recipe author and may differ significantly from recipe to recipe. Equipment procedural elements are typically configured as an engineering design activity and are part of the equipment. Equipment procedural elements do not change from recipe to recipe and usually require an engineering activity to modify, add or delete them.

Table 2 defines the nomenclature for RPEs and EPEs at each level of the procedural model hierarchy.

Table 2 – Recipe and equipment procedural element levels

Types of Procedural Elements	When used in recipes	When used in equipment
Process cell procedure	Recipe Process cell procedure	Equipment Process cell procedure
Unit Procedure	Recipe Unit Procedure	Equipment Unit Procedure
Operation	Recipe Operation	Equipment Operation
Phase	Recipe Phase	Equipment Phase

The structure and properties of recipe procedural elements and equipment procedural elements are the same, but they have different constraints. Table 3 defines the allowable contents of a procedural element strategy for each type of the procedural elements derived from the procedural model.

Table 3 – Recipe and equipment procedural element strategy contents

Type of Procedural Element	Procedural element strategy options
----------------------------	-------------------------------------

	Strategy defines lower level PE orchestration	Strategy can reference another PE	Strategy can reference a Process Task Strategy EDITORS NOTE: “Process Task Strategy” is to be removed from the draft and a comment is expected to delete/change this table.
Recipe Process cell procedure	Yes	Equipment Process cell procedure	No
Recipe Unit Procedure	Yes	Equipment Unit Procedure	No
Recipe Operation	Yes	Equipment Operation	No
Recipe Phase	No	Equipment Phase	No
Equipment Process cell procedure	Yes	No	No
Equipment Unit Procedure	Yes	No	No
Equipment Operation	Yes	No	No
Equipment Phase	No	No	Yes

The table above defines the capabilities of the defined procedural elements. A given instance of one of these procedural elements shall only have one type of strategy.

- A recipe procedural element may define subordinate recipe procedural elements to be executed. Alternately, it may specify a single equipment procedural element to be executed that is on the same hierarchical level as the recipe procedural element.
- An equipment procedural element may define subordinate equipment procedural elements to be executed. Alternately it may specify a single procedure to be executed. Such a procedure may be in any form appropriate for the implementation method, such as directions for manual activities, computer code, standard operating procedures, etc. It may be defined as part of the equipment procedural element or by reference.
- Because the phase procedural element is the lowest level in the hierarchy, if the recipe phase exists, its definition cannot specify subordinate procedural elements and must specify an

equipment phase. Likewise the definition of the equipment phase, if it exists, can only specify a procedure to be executed.

5.3 Equipment entities

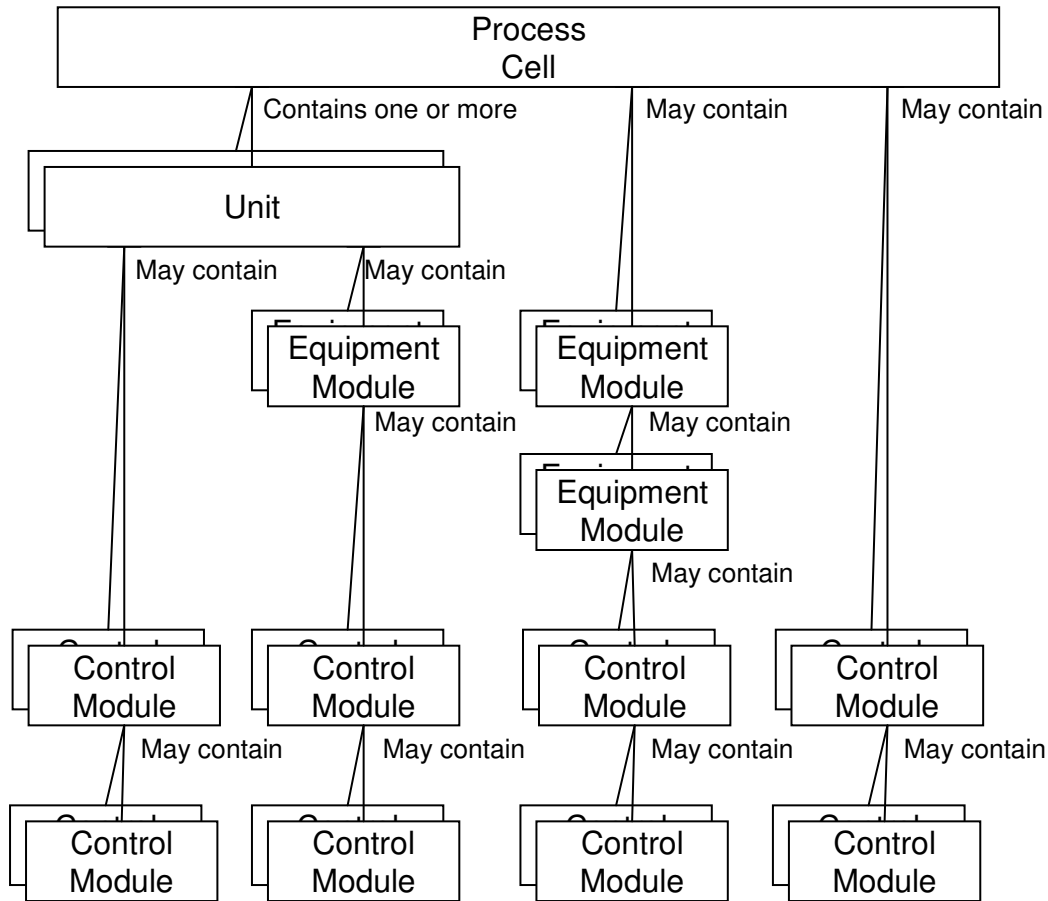


Figure 8 – Equipment Entities

Editor's Note - Working Group Note: Need to add text that state that although the model provides for units without equipment and/or control modules, it is understood that when a unit does execute actions which manipulate physical equipment, then it does so via control module(s).

This section discusses equipment entities that are formed from the combination of equipment control and physical equipment. This combination results in four equipment entities: process

cells, units, equipment modules, and control modules. Guidelines for structuring these equipment entities are also discussed.

When the terms process cell, unit, equipment module, and control module are used, they generally refer to the equipment and its associated equipment control. Whether equipment control in an equipment entity is implemented manually or by way of automation, it is only through the exercise of equipment control that the equipment can produce a batch.

The notion of equipment control being part of an equipment entity is to be understood logically. It is not a statement of the physical implementation of equipment control. However, it must be possible to identify equipment control for a particular equipment entity.

This interaction of equipment control and physical equipment is described purposely without any reference to language or implementation. The intent is to describe a framework within which equipment control and physical equipment may be defined and discussed.

5.3.1 Procedural control model/physical model/process model relationship

The general relationship between the procedural control model, the physical model, and the process model is illustrated in Figure 9. This mapping of procedural control with individual equipment provides processing functionality described in the process model.

The concept of equipment capabilities and usage of these capabilities to accomplish processing tasks is a major point of this standard. The procedural control capability of equipment entities is the mechanism that enables this. The procedural control may be entirely defined as part of equipment control, or it may be based on procedural information passed on to the equipment entity from the recipe.

5.3.2 Equipment control in equipment entities

The control capability possible in the different equipment entities are important characteristics and a main basis for classification of equipment entities. In the following paragraphs equipment control for the individual equipment entities is discussed.

5.3.2.1 Process cell

The process cell is capable of orchestrating all processing activities for one or more batches. It receives recipes containing procedure, parameter, and other information and a schedule containing operational requirements for each batch. It may also need to prepare and monitor equipment or resources not currently involved in batch processing, such as which units are available, what units and piping are going through a clean-in-place (CIP) routine, and what the current inventories of raw materials are.

The complexity of control within the process cell will depend on the equipment available within the process cell, the interconnectivity among this equipment, the degree of freedom of movements of batches through this equipment, and the arbitration of the use of this equipment so that the equipment can be used most effectively.

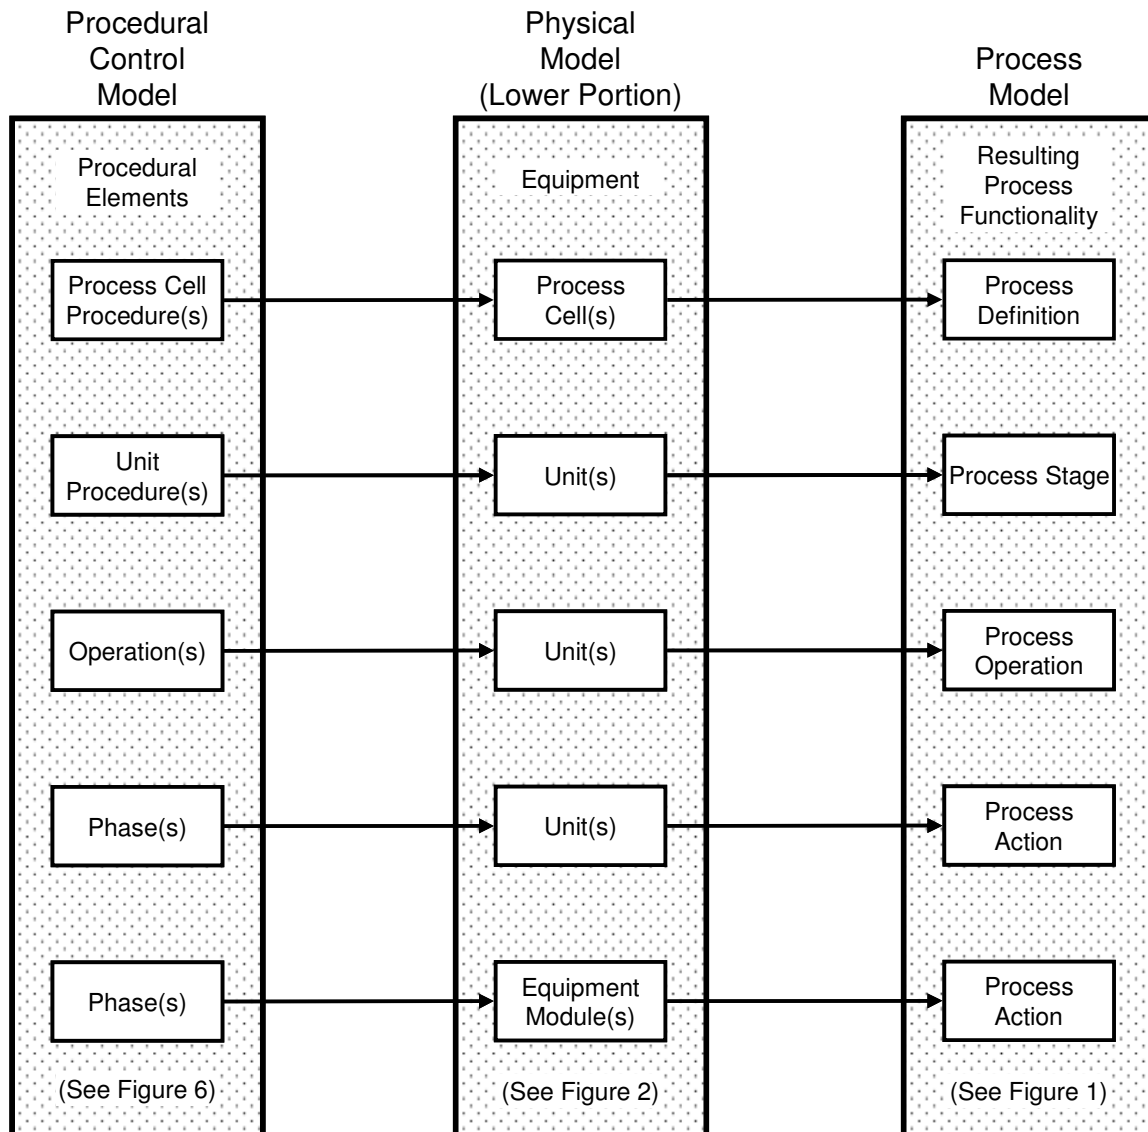


Figure 9 — Procedural control/equipment mapping to achieve process functionality

Equipment control in the process cell may be distributed in the same manner as the physical equipment is subdivided. For example, if the process cell is subdivided into trains, equipment control within the process cell may be distributed among the various trains.

Equipment modules and control modules may exist as separate entities under direct control of the process cell.

5.3.2.1.1 Basic control in process cells

The process cell may include control modules to support basic control that spans several units. For example, an interlock that shuts one unit down may need to be propagated to the upstream units that are feeding this particular unit.

5.3.2.1.2 Procedural control in process cells

The execution of a process cell procedure and initiation of the individual unit procedures is a process cell responsibility. The execution may or may not be integral to the coordination control involved with the movement of batches as described in 5.2.2.1.3.

5.3.2.1.3 Coordination control in process cells

More coordination control is needed in process cells than in the lower level equipment entities because

- the process cell may contain multiple units and process multiple batches at the same time. This involves coordinating the execution of a number of different process cell procedures;
- the control of the movement of batches may involve a number of choices between alternate paths. Although these choices may be made via links between units, the process cell may also have to determine the routing;
- arbitration may be needed at the process cell level to optimize the use of resources, such as shared resources and resources that must be reserved well in advance of the time actually needed.

Examples of coordination control in a process cell include algorithms that

- manage the initialization and movement of the batches being processed within the process cell; and
- initiate and/or associate unit procedures, parameters and other information in individual units in the proper order to cause them to process the product described by the unique combination of schedules and recipes.

5.3.2.2 Unit

Units coordinate the functions of the lower level entities, such as equipment modules and control modules. The primary purpose of equipment control in a unit is to control the processing of the batch that is currently associated with the unit.

5.3.2.2.1 Basic control in units

Basic control in a unit is performed by regulatory control and discrete control in control modules within the unit or in some way referenced by the unit.

5.3.2.2.2 Procedural control in units

Units may include and execute equipment phases, equipment operations, and equipment unit procedures or they may execute recipe operations and recipe unit procedures passed on to it.

5.3.2.2.3 Coordination control in units

Equipment control in a unit will include a substantially higher level of coordination control than any of the lower level equipment entities. This may include, for example, algorithms that manage unit and acquired resources; arbitrate requests for services from other units or from the

process cell; acquire the services of resources from outside the unit; and communicate with other equipment entities outside unit boundaries.

5.3.2.3 Equipment module

The primary purpose of equipment control in an equipment module is to coordinate the functions of other equipment modules and lower level control modules. An equipment module may be commanded by a process cell, a unit, an operator, or, in some cases, another equipment module.

5.3.2.3.1 Basic control in equipment modules

Basic control in an equipment module is performed by regulatory control and discrete control in control modules within the equipment module or in some way referenced by the equipment module.

5.3.2.3.2 Procedural control in equipment modules

Equipment modules may execute equipment procedural elements at the phase level, but they do not have the capability of executing higher level procedural elements such as equipment operations.

The procedural elements may or may not be associated with a recipe phase, i.e. an equipment module may execute procedural control that is not defined in a recipe. An equipment module executing a sequence of actions on the control modules it contains, which is independent of a direct recipe procedure relationship, is an example of a procedural element that may not be associated with a recipe phase.

An equipment module does not have to contain procedural elements, i.e. an equipment module may be a collection of control modules without any additional procedural control definition.

5.3.2.3.3 Coordination control in equipment modules

Coordination control in an equipment module includes coordination of its component parts and may include algorithms for propagating modes and for arbitrating requests from units.

5.3.2.4 Control module

Equipment control normally found at this level directly manipulates actuators and other control modules. A control module can direct commands to actuators if they have been configured as part of the control module. A control module can also direct commands to other control modules if they are contained or in some way referenced by that control module. Control of the process is affected through the equipment specific manipulation of control modules and actuators.

Examples of equipment control in control modules include

- opening or closing a valve, with confirmation failure alarms;
- regulating the position of a control valve based on a sensor reading and PID control algorithm;
- setting and maintaining the state of several valves in a material header. This could be a single control module configured to contain all of the valves directly or a compound

control module configured to contain several control modules, each of which is configured to directly contain a single valve.

NOTE: When a control module contains another control module, it is often referred to as a compound control module. The term compound control module is not considered an additional level in the physical hierarchy.

5.3.2.4.1 Basic control in control modules

Control modules contain basic control. Equipment modules, units, and process cells may also be capable of performing basic control only because they contain or make use of subordinate control modules. Although this control is normally either regulatory or state oriented, in some cases it is both. It may also include conditional logic. For example, open the valve if the temperature is within limits and the downstream valve is open.

Regulatory control is dedicated to maintaining a process variable or variables at or near some desired value. Complex control strategies such as multivariable control, model-based control, and artificial intelligence techniques may also fit into this category of regulatory control.

State-oriented control refers to setting the state of a piece of equipment as opposed to the state of a process variable or variables. A state-oriented device has a finite number of states. It defines a product independent processing sequence.

Control modules may contain exception handling.

5.3.2.4.2 Procedural control in control modules

Control modules do not perform procedural control.

5.3.2.4.3 Coordination control in control modules

Coordination control in a control module may include, for example, algorithms for propagating modes and for arbitrating requests from units or other modules for usage.

5.3.3 Structuring of equipment entities

This section discusses the general principles involved in segmenting a process cell into equipment entities that can carry out specified processing activities or equipment-specific actions. Total explanation of process segmentation principles is beyond the scope of this standard.

It is important to note that the physical process cell design can greatly influence the implementation of batch control. Minor differences in the physical system can dramatically affect the organization of equipment entities and procedural elements.

All control related sections of the standard assume that the process cell in question (both physical equipment and related control activities) has been subdivided into well defined equipment entities such as units, equipment modules, and control modules. Effective subdivision of the process cell into well defined equipment entities is a complex activity, highly dependent on the individual requirements of the specific environment in which the batch process exists. Inconsistent or inappropriate equipment subdivisions can compromise the effectiveness of the modular approach to recipes suggested by this standard.

Subdivision of the process cell requires a clear understanding of the purpose of the process cell's equipment. Such understanding allows the identification of equipment entities that must work together to serve an identifiable processing purpose.

5.3.3.1 Structuring of process cells

The subdivision of a process cell usually follows the principles listed below :

- The function any equipment entity serves in product processing must be clear and unambiguous.
- The function performed by the equipment entity must be consistent in terms of processing task, and should be usable for that task no matter what product is being manufactured at a given time.
- Subordinate equipment entities should be able to execute their task(s) independently and asynchronously, allowing the highest level equipment entity to orchestrate the activities of its subordinates.
- Interactions between equipment entities should be minimized. While planned interaction is periodically necessary, each equipment entity should perform its functions while influencing the functioning of other equipment entities as little as possible.
- Equipment entities must have clear boundaries.
- A consistent basis is required for the definition of equipment entities. An operator subsequently interacting with similar equipment entities should be able to do so naturally and without confusion.
- Necessary interaction between equipment entities is, insofar as possible, coordinated by equipment entities at the same level or at the next higher level.

5.3.3.2 Structuring of batch units

The definition of a batch unit requires knowledge of the major processing activities, as well as the equipment capabilities. The following guidelines apply:

- One or more major processing activities, such as reaction or crystallization, may take place in a unit.
- Batch units should be defined such that they operate independently of each other.
- Batch units operate on only one batch at a time.

5.3.3.3 Structuring of equipment modules

The definition of an equipment module requires knowledge of specific minor processing activities and equipment capabilities. Equipment modules can carry out a finite number of minor processing activities, such as dosing and weighing, and are typically centered around a set of process equipment. Collections of control modules can be defined as equipment modules or as control modules. If the collection executes one or more equipment phases, then it is an equipment module.

5.4 Recipes

This section defines recipe contents and four types of recipes. Recipes contain five categories of information:

- Header
- Formula
- Equipment requirements
- Procedure
- Other information.

There are four types of recipes:

- General recipe
- Site recipe
- Master recipe
- Control recipe.

Each type of recipe contains the same five categories of information, however the information changes for the different recipe types.

Recipes often need to be frequently added, deleted, or modified to support business needs and are often managed by different individuals or organization than those whom manage the equipment the recipes are executed on. Recipes are generally managed by individuals who understand the processing required to produce products. They generally do not understand the details of configuring the equipment and building libraries of procedural elements which are the toolsets they use to build and maintain recipes. The configuration of equipment and building of libraries of procedural elements is generally the responsibility of process and automation engineers.

NOTE – In this standard, recipes are described as formal sequences dedicated towards creating products. In some cases, the recipe may be as simple as a manually initiated process action and need not be directed to creating product. Such a recipe might be the initiation of a cleanout procedure or sterilization of equipment.

5.4.1 Recipe contents

While each type of recipe may contain each of the five categories of information the rules for content will differ by type. This section defines the common rules that apply to all recipe types. The differences in the content rules for each type are detailed in section 5.4.2 Recipe Types.

5.4.1.1 Header

The administrative information in the recipe is referred to as the header. Typical header information shall include

- Recipe identification
- Product identification
- Version identification

- Change management information consisting of
 - Originator
 - Creation date
 - Identification of persons who modified the recipe, the date of the modification and information about the modifications
- Approval information consisting of
 - Identification of persons with their authority providing approval and the date approval was provided,
 - Expiry date
- Recipe status
 - Status values are user defined, examples are under development, approved for test, approved for production, out of service,
- Other administrative information
 - For example, a site recipe may contain the name and version of the general recipe from which it was created.

5.4.1.2 Formula

The formula is a category of recipe information that includes process inputs, process parameters, and process outputs.

A process input is the identification and quantity of a raw material or other resource required to make the product. In addition to raw materials which are consumed in the batch process in the manufacture of a product, process inputs may also include energy and other resources such as manpower. Process inputs consist of both the name of the resource and the amount required to make a specific quantity of finished product. Quantities may be specified as absolute values or as equations based upon other formula parameters or the batch or equipment size. Process inputs may specify allowable substitutions, expressed in the same basic form.

A process parameter details information such as temperature, pressure, or time that is pertinent to the product but does not fall into the classification of input or output. Process parameters may be used as set points, comparison values, or in conditional logic.

A process output is the identification and quantity of a material and/or energy expected to result from one execution of the recipe. This data may detail environmental impact and may also contain other information such as specification of the intended outputs in terms of quantity, labeling, and yield.

The types of formula data are distinguished to provide information to different parts of an enterprise and need to be available without the clutter of processing details. For example, the list of process inputs may be presented as a condensed list of ingredients for the recipe or as a set of individual ingredients for each appropriate procedural element in a recipe.

5.4.1.3 Equipment requirements

Equipment requirements constrain the choice of the equipment that will eventually be used to implement a specific part of the procedure.

At the control recipe level, the equipment requirements are the same as, or a subset of, the allowable equipment in the master recipe. The control recipe may be used to include specific allocations of process cell equipment, such as Reactor R-501, when this becomes known.

5.4.1.4 Procedure

The recipe process cell procedure defines the strategy for carrying out a process. The recipe process cell procedure may consist of a hierarchy of recipe procedural elements or reference an associated equipment procedural element.

The recipe creator is limited to the use of procedural elements that have been, or will be, configured and made available for use in creating a process cell procedure. These sets of procedural elements are called libraries and procedural elements in them are called the building blocks of a recipe process cell procedure. Recipe authors use the building blocks to define a process cell procedure.

Determination of which of these procedural elements may be part of the process cell procedure is an application specific design decision based on many factors including the capabilities of the controls and the degrees of freedom appropriate for the recipe creator in a given application.

5.4.1.5 Other information

Other information is a category of recipe information that may contain batch processing support information not contained in other parts of the recipe. Examples include regulatory compliance information, materials and process safety information, process flow diagrams, and packaging/labeling information.

5.4.2 Recipe types

This section discusses four types of recipes typically found in an enterprise. A recipe is an entity that contains the minimum set of information that uniquely defines the manufacturing requirements for a specific product. Recipes provide a way to describe products and how those products are produced. Depending on the specific requirements of an enterprise, other recipe types may exist. However, this standard discusses only the general recipe, site recipe, master recipe, and control recipe (see Figure 10).

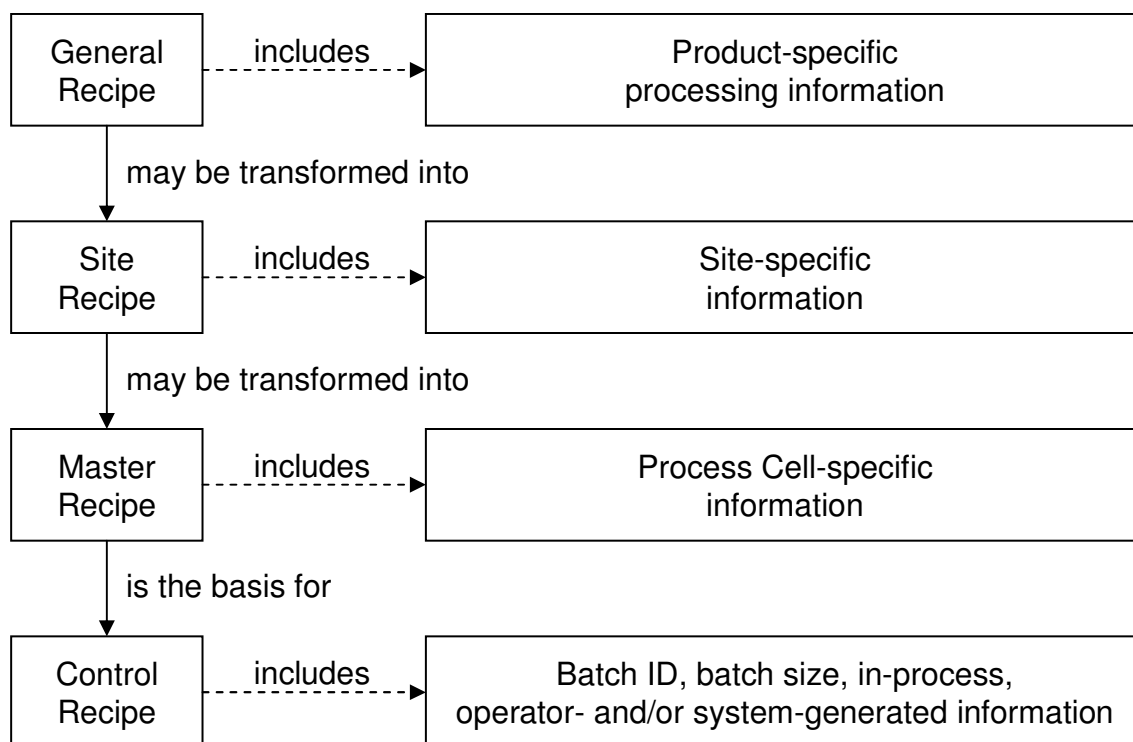


Figure 10 — Recipe types

Fundamental to the practical application of recipes is the concept that different parts of an enterprise may need information about the manufacture of a product in varying degrees of specificity, because different recipients of the information use it for different purposes. Therefore, more than one type of a recipe is needed in an enterprise.

It should be noted that whether a particular recipe type actually exists, who generates it, and where it is generated will vary from case to case and from enterprise to enterprise. For example, an enterprise may choose not to implement one or more of the recipe types. The recipe types model presented in this standard is complete as indicated, but may be collapsed and expanded. However, the master recipe and the control recipe may not be omitted from the recipe types model.

A product may be made in many different arrangements of equipment at many different sites. Recipes that are appropriate for one site or set of equipment may not be appropriate for another site or set of equipment. This can result in multiple recipes for a single product. There should be sufficient structure in the definition of recipes to allow tracing of the genealogy of any given recipe.

The recipe contains neither scheduling nor equipment control. The recipe contains process-related information for a specific product. This permits batch processing equipment to make many different products without having to redefine equipment control for each product.

There is a substantial difference between general/site recipes and master/control recipes. The general and site recipes describe the technique, that is, how to do it in principle. Master and control recipes describe the task, that is, how to do it with actual resources.

5.4.2.1 General recipe

The general recipe is an enterprise level recipe that serves as the basis for lower-level recipes. The general recipe is created without specific knowledge of the process cell equipment that will be used to manufacture the product. It identifies raw materials, their relative quantities, and required processing, but without specific regard to a particular site or the equipment available at that site. It is created by people with knowledge of both the chemistry and processing requirements peculiar to the product in question, and reflects their interests and concerns.

While the general recipe is not specific to equipment or to a particular site, the technology for manufacturing a product will usually have evolved sufficiently beyond the laboratory so that equipment requirements can be described in enough detail to define the type of equipment needed at a particular site or in a particular set of batch plant equipment. The general recipe provides a means for communicating processing requirements to multiple manufacturing locations.

Quantities may be expressed as fixed or normalized values; equipment requirements are expressed in terms of the attributes needed by the equipment, such as pressure requirements and materials of construction.

The general recipe may be used as a basis for enterprise-wide planning and investment decisions. It may be part of, or referenced by production specifications and, as such, used for production planning and for information to customers and authorities.

In general recipes, the equipment requirements are typically described in equipment independent terms that apply to all sites in the enterprise which have the ability to run the recipe. Equipment independent requirements may be items such as allowable materials and required processing characteristics. It is the guidance from and constraints imposed by equipment requirements that will allow the general recipe to eventually be used to create a master recipe which targets appropriate equipment.

General recipe procedures are structured using the levels described in the process model since these levels allow the process to be described in non-equipment specific terms.

The procedure information in the general recipe is expressed in three levels of breakdown: Process Stages, Process Operations, and Process Actions as shown in Figure 11. The functionality of these levels corresponds to the functionality of the analogous levels in the Process Model as shown in Figure 1.

The process stage, process operation, and process action are not constrained by unit boundaries in any real plant. They describe processing activities that others may choose to execute in one or in many different units as the general and site recipe is transformed to run in one or more real plants.

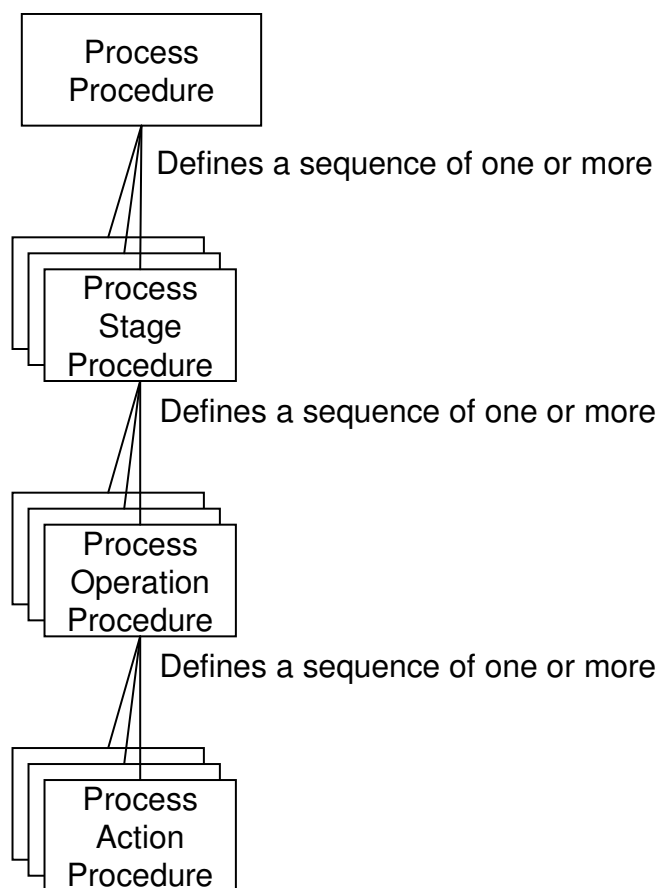


Figure 11 — General/Site recipe procedure levels

5.4.2.2 Site recipe

The site recipe is specific to a particular site. It is the combination of site-specific information and a general recipe. It is usually derived from a general recipe to meet the conditions found at a particular manufacturing location and provides the level of detail necessary for site-level, long-term production scheduling. However, it may also be created directly without the existence of a general recipe. Such things as the language in which it is written or local raw material differences are accommodated as site-specific variances. It is still not specific to a particular set of process cell equipment. Typically, the site recipe is the output of a local "site focused" process development function.

There may be multiple site recipes derived from a general recipe, each covering a part of the general recipe that may be implemented at a specific site.

In site recipes, the equipment requirements are typically described in equipment independent terms that are specific to a site, such as allowable materials and required processing characteristics. It is the guidance from and constraints imposed by equipment requirements that will allow the site recipe to be used to create a master recipe which targets appropriate equipment.

As with general recipes, site recipe procedures are structured using the levels described in the process model since these levels allow the process to be described in non-equipment specific terms.

The procedure information in a site recipe consists of process stages, process operations, and process actions that relate directly to those defined by the general recipe. In general, there is a 1:1 correspondence between the process stages in a general recipe and the process stages in a site recipe, between the process operations in a general recipe and the process operations in a site recipe, and between the process actions in a general recipe and the process actions in a site recipe. As with the other site recipe information, the process stages, process operations, and process actions may be modified to make the recipe site-specific.

5.4.2.3 Master recipe

The master recipe is that level of recipe that is targeted to a process cell or a subset of the process cell equipment. A master recipe can be derived from a general recipe or a site recipe. It can also be created as a stand-alone entity if the recipe creator has the necessary process and product knowledge.

Some characteristics of master recipes include the following:

- There may be multiple master recipes derived from a site recipe, each covering a part of the site recipe that may be implemented in a process cell.
- The master recipe has to be sufficiently adapted to the properties of the process cell equipment to ensure the correct processing of the batch. This is done by combining the functionality of the specific set of process cell equipment with the information from the master recipe.
- In a master recipe, the formula data may be specified as normalized values, calculated values, or fixed values.
- The master recipe may contain product-specific information required for detailed scheduling, such as process input information or equipment requirements.
- The master recipe level is a required recipe level, because without it no control recipes can be created and, therefore, no batches can be produced.
- Whether the batch manufacturing equipment is operated manually or fully automatically, the master recipe exists either as an identifiable set of written instructions or as an electronic entity.

At the master recipe level, the equipment requirements may be expressed in any manner that specifies allowable equipment in process cells. If trains have been defined, then it is possible for the master recipe (and the resulting control recipe) to be based on the equipment of the train rather than the full range of equipment in the process cell.

The recipe process cell procedure portion of the master recipe may contain recipe unit procedures, recipe operations, and recipe phases as shown in Figure 12.

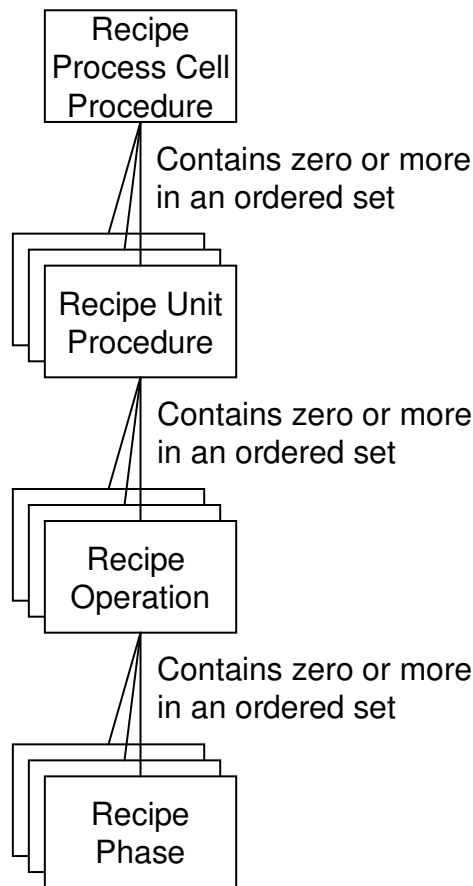


Figure 12 — Master recipe procedure levels

The creation of a procedure in a master recipe from a procedure in a site recipe may be quite complex. The master recipe must contain sufficiently detailed equipment requirements information so that resources may be determined and allocated to create and initiate a control recipe. It is at this recipe level that the set of recipe phases necessary to carry out the intended process actions, process operations, and process stages can be determined.

There may be a 1:1, 1:n, or n:1 relationship between process actions in the general or site recipe and recipe phases in the master recipe, between process operations in the general or site recipe and recipe operations in the master recipe, and between process stages in the general or site recipe and recipe unit procedures in the master recipe as shown in Figure 13. The actual relationship may depend on the equipment being used.

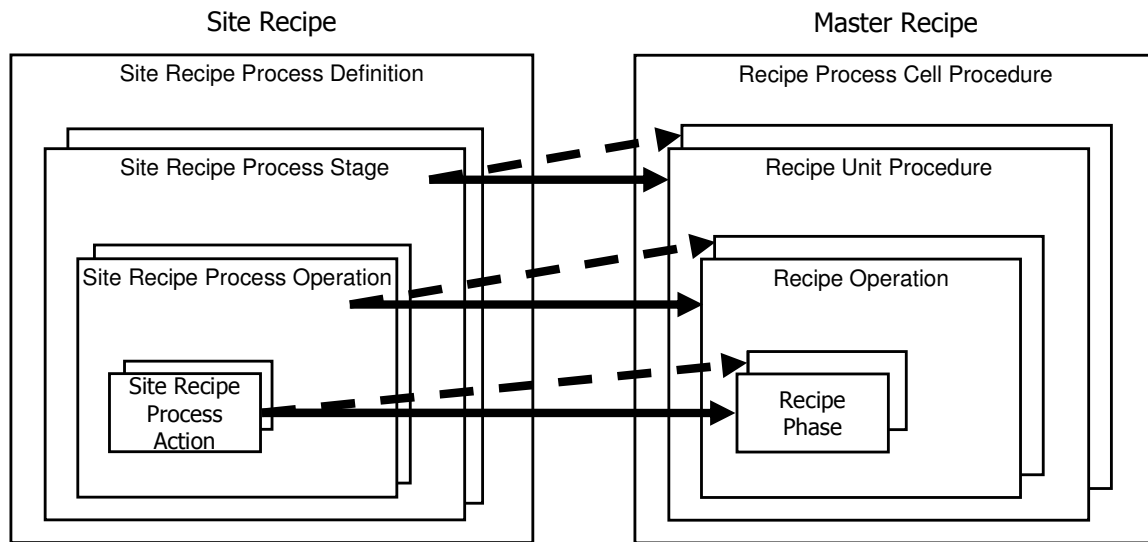


Figure 13 — Procedural element relationships in the site recipe and master recipe

Although there is a general similarity between the processing intent of process actions and the processing function defined by recipe phases, there is not necessarily a one-to-one correspondence between the two. One process action may correspond to several recipe phases, and several process actions may correspond to a single recipe phase.

There is a similar relationship between process operations and operations. There are significant differences also. Operations are carried to completion in a single unit in the target equipment while process operations are not constrained to units in any specific facility. A single process operation might require one or more operations to carry out the processing intent described.

There is a similar relationship between process stages and unit procedures as there is between process operations and operations. Unit procedures are also carried to completion in a single unit in the target equipment while process stages are not constrained by equipment boundaries in any specific facility. A single process stage might require one or more unit procedures to carry out the processing intent described.

5.4.2.4 Control recipe

The control recipe starts as a copy of a specific version of a master recipe and is then modified as necessary with scheduling and operational information to be specific to a single batch. It contains product-specific process information necessary to manufacture a particular batch of product. It provides the level of detail necessary to initiate and monitor equipment procedural entities in a process cell. It may have been modified to account for actual raw material qualities and actual equipment to be utilized. The selection of units and appropriate sizing can be done any time before that information is needed.

Since modifications of a control recipe can be made over a period of time based on scheduling, equipment, and operator information, a control recipe may go through several modifications during the batch processing. Examples include

- defining the equipment that will actually be used for the control recipe at the initiation of the batch or when it becomes known;

- adding or adjusting parameters based on an "as-charged" raw material quality or mid-batch analysis;
- changing the procedure based on some unexpected event.

The process cell procedure of a control recipe consists of recipe unit procedures, recipe operations and recipe phases that relate directly to those defined by the master recipe. At the control recipe creation time, there is a 1:1 correspondence between recipe unit procedures in the master recipe and recipe unit procedures in the control recipe, between recipe operations in the master recipe and recipe operations in the control recipe, and between recipe phases in the master recipe and recipe phases in the control recipe. Changes in the control recipe process cell procedure during the execution may cause it to differ from the master recipe process cell procedure. In a control recipe, as in a master recipe, the process cell procedure is divided along unit procedure boundaries to provide the process cell with the processing requirements of the recipe on a unit-by-unit basis.

5.4.3 Recipe entity

A recipe entity is the combination of a recipe procedural element with associated recipe information (e.g. header, formula, equipment requirements, and other information). General, site, master, and control recipes are recipe entities.

Figure 14 illustrates how a master recipe consists of a set of encapsulated recipe entities and how each recipe entity may contain the five types of recipe contents.

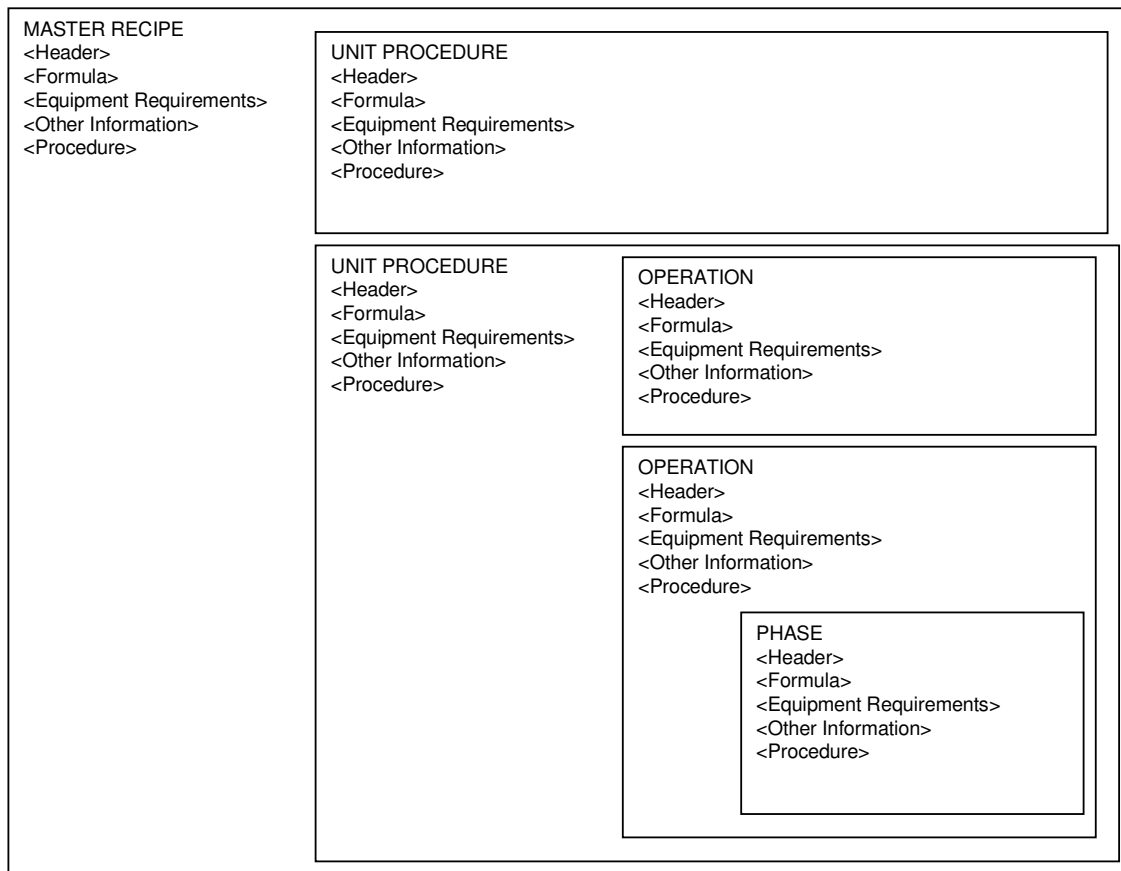


Figure 14- Recipe entity encapsulation

5.4.4 Recipe transportability

Recipe transportability ensures that recipe information movement is possible between batch control implementations at the same recipe level. The recipe information must be understood by each implementation.

The general recipe is transportable from where it was created to any site. The site recipe is transportable, but not to the same extent as the general recipe. It is intended to be used within a specific site and is transportable within that site.

The master recipe is transportable to another process cell, recognizing that the master recipe has been customized for a particular set of process cell equipment. When the master recipe is transported to another process cell, some process engineering analysis may be necessary to

- determine that the new set of process cell equipment is configured similarly so that the master recipe can be used unchanged or;
- make the necessary changes so that the modified master recipe will run on the target set of process cell equipment.

The control recipe is not transportable.

5.5 Connecting recipe entities and equipment entities

Procedural elements by themselves do not possess the ability to directly manipulate equipment. The manipulation of equipment is achieved by linking the lowest level procedural elements in control recipes to equipment procedural elements within equipment entities. This linkage is implementation dependent but is driven by references from a procedural element's strategy to either an equipment procedural element or to command basic control.

The lowest level procedural elements in master recipes must contain sufficient information so when transformed into a control recipe the linkage may be achieved. However, master recipe procedural elements are not actually executed, or run, only those in control recipes are. Since general and site recipes are equipment independent they do not contain linkages or references to specific equipment entities.

Figure 15 shows the flow of information from a general recipe to an actual equipment entity that is operated by a control recipe. This figure illustrates the abstract nature of the general, site and master recipes and their recipe procedural elements. The flow of information between recipe types is a transformation. From the control recipe to the equipment entity, and within the equipment entity there is a less abstract and more physical linkage that must be achieved in order for the physical equipment to be operated.

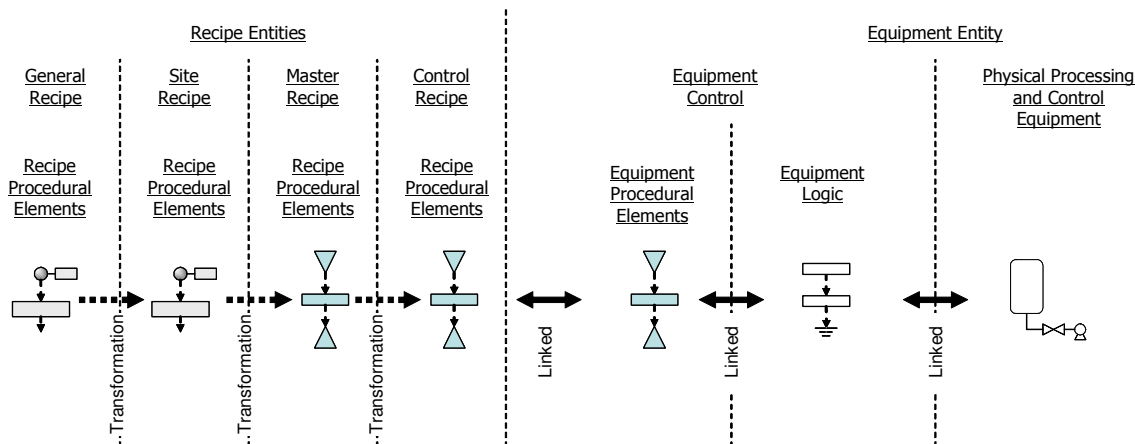


Figure 15 - Information Flow from General Recipe to Equipment Entity

The linked data flows indicate bi-directional information flow since these reflect operational information flows consisting of commands and direction sent from the control recipe toward the physical processing equipment and status and reporting information sent from the physical processing equipment towards the control recipe. The actual information sent in any of the information flows is dependent upon the application.

This section discusses the linked information flows. Specifically it addresses:

- the separation between recipe procedural elements in control recipes and equipment entities,
- how recipe procedural elements reference equipment procedural elements,
- how equipment procedural elements command basic control, and

- the rules for collapsing and expanding the procedural control model with regards to connecting recipe procedural elements, equipment procedural elements and equipment entities.

5.5.1 Connecting recipe procedural elements, equipment procedural elements and basic control

The logical separation of recipes and equipment provides the ability to separate product specific definitions, instructions and information (e.g. recipes) from processing capabilities (e.g. equipment entities).

This separation is of an abstract, logical, nature. In a given implementation there may or may not be a physical separation that matches this logical one. Two examples are:

- A control recipe, or parts of it, may be downloaded to an embedded computer that was supplied by the physical equipment manufacturer and also contains the equipment entity's control equipment.
- A control recipe may run in a dedicated computer that uses a network connection to communicate with the equipment entity and its equipment control.

In both cases the logical separation discussed below exists, although in the first case it may not be physically apparent.

Figure 16 shows the logical separation between control recipe procedural elements and an equipment entity using the complete procedural control model in the control recipe. Section 5.5.3 provides rules for connections when the procedural control model is collapsed or expanded in either the control recipe and or equipment entity.

In Figure 16 recipe phases contain references to equipment phases that are part of an equipment entity. This is a requirement of recipe phases since when recipe procedural elements reference an equipment procedural element they must reference an equipment procedural element of the same procedural element type.

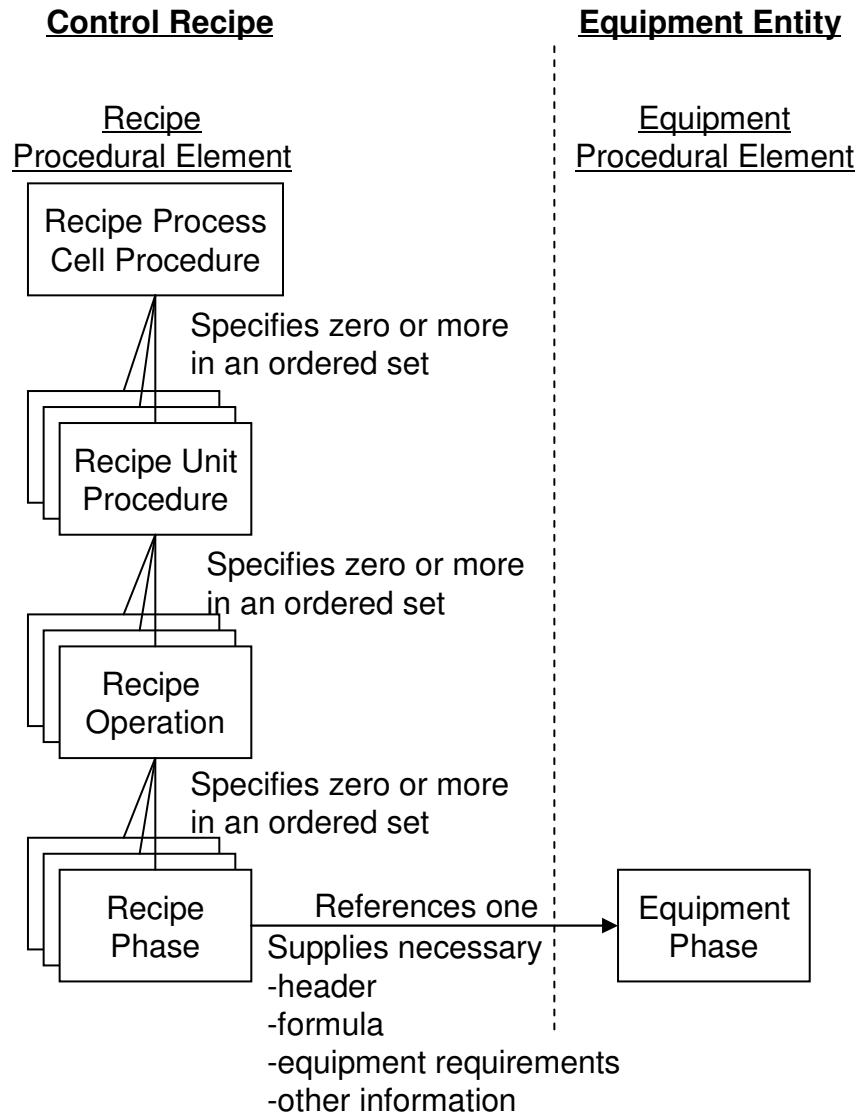


Figure 16 – Separation of the types of procedural elements and external procedural element task strategy

Since recipe phases and equipment phases are both procedural elements they each have a similar structure and contents are defined in section 5.2.6, that is states, modes, attributes and strategy. Recipe phases and equipment phases may both have human and machine interfaces for receiving inputs such as commands, modes and data as well as for displaying to humans and communicating to machines their status, mode and data.

Equipment phases must reference a source of external equipment control which commands basic control. There is a many to many relationship between equipment phases and basic control functions since one equipment phase may reference one or many sets of equipment control and the same module of equipment basic control may be referenced by one or many different equipment phases. Coordination control in equipment phases performs the coordinating

functions to select the correct equipment basic control module, pass the correct commands, modes and data to it and receive the corresponding status data back. Coordination control also is responsible for collating data received back from the process task strategy in order to determine an equipment phase's current state and mode as well as perform any exception handling or normal operation activities required by its application specific configuration.

Since each of the three items, recipe phases, equipment phases and basic control may act asynchronously within the application specific configuration the propagation of their current statuses must occur from the equipment basic control to equipment phase to recipe phase with the option to display and permit control at any of these points.

5.5.2 Using recipe procedural elements in master recipes

In order for recipe procedural elements in a control recipe to be linked with equipment entities the master recipe the control recipe originated from must be configured with sufficient information.

Recipe creators should be able to build master recipe process cell procedures using a building blocks which are recipe entities that exist in a library. The building blocks are reusable sets of recipe procedural elements that contain encapsulated procedural elements and/or reference equipment procedural elements. This allows recipe creators to create new and maintain existing master recipes without detailed knowledge of the linkages to equipment entities required for actual operation.

The building blocks should be developed and maintained by automation engineers that understand the references and linkages between individual recipe procedural elements and equipment entities. In order for a recipe procedural element to be able to reference an equipment procedural element, it must have an identification that enables the element to be correctly linked. In other cases, it must reference or include other recipe procedural elements and a specification of the execution order of those procedural elements.

The equipment procedural element to be linked typically has the following:

- An identification that can be referenced by the recipe procedural element or a higher level equipment procedural element
- A description of the functionality provided
- Variables that can receive the formula and other parameter information from the recipe
- Commands and/or instructions for basic control

It is possible for the recipe creator to work with a higher level procedural element for defining the procedure and still have the lower level procedural elements as part of the procedure. This could occur when the higher level procedural element has been pre-configured in terms of one or more lower level procedural elements. When the recipe creator invokes the use of a higher level procedural element, the lower level procedural elements are carried along, even though they may be invisible to the recipe creator and become part of the procedure.

When a procedural element is used more than once in a recipe, there may be a need to uniquely identify each occurrence of the procedural element to the operator and batch history.

5.5.3 Connecting recipe procedural elements, equipment procedural elements and equipment control when the control recipe uses a collapsed procedural control model

Section 5.5.1 described how control recipes are connected to equipment entities when the full procedural control model is used in the control recipe. When the full procedural control model is not used there are many more options for configuring the connection between a control recipe and equipment entities.

Figure 17 shows the range of options when collapsing a control recipe's procedural control model. As a minimum a control recipe must contain a process cell procedure, this cannot be collapsed. Otherwise the procedures in a control recipe might not include recipe unit procedures, recipe operations, and recipe phases. Such a recipe procedure must then be linked (by reference) to equipment procedural elements in an equipment entity. Whenever a procedural element, such as a recipe process cell procedure, recipe unit procedure procedure, recipe operation procedure, or recipe phase procedure, is linked to an equipment entity, it must be linked to an equipment procedural element of the same level (e.g. recipe process cell procedure to equipment process cell procedure, recipe unit procedure procedure to equipment unit procedure procedure, recipe operation procedure to equipment operation procedure or recipe phase procedure to equipment phase procedure).

When recipe unit procedure procedures, recipe operation procedures, and recipe phase procedures are not used as part of the control recipe process cell procedure, lower level equipment procedural elements should be used as part of equipment procedural control hierarchy to provide a modular structure above the commands to basic control.

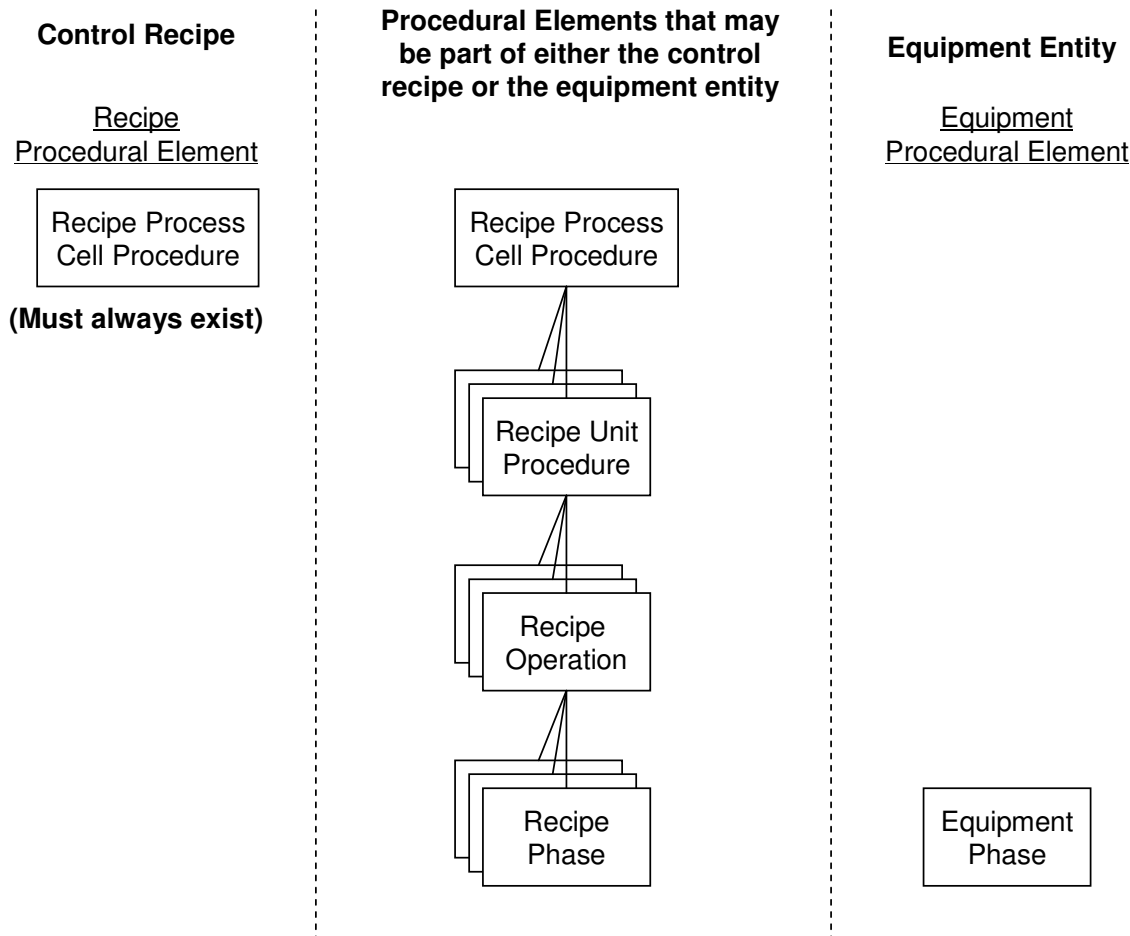


Figure 17 — Control recipe procedure/equipment control separation

While Figure 17 does not explicitly illustrate it, a control recipe may contain recipe procedural elements at different levels (e.g. unit procedure, operation and phase) that link to equipment entities. This results in more complicated operational scenarios but is possible within the constraints of this standard. Figure 18 provides a visual example of this. As can be seen, within the same control recipe process cell procedure, recipe unit procedure procedures, recipe operation procedures and recipe phase procedures can all reference equipment entities. Rounded rectangles have been used to help identify the recipe procedural elements that reference equipment procedural elements (EPE) in an equipment entity.

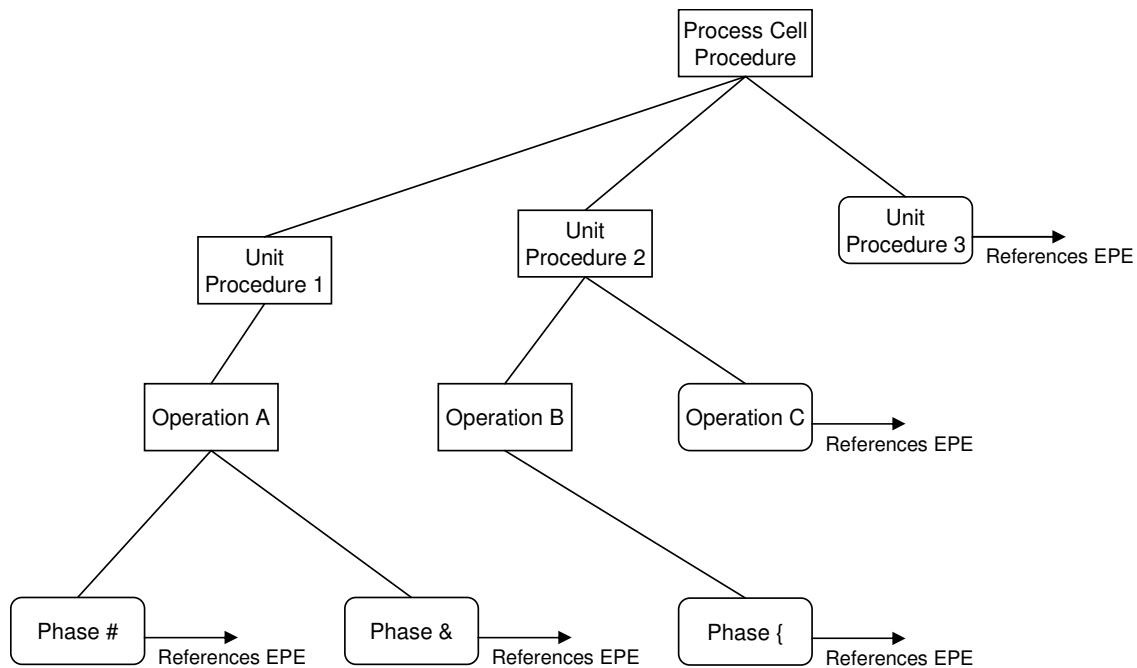


Figure 18 – Referencing equipment entities at different levels within a control recipe process cell procedure

The following examples assume only one level in a control recipe process cell procedure references equipment procedural elements in an equipment entity.

Example 1

If phases do not exist as part of the control recipe but operations do, the linking would be done at the operation level.

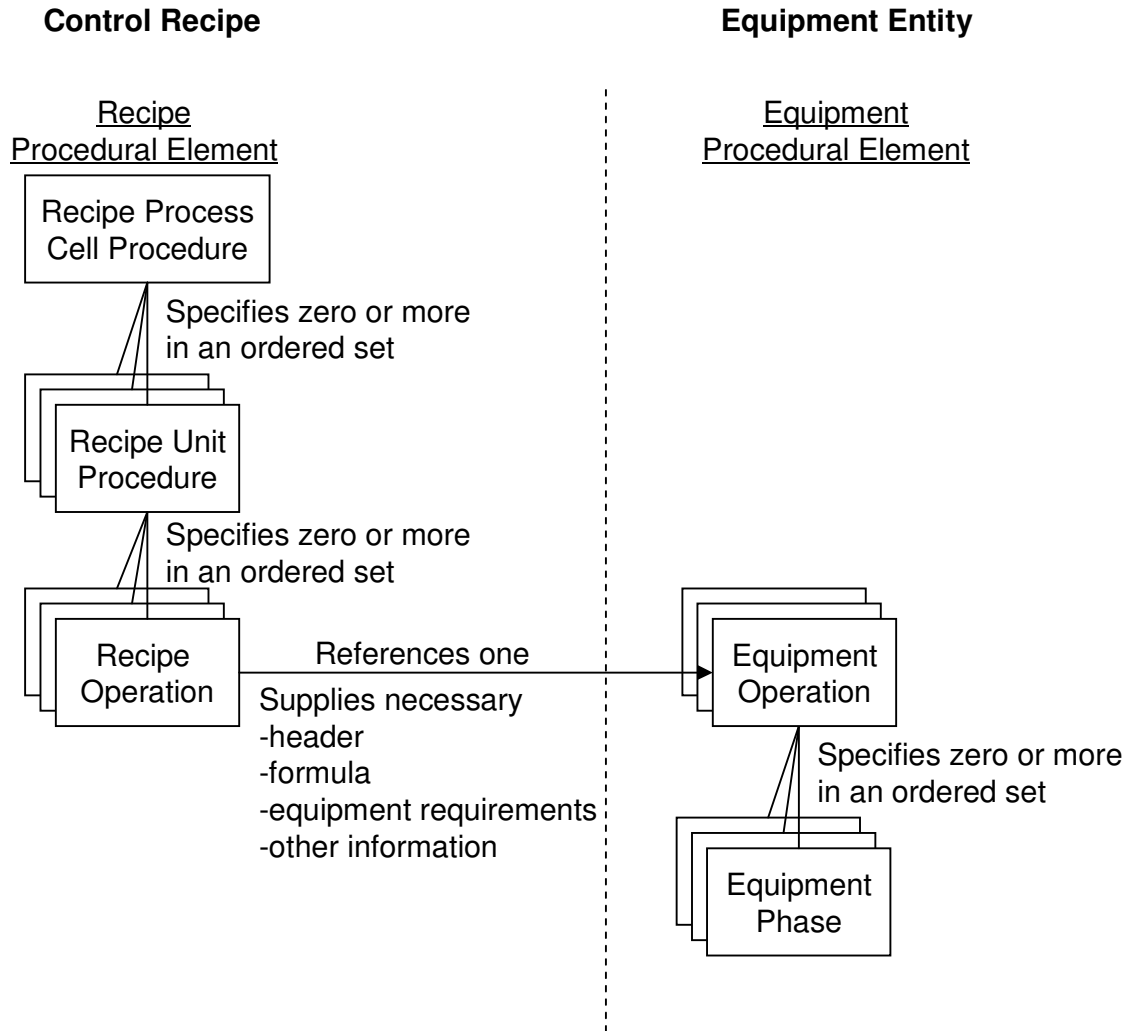


Figure 19 — Control recipe procedure example with unit procedures and operations

Example 2

If neither phases nor operations exist as part of the control recipe but unit procedures do, the linking would be done at the unit procedure level.

Control Recipe Procedure

Equipment Entity

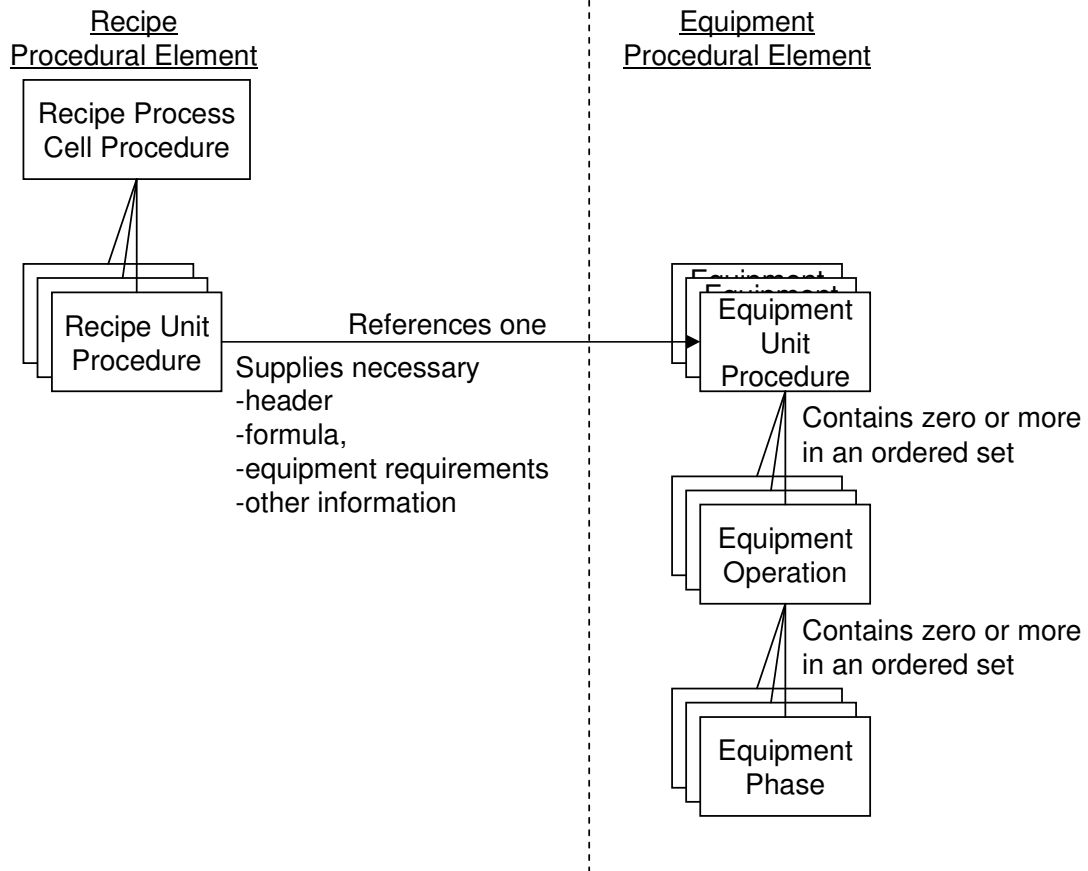


Figure 20 — Control recipe procedure example with unit procedures

Example 3

If only the process cell procedure exists as part of the control recipe, the linking would be done at the process cell procedure level.

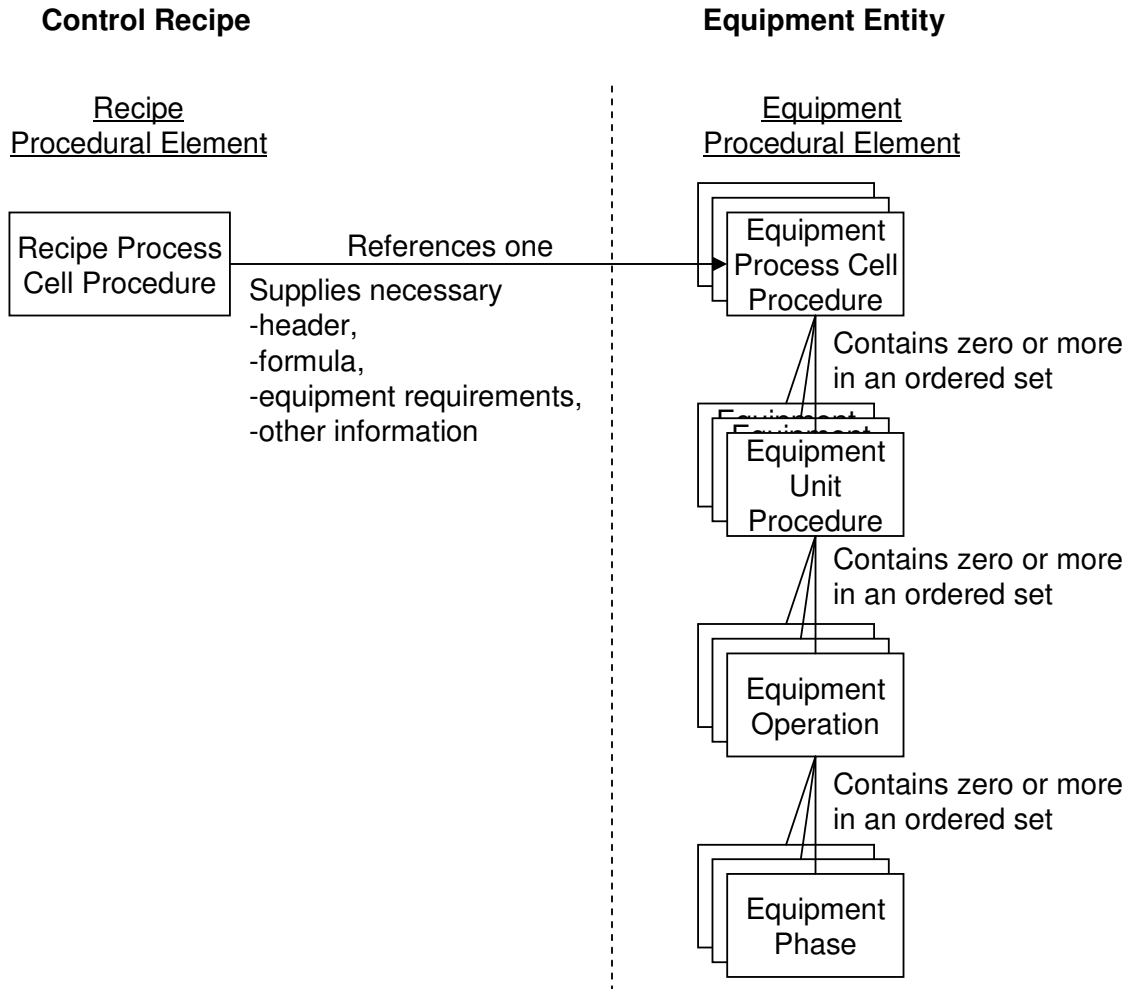


Figure 21 — Control recipe procedure example with only a process cell procedure

The preceding examples have assumed that between the control recipe and equipment entity all levels of the procedure model are being used. Levels in the procedural control model may be left out in a specific application. Examples 4-7 illustrate how the procedural control model in both the control recipe and equipment entity maybe collapsed.

Example 4

If a recipe process cell procedure addresses a single unit, the recipe process cell procedure itself may take the place of the recipe unit procedure. Figure 22 shows the recipe unit procedure omitted from the control recipe.

Example 5

Recipe phases alone might be used to define a recipe process cell procedure that addresses a single unit. Then the recipe process cell procedure consists of the phases needed to accomplish the function of the process cell procedure and the strategy needed to organize and properly sequence the phases. The recipe procedure model is collapsed to eliminate the use of recipe unit procedures and recipe operations as overtly stated subdivisions (see Figure 22).

Example 6

The case in example 5 could also be implemented as show in Figure 22 with the recipe process cell procedure referencing an equipment process cell procedure which in turn is made up of an ordered set of equipment phase procedures.

Example 7

The phase level may be omitted if a specific application is better described with operations that are not further subdivided. Then the operation interacts directly with basic control (see Figure 22).

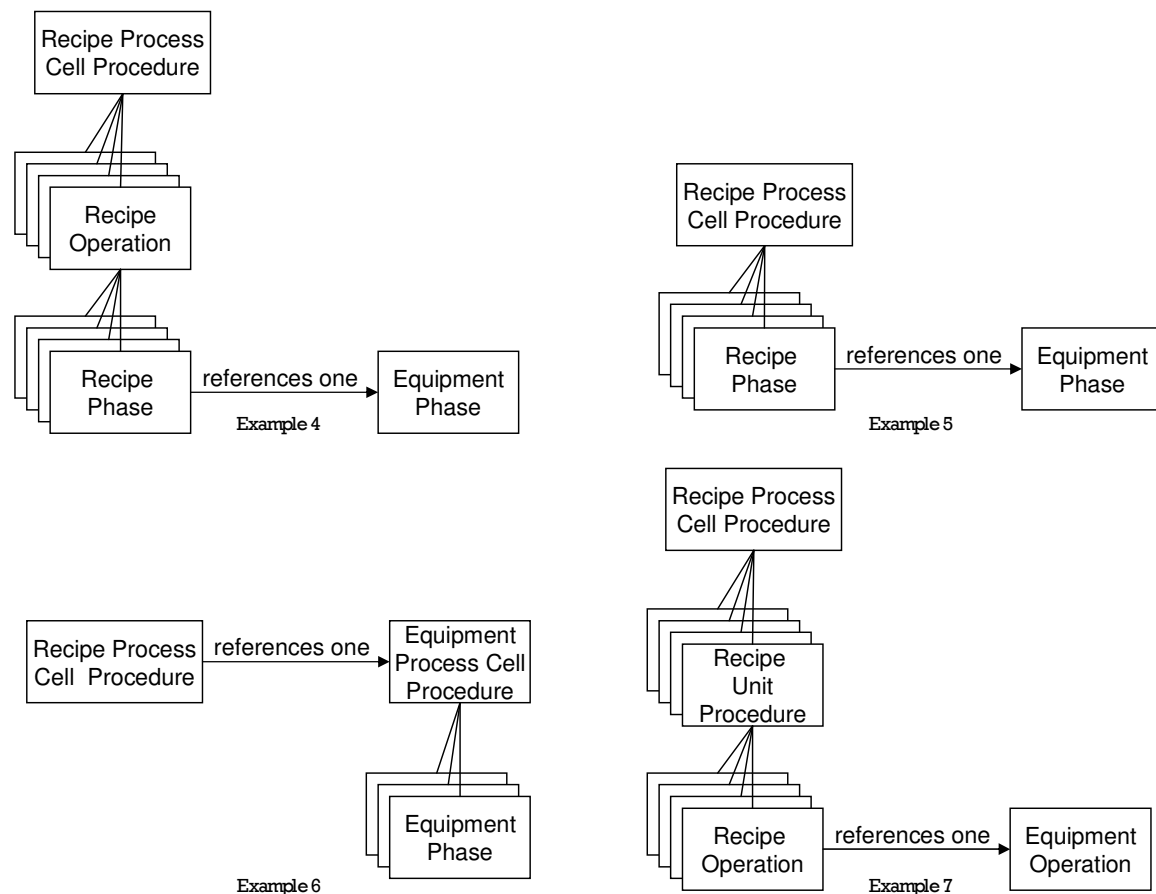


Figure 22 — Control recipe procedure/equipment control collapsibility examples

The following considerations must be taken into account when collapsing:

- When a procedural element level is taken out, the next higher level must take over its functions and contain the ordering task strategy controlling the next lower level and any other information that would have been stated in the collapsed level, including equipment requirements and other information.
- The lowest level of equipment procedural control must have the functionality to activate equipment through basic control.

5.5.4 Connecting recipe procedural elements, equipment procedural elements and equipment control when the control recipe uses an expanded procedural control model

Section 5.5.1 described how control recipes are connected to equipment entities when the full procedural control model is used in the control recipe. When the full procedural control model is expanded by adding new recipe procedural element levels or new equipment procedural element levels the same principles used for the full and collapsed procedural models shall be followed.

5.6 Production plans and schedules

Production plans and schedules state the production requirements for the enterprise, sites, areas, and process cells. Since these levels of the physical model operate on different time horizons, a number of different types of plans and schedules are typically needed within an enterprise. A detailed discussion of the various types of plans and schedules is outside the scope of this standard. Only the scheduling needs at the process cell level, the batch schedule, will be discussed.

The batch schedule typically contains more detailed information than production plans and schedules aimed at higher levels in the enterprise. It contains information such as the products that are to be produced, how much of each product is to be produced, and when they are required for a specific process cell. It identifies which batches are to be made, their order, and the equipment to be used. This schedule also deals with issues such as personnel requirements, raw material options, and packaging requirements.

Time horizons for the batch schedule are dependent on the speed of the processes and might be measured in minutes, hours, shifts, or days. The batch schedule is based on the specific resources and requirements of the process cell. The possible paths and equipment options are determined at this point. For the batch schedule to be totally meaningful, this schedule would need to be redone any time there is significant variance from the time projections, resource assumptions, or other anticipated factors on which the schedule was based. For example, the schedule may have to be updated if an activity is not completed close to the scheduled time. Whether that activity is delayed or whether it is completed ahead of time, the primary concern is whether that activity can affect other schedules in this process cell or other associated process cells.

The following is the typical information found in a batch schedule:

- Product name
- Master recipe name
- Quantity (with engineering units) of product
- Equipment and materials permitted to be used, such as path and raw material
- Projected mode of operation
- Order of initiation and priority

- Lot ID (if preassigned)
- Batch ID (if preassigned)
- Projected start time and end time
- Disposition of the finished batch
- Specific customer requirements

A key to efficient batch manufacturing is a comprehensive method that links the various plans and schedules with batch data collection. Batch data collection is the source of timely information that provides feedback so that these plans and schedules can be fine tuned. During the actual manufacturing of a batch, information is needed in real time so that schedules can be updated within a short time horizon. This update information also allows the user to be kept apprised of the status of lots and/or batches in the schedule.

5.6.1 Campaign

A series of batches can be called a campaign. The term describes a common method of operation of production facilities that relate batches together. Campaigns may be defined for one or more reasons. Examples include:

- Each batch is smaller than the required amount of material to be produced, so that multiple batches are required to meet production requests. The batches are all tied to a specific production request and can collectively be described as a product campaign.
- Multiple batches may be produced using the same master recipe, even if the production requests are not related, except that they specify the same produced product. This can be described as a batch campaign.
- A series of recipes, both production and non-production (e.g. cleaning), may be related in a sequence of execution to form a campaign.
- A series of recipes may be executed to perform non product related procedures, such as cleaning or sterilizing of equipment. This could be described as cleaning or sterilization campaigns that execute the same non-product master recipe against different pieces of equipment.

Campaigns are not normally visible to the process cell, they are the result of a planning process that results in a series of planned batches for one or more process cells.

NOTE: Change the definition of batch

batch: 1.) The material that is being produced or that has been produced by a single execution of a batch process. 2.) An entity that represents the production of a material at any point in the process. 3)An entity that represents the execution of a control recipe.

5.7 Production information

This section discusses information that is generated in the course of production. Information needs to be collected and made available to various levels of the enterprise. The type of information needed varies between different parts of the enterprise. At the enterprise level, for example, summary information may be all that is needed. Examples include the amount of

production of a particular product that was achieved at a specific site or at all sites, or how much product is available in inventory.

Process development may need detailed processing information on the individual batches in order to perform statistics and comparisons. At the process cell level where the batches are actually executed, there is a need for more detailed information in order to monitor the day-to-day production, to perform adjustments to the schedule, or to adjust processing from batch to batch.

Production information may be batch specific or it may be common to several or all of the batches produced.

5.7.1 Batch-specific information

The batch-specific information may include the following:

- A copy of the control recipe that was used to make the batch. This may not be identical to the original recipe because of operator changes, equipment problems, etc. It may be desirable to record both the original recipe and the actual recipe.
- Recipe data. This is actual process data that corresponds exactly to the recipe formula, such as the amount and type of material charged. This can then be compared to the original recipe.
- Recipe-specified data. This is data whose collection is specified by the recipe. An example is process control information to be trended.
- Summary batch data. This is data such as utilities consumption, equipment run times, and temperatures for the entire batch.
- Operator comments
- Continuous data. This is process data that is collected independent of specific events within the batch with the purpose of giving an accurate history of that measurement.
- Event data. This is data from predictable and unpredictable events, such as recording start and stop times of procedural elements, or unpredictable process or equipment events.
- Operator data. This includes any operator intervention that may affect the processing of the batch (includes operator's ID).
- Analysis data. This is data that is related to off-line measurements or analyses such as measured variables, operator ID, lab technician ID, time of entry of results, and time of sample.

5.7.2 Common (non-batch specific) batch information

Examples of common (non-batch specific) batch information include:

- Quality control information. This is information related to monitoring raw material qualities and processing quality.

- Utility systems information. This is process information for equipment such as process heating and cooling that do not produce batches themselves but support equipment that does produce batches.
- Equipment history. This is historical information, such as equipment utilization, calibration, and maintenance.
- Operational documentation. This includes documentation such as production volumes, material consumption summaries, and inventory statistics.
- Materials information. This is typically information such as quality information and packaging and labeling information of input and output materials.

5.7.3 Batch history

All recorded information pertaining to a batch is referred to as the batch history. The batch history will typically include the batch-specific information. Common (non-batch specific) batch information may be included in the batch history. Since information of this nature typically applies to all or several batches being processed in a process cell, it may be included in the individual batch histories by reference.

In many regulated industries, the record of the batch history is as important as the product itself. Without reliable and accurate batch record keeping, product quality and traceability cannot be ensured. Complete batch record keeping also provides information that is invaluable in process analysis and continuous improvement efforts.

Batch history must be stored in a way that makes it possible to associate the data with that batch (or batches) to which it relates and the processing that has taken place. This means that, in addition to the specific batch identity, the data must be associated with the actual execution of the appropriate procedural elements, where relevant. The structure of the executed procedure may differ from what is specified in the original recipe because of operator intervention, exception handling, or even planned diversity in the procedure, such as changes caused by varying resource limitations.

5.7.4 Batch reports

The extraction of data related to one or more batches is called a batch report. The extraction and ordering of the data in a report may vary based on the intended recipient of the batch report. Some of the typical recipients of batch reports and the types of information typically included in their reports are

- production management: These batch reports typically provide key economic information on the processing result and resource utilization from multiple batches.
- product development: These batch reports typically include detailed process information for an individual batch or compare similar data between a group of batches.
- plant operations: These batch reports typically include the data collected to the current point of processing.
- quality management: These batch reports typically contain information for documenting batch quality, which may be useful in quality statistics.

- authorities: These batch reports are typically provided as documentation of production complying with regulations.
- customers: These batch reports usually are documentation of product quality and process uniformity.

5.8 Allocation and arbitration

This section discusses mechanisms for allocating resources to a batch or unit and for arbitrating the use of common resources when more than one requester needs to use a common resource at the same time.

Resources such as equipment are assigned to a batch or a unit as they are needed to complete or to continue required processing. Allocation is a form of coordination control that makes these assignments. When more than one candidate for allocation exists, a selection algorithm such as "select lowest duty time" might be used as a basis for choosing the resource. When more than one request for a single resource is made, arbitration is needed to determine which requester will be granted the resource. An algorithm such as "first come/first served" might be used as a basis for arbitration.

In the following sections, allocation and arbitration are discussed in terms of equipment. The concepts apply equally well to other resources, such as operators.

5.8.1 Allocation

The very nature of batch processing requires that many asynchronous activities take place in relative isolation from each other with periodic points of synchronization. Many factors, both expected and unexpected, can affect the time required by one or more of the asynchronous activities from one point of synchronization to the next. For those reasons, and because of the inherent variation in any manufacturing process, the exact equipment which will be available at the time it is needed is very difficult to predict over a significant period of time. Even though a schedule may have been planned to totally optimize the processing sequence from the standpoint of equipment utilization, it often is desirable to allow alternate equipment to be used if the units planned for a batch are not available when planned. In this case the allocation of units to the batch -- the routing or path of the batch -- is a decision which must be made every time there is more than one path the batch can take through the available equipment.

If more than one unit can acquire or request the services of a single resource, the resource is designated as a common resource. Common resources are often present with complex batch processes. Common resources are often implemented as either equipment modules or control modules. A common resource may be either exclusive-use or shared-use.

If the resource is designated as exclusive-use, only one unit may use the resource at a time. A shared weigh tank in a batch plant might be an example of an exclusive-use resource. It can be used by only one reactor at a time. The schedule or some other basis for allocation must take this exclusive-use resource into consideration. If a reactor is waiting for the use of the weigh tank while another is using it, the waiting reactor is idle and is not making product, which has a negative effect on equipment utilization.

If the common resource is designated as shared, several units may use the resource at the same time. Some shared-use resources in a batch plant might be a process heater serving multiple units at the same time or a raw material distribution system which is capable of delivering material to more than one unit at a time. If the capabilities of a shared-use resource are limited, then it is possible that the requests for service might exceed the capacity of the resource. In that case some of the same concerns about allocation which apply to exclusive-use resources also apply to shared-use resources. Care must also be taken so that one unit does not improperly shut off or deactivate a resource while other units are using it.

5.8.2 Arbitration

If there are multiple requesters for a resource, arbitration is required so that proper allocations can be made. Arbitration resolves contention for a resource according to some predetermined algorithm and provides definitive routing or allocation direction. The algorithm may take various forms such as a predetermined schedule with reservations, a batch priority scheme, or it might rely upon operator judgment. Arbitration may bring with it two distinct issues which affect complexity, resource reservation and preemption.

Reservation allows a claim to be placed on a resource prior to actual allocation. Reservation allows arbitration to be based on future needs rather than allowing the first request for allocation of an idle resource to take precedence regardless of priority. Preemption occurs when a higher priority batch is allowed to cancel or interrupt the use of a resource assigned to a lower priority batch. When allowed, it is most often associated with allocation of exclusive-use common resource but can apply to allocation of any resource.

5.9 Modes and states

This section discusses the modes and states of equipment entities and of procedural elements. In the preceding sections, models describing equipment entities and procedural elements have been defined. In these models, transitions for procedural elements and for equipment entities occur within each hierarchical level. The status of equipment entities and of procedural elements may be described by their modes and states. Modes specify the manner in which these transitions take place; states specify their current status. Other resources, such as materials, may also have states.

5.9.1 Modes

Equipment entities and procedural elements may have modes. Example modes are described in this standard in relation to batch control. The mode of an equipment entity may be based on procedural elements or equipment entities utilizing basic control functions, depending on the main control characteristic of the entity.

This standard uses as examples three modes (automatic, semi-automatic and manual) for procedural elements, and two modes (automatic and manual) for equipment entities. Control modules contain basic control functions and will have automatic and manual modes, whereas a unit running procedural control would also have a semi-automatic mode.

This standard does not preclude additional modes or require the use of the modes defined here. The functionality of the modes presented is felt to be generally useful in most batch applications.

By naming the modes and including them in the standard, a defined set of terms is documented that can be used when communicating on batch control issues.

A mode determines how equipment entities and procedural elements respond to commands and how they operate. In the case of procedural elements, the mode determines the way the procedure will progress and who can affect that progression. In the case of a control module, such as an automatic block valve, that contains basic control functions, the mode determines the mechanism used to drive the valve position and who/what, such as another device or an operator, may manipulate it to change its state.

For procedural elements, the mode determines the way the transitions are treated. In the automatic mode, the transitions take place without interruption when the transition conditions are fulfilled. In the semi-automatic mode, the procedure requires manual approval to proceed after the transition conditions are fulfilled. Skipping or re-executing one or more procedural elements, without changing their order, is usually allowed. In the manual mode, the procedural elements and their order of execution are specified manually.

For equipment entities containing basic control functions, the mode determines how their states may be manipulated. In automatic mode equipment entities are manipulated by their control algorithms and in manual mode the equipment entities are manipulated by an operator.

Table ~~Table 4 — Possible implementations of example modes~~~~Table 4 — Possible implementations of example modes~~, lists possible behaviors and commands associated with the example modes.

Equipment entities or procedural elements may change mode. This change can occur if the conditional logic requirements for the change are met by internal logic or by an external command such as one generated by another procedural element or by an operator. A mode change takes place only when the conditions for the change request are met.

A change of mode in one equipment entity type or procedural element type may cause corresponding changes in other types. For example, putting a unit procedure to the Semi-automatic mode may cause all lower-level procedural elements in that unit to go to the Semi-automatic mode, or, a safety interlock trip may cause several control modules to go to the Manual mode with their outputs at minimum value. The propagation can be in either direction, from a higher level entity to a lower level entity, or conversely. This standard does not specify propagation rules.

5.9.2 States

Equipment entities and procedural elements may have states. Example states are described in this standard in relation to batch control. The state completely specifies the current condition of equipment entities or procedural elements. In the case of a valve, the state may be "percent open," and in the case of a procedural element, it may be "running" or "holding."

Table 4 — Possible implementations of example modes

Mode	Behavior	Command
Automatic (Procedural)	The transitions within a procedure are carried out without interruption	Operators may pause the progression, but may not force transitions

Automatic (Basic Control)	as appropriate conditions are met	
	Equipment entities are manipulated by their control algorithm.	The equipment cannot be manipulated directly by the operator.
Semi-automatic (Procedural Only)	Transitions within a procedure are carried out on manual commands as appropriate conditions are fulfilled.	Operators may pause the progression or re-direct the execution to an appropriate point. Transitions may not be forced.
Manual (Procedural)	The procedural elements within a procedure are executed in the order specified by an operator.	Operators may pause the progression or force transitions.
Manual (Basic Control)	Equipment entities are not manipulated by their control algorithm	Equipment entities may be manipulated directly by the operator.

This standard uses as an example a self-consistent set of procedural states and commands. The number of possible states and commands and their names vary for equipment entities and for procedural elements.

Examples of states for procedural elements include running, holding, paused, stopped, aborted, and complete. Examples of states for equipment entities include on, off, closed, open, failed, traveling, tripped, 35% open, and available. Examples of commands applicable to procedural elements are start, hold, pause, stop, and abort.

This standard does not require these states or preclude additional states. The functionality of the states and commands presented is felt to be generally useful in most batch applications. By naming the states and commands and including them in the standard, a defined set of terms is documented that can be used when communicating on batch control issues.

Equipment entities or procedural elements may change state. This change can occur if the conditional logic requirements for the change are met by internal logic or by an external command such as one generated by another procedural element or by an operator.

A change of state in one equipment entity type or procedural element type may cause corresponding changes in other types. For example, putting a unit procedure to the Held state may cause all procedural elements in that unit to go to the Held state, or, a safety interlock trip may cause all procedural elements in that unit to go to the Aborting state. The propagation can be in either direction, from a higher level entity to a lower level entity, or conversely. This standard does not specify propagation rules.

A set of procedural states and commands is provided below as a representative example to illustrate one way to define these procedural states and commands. The list of states and commands is summarized in the state transition matrix (see Table 5). An example state transition diagram is derived from the matrix for the first three lines in the matrix (Idle, Running, Complete) (see Figure 23).

5.9.2.1 Procedural states

For this example, the list of valid procedural states are the following:

- IDLE: The procedural element is waiting for a START command that will cause a transition to the RUNNING state.
- RUNNING: Normal operation
- COMPLETE: Normal operation has run to completion. The procedural element is now waiting for a RESET command that will cause a transition to IDLE.
- PAUSING: The procedural element or equipment entity has received a PAUSE command. This will cause the procedural element to stop at the next defined safe or stable stop location in its normal RUNNING logic. Once stopped, the state automatically transitions to PAUSED.
- PAUSED: Once the procedural element has paused at the defined stop location, the state changes to PAUSED. This state is usually used for short-term stops. A RESUME command causes transition to the RUNNING state, resuming normal operation immediately following the defined stop location.
- HOLDING: The procedural element has received a HOLD command and is executing its HOLDING logic to put the procedural element or equipment entity into a known state. If no sequencing is required, then the procedural element or equipment entity transitions immediately to the HELD state.
- HELD: The procedural element has completed its HOLDING logic and has been brought to a known or planned state. This state is usually used for a long-term stop. The procedural element or equipment entity is waiting for a further command to proceed.
- RESTARTING: The procedural element has received a RESTART command while in the HELD state. It is executing its restart logic in order to return to the RUNNING state. If no sequencing is required, then the procedural element or equipment entity transitions immediately to the RUNNING state.
- STOPPING: The procedural element has received a STOP command and is executing its STOPPING logic, which facilitates a controlled normal stop. If no sequencing is required, then the procedural element or equipment entity transitions immediately to the STOPPED state.
- STOPPED: The procedural element has completed its STOPPING logic. The procedural element or equipment entity is waiting for a RESET command to transition to IDLE.
- ABORTING: The procedural element has received an ABORT command and is executing its ABORT logic, which is the logic that facilitates a quicker, but not necessarily controlled, abnormal stop. If no sequencing is required, then the procedural element transitions immediately to the ABORTED state.
- ABORTED: The procedural element has completed its ABORTING logic. The procedural element is waiting for a RESET command to transition to IDLE.

5.9.2.2 Commands

For this example, the list of valid commands are the following:

- **START:** This command orders the procedural element to begin executing the normal RUNNING logic. This command is only valid when the procedural element is in the IDLE state.
- **STOP:** This command orders the procedural element to execute the STOPPING logic. This command is valid when the procedural element is in the RUNNING, PAUSING, PAUSED, HOLDING, HELD, OR RESTARTING state.
- **HOLD:** This command orders the procedural element to execute the HOLDING logic. This command is valid when the procedural element is in the RUNNING, PAUSING, PAUSED or RESTARTING state.
- **RESTART:** This command orders the procedural element to execute the RESTARTING logic to safely return to the RUNNING state. This command is only valid when the procedural element is in the HELD state.
- **ABORT:** This command orders the procedural element to execute the ABORTING logic. The command is valid in every state except for IDLE, COMPLETED, ABORTING and ABORTED.
- **RESET:** This command causes a transition to the IDLE state. It is valid from the COMPLETE, ABORTED, and STOPPED states.
- **PAUSE:** This command orders the procedural element to pause at the next programmed pause transition within its sequencing logic and await a RESUME command before proceeding. This command is only valid in the RUNNING state.
- **RESUME:** This command orders a procedural element that has PAUSED at a programmed transition as the result of either a PAUSE command or a SINGLE STEP mode to resume execution. This command is only valid when the procedural element is in the PAUSED state.

Table 5 — State transition matrix for example states for procedural elements

Command		Start	Stop	Hold	Restart	Abort	Reset	Pause	Resume
Initial State	No Command End State	State Transition Matrix							
Idle		Running							
Running	Complete		Stopping	Holding		Aborting		Pausing	
Complete							Idle		
Pausing	Paused		Stopping	Holding		Aborting			
Paused			Stopping	Holding		Aborting			Running
Holding	Held		Stopping			Aborting			
Held			Stopping		Restarting	Aborting			
Restarting	Running		Stopping	Holding		Aborting			

Stopping	Stopped					Aborting			
Stopped						Aborting	Idle		
Aborting	Aborted								
Aborted							Idle		

NOTE — The states ending with “ING” are transient states. If their logic completes normally, then a state transition to the state listed under NO COMMAND END STATE occurs. For example, if the RUNNING state completes normally, then the state automatically transitions to COMPLETE. Execution of the transient states (ending in -ING) is governed by the mode.

5.10 Exception handling

An event which occurs outside the normal or desired behavior of batch control is commonly called an exception. Handling of these exceptions can occur at all of the levels in the control activity model and may be part of procedural, basic, and coordination control.

Exception handling is an essential function of batch manufacturing. Exception handling is an integral part of all control and typically constitutes a very large portion of the control definition.

Examples of events that may indicate the need for exception handling are

- unavailability of raw materials, utilities, or plant equipment when needed;
- product or process problems;
- control equipment malfunction;
- hazardous conditions such as fire or chemical spills.

From the standpoint of control, exception handling is no different from desired control strategies in that an event is detected, evaluated, and a response generated.

Exception response functions may affect the modes and states of equipment entities and of procedural elements. For example, high pressure in a reactor could lead to the exception response function transferring the process to a STOPPED state, or an operator could detect some unusual condition and initiate similar action.

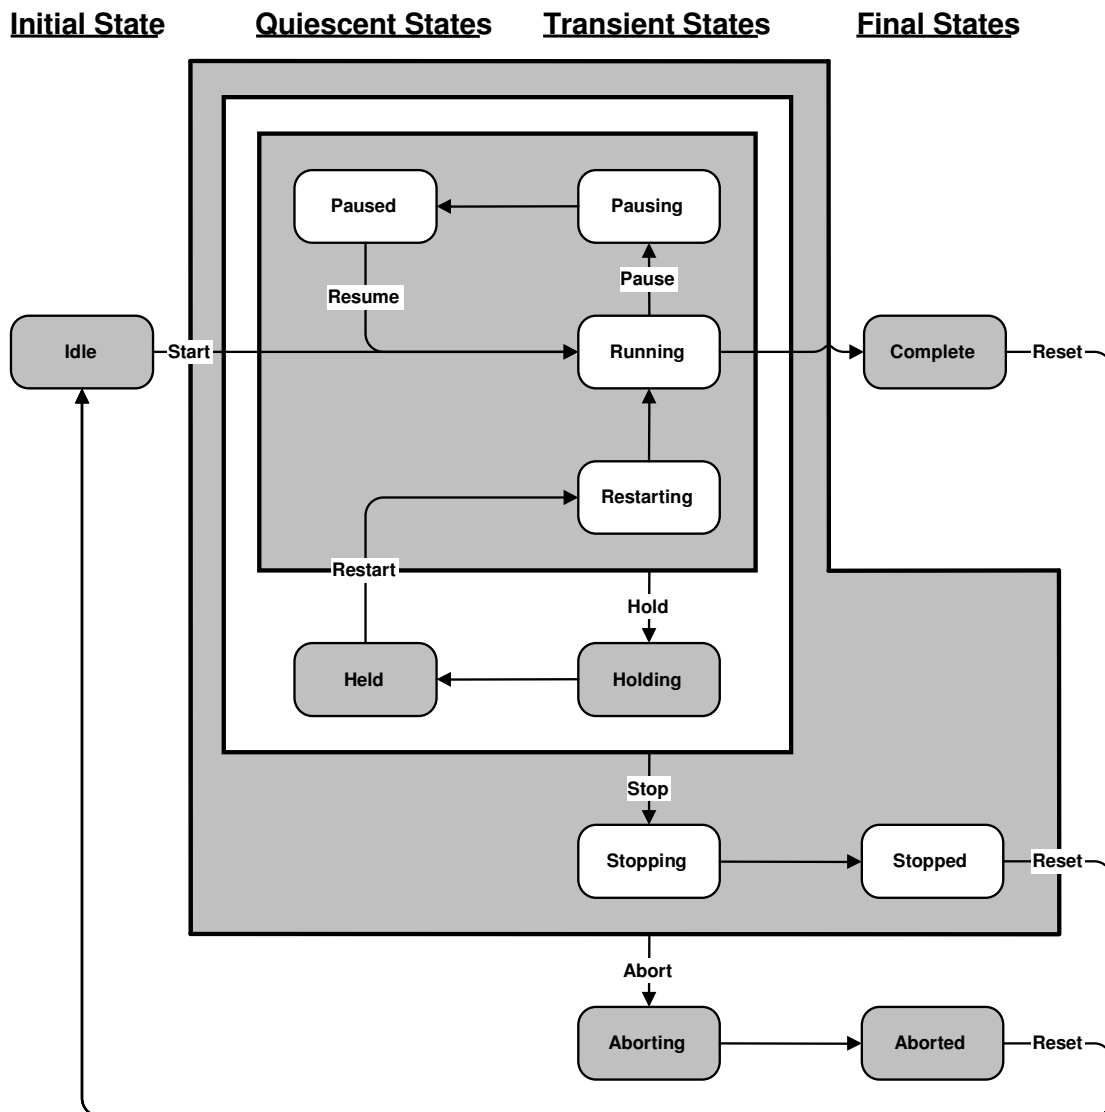


Figure 23 — State transition diagram for example states for procedural elements

6. Batch control activities and functions

This section discusses control functions that are associated with the batch processing, manufacturing, and control tasks described in the previous two sections. The control functions defined in this section elaborate on the control tasks defined in Section 5.1 for the equipment entities discussed in Section 5.2, which are the bottom four levels of the Physical Model described in Section 4.2. Control functions that meet the control needs of the higher levels of the Physical Model are also described. For convenience purposes, these control functions have been grouped into, and are discussed in the context of, control activities. The control activities that are discussed in this section are Recipe Management, Production Planning and Scheduling, Production Information Management, Process Cell Management, Unit Supervision, Process Control, and Personnel and Environmental Protection. The intent of this section is to clearly identify the individual functionality associated with batch control. This will make it easier to define the requirements for batch control for a given application.

6.1 Control activities

Many control functions must be implemented to successfully manage batch production. These control functions define how equipment in the batch manufacturing plant will be controlled. They are needed to support the equipment entities described previously. They are combined into seven control activities, as represented in the Control Activity Model of Figure 24.

6.1.1 Control activity model

The Control Activity Model in Figure 24 provides an overall perspective of batch control and shows the main relationships between the various control activities. It is not intended to show all relationships. The relationships illustrated are achieved via information flow between the control activities. The purpose of this drawing is simply to show where there is a relationship and not to define that relationship. The definition of the major relationships will take place later in this section as the control functions grouped within each control activity are discussed. A few of the relationships shown in Figure 24 are not discussed further in this standard.

The control activities shown relate to real needs in a batch manufacturing environment. The need to have control functions that can manage general, site, and master recipes implies a need for the Recipe Management control activity. Production of batches must occur within a time domain that is planned and subsequently carried out. Production Planning and Scheduling is the control activity where these control functions are discussed. Various types of production information must be available, and the collection and storage of batch history is a necessity. The Production Information Management control activity in the model covers these control functions.

Control recipes must be generated, batches must be initiated and supervised, unit activities require coordination, and logs and reports must be generated. These control functions fall under the Process Management control activity in the model. There are many control functions needed at the Unit Supervision control activity level. For example, there is a need to allocate resources, to supervise the execution of procedural elements, and to coordinate activities taking place at the Process Control level. In Process Control, control functions are discussed that deal directly with

equipment actions such as the need to implement control functions using regulating devices and/or state-oriented devices.

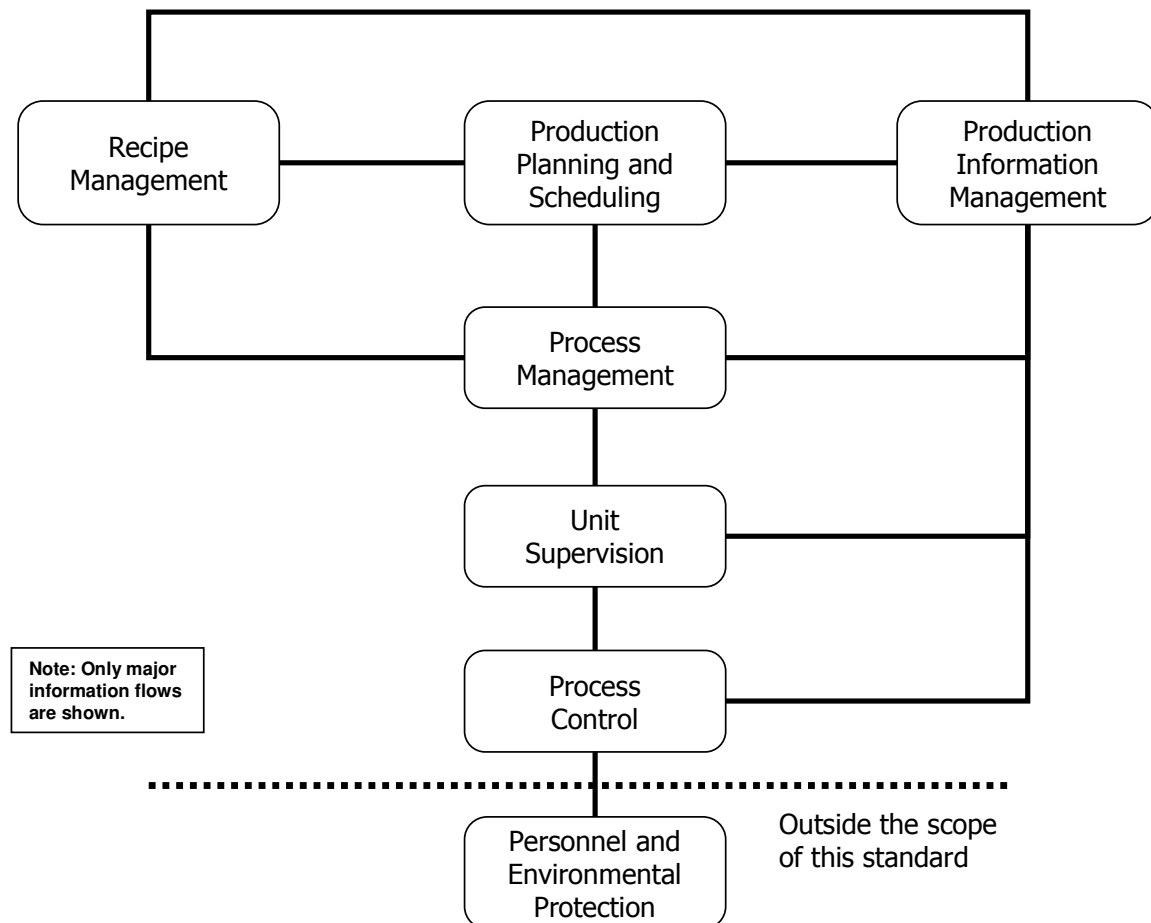


Figure 24 — Control activity model

Finally, the safety of personnel and the surrounding communities must be a prime concern, along with protection of the environment. The Personnel and Environmental Protection control activity covers these control functions.

6.1.2 Information handling

One dimension of the control activity model is its description of information flow throughout the levels. As such, there are a number of information handling functions that can be applied to all categories of data addressed by the control activity model. These are applicable regardless of the combination of manual and computerized systems that are established at a site. Additional information handling aspects that are specific to a particular control activity are described within their respective sections.

6.1.2.1 Reference information

The batch manufacturing enterprise may incorporate activities that fall outside the scope of this standard. Examples include

- material inventory management;
- process and product development;
- customer service support;
- regulatory reporting and process validation; and
- inter-departmental coordination, such as production versus support services.

To provide an interface to these information sources, the control activities discussed in this section need to store information in a way that provides a usable, accessible data source to these external activities. Similarly, each control activity should have the ability to access relevant reference information as needed to fulfill its function.

Examples of reference information include

- sales or marketing data, including customer orders or other statements of product demand;
- raw material vendor data;
- final products specifications;
- costing data;
- research and development data;
- standard consumptions of raw materials and standard yields for the products manufactured;
- rate information for the various process cells;
- equipment capability specifications;
- operational procedures for equipment maintenance and process safety;
- human resource information;
- quality control information such as the procedure used to perform a particular laboratory analysis; and
- regulatory requirements.

Reference information may be enterprise-wide, site-wide, area-wide, or process cell-wide.

6.1.2.2 Security

Within the control environment, information is used to impact the control functions, to communicate between levels and entities, and to provide communication to control functions outside of the control activity model. Access to this information is restricted to ensure that only authorized and/or qualified resources can affect the information.

6.1.2.3 Availability

Control activity information should be stored and retrieved in a way that provides the necessary safeguards to ensure access to critical data. The time necessary to recover access to the data in case of loss at one location should be considered carefully. These considerations will vary based

on the different levels of the control activity model, the types of information, and the level of detail required.

6.1.2.4 Archival

Removal of information from the control activity and into a long-term archive is often desirable to improve storage efficiency and recoverability. Once archived, it should be possible to retrieve the archived data in a usable form. For example, once a master recipe is no longer in active use, it would be useful to be able to extract all information (both structural and historical) related to that master recipe from the main repository.

6.1.2.5 Change management

Information that defines control — including configuration of equipment control and recipes — may be subject to formal change management. Means may be provided to support

- requests for and authorization of changes;
- version numbering and documentation;
- validation of changes; and
- audit tracking.

Change management may also include restrictions and checks necessary to maintain the integrity of the configuration. For example, it may be necessary to prevent a recipe creator from modifying a procedural element in use by an active recipe.

6.1.2.6 Reference tracking

Historical tracking of information references — for example, which definitions are used within which others or which served as the basis for others — can be important in analysis of production performance and in demonstrating compliance with production guidelines. This function can also provide a means to attach written comments about the changes, to assist in subsequent interpretation.

6.1.3 Process and control engineering

In order for required processing functions to be properly carried out in a batch manufacturing environment, the equipment structure needed, the process functionality, and the exception handling for that equipment have to be fully developed. This requires a coordinated engineering effort that continues from initial definition through the life of the batch processing facility. This section describes the process and control engineering needed for the design of the controls needed to support the recipe hierarchy, the definition of equipment capability, and the development of the functionality required in the process cell procedures to produce a batch.

Process and control engineering is needed at the general and site recipe levels to describe process definitions, process stages, process operations, and process actions and at the master recipe level to describe recipe process cell procedures, recipe unit procedures, recipe operations, and recipe phases.

The precise definition of appropriate procedural elements and equipment entities is an iterative process. The dual work process is illustrated in Figure 25. Considerations affecting one decision process also affect the other. Processing considerations are the primary input to the definition (or selection) of procedural elements that will characterize functionality for associated equipment entities. Since the functionality defined will be affected by the equipment used, equipment considerations must be a secondary input. In the same way, equipment considerations form the primary input and processing considerations the secondary input when making the definition (or selection) of equipment entities.

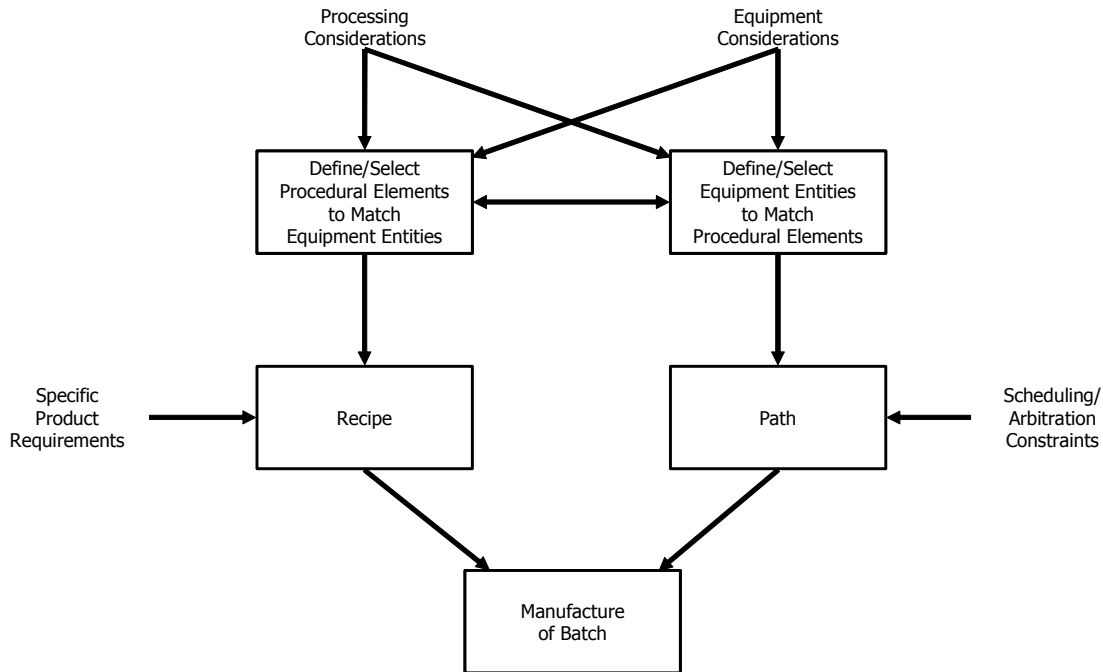


Figure 25 — Simultaneous definition/selection of procedural elements and equipment entities

Recipes can be constructed using these procedural elements and specific product information. The equipment entities are arranged into a path that is determined by scheduling and taking into account arbitration constraints. The combination of the results of these activities provides a framework within which a batch of material can be manufactured.

Process and control engineering also includes the development and revision of the equipment procedural element corresponding to the recipe phases that are used to define the recipe. As far as possible, recipe and equipment procedural elements should be defined such that any reasonable functionality of a unit can be expressed in terms of these phases. They should generally not be tailored to a set of known recipes. Then, new recipes can in most cases be written by using existing recipe phases that reference existing equipment procedural element. The development and revision of recipe and equipment procedural elements is an ongoing activity that provides ongoing support to the batch manufacturing facilities. This activity is the result of the ongoing drive for continuous improvement and the periodic addition of new process technology.

6.2 Recipe management

Recipe Management is made up of the control functions that create, store, and maintain general, site, and master recipes. The overall output of this control activity is a master recipe that is made available to Process Cell Management, which uses it to create a control recipe.

Recipe Management will be discussed in terms of managing the three levels of recipes and defining the procedural elements used in the recipe process cell procedures (see Figure 26).

6.2.1 Manage general recipes

Manage general recipes is the control function by which general recipes are created, maintained and stored. The specific processing requirements furnished by the process development activity for the product being considered serve as the basis for the general recipe.

In connection with the definition of the individual general recipe, the following capabilities may be required:

- Selecting and combining procedural elements to create a general recipe process definition
- Incorporating formula information
- Specifying equipment requirements and other information
- Maintaining the general recipe
- Managing changes to general recipes

6.2.2 Define general recipe procedural elements

The define general recipe procedural elements control function creates, maintains and makes available for subsequent use, the procedural elements that are used as building blocks in general recipe and site recipe process definitions.

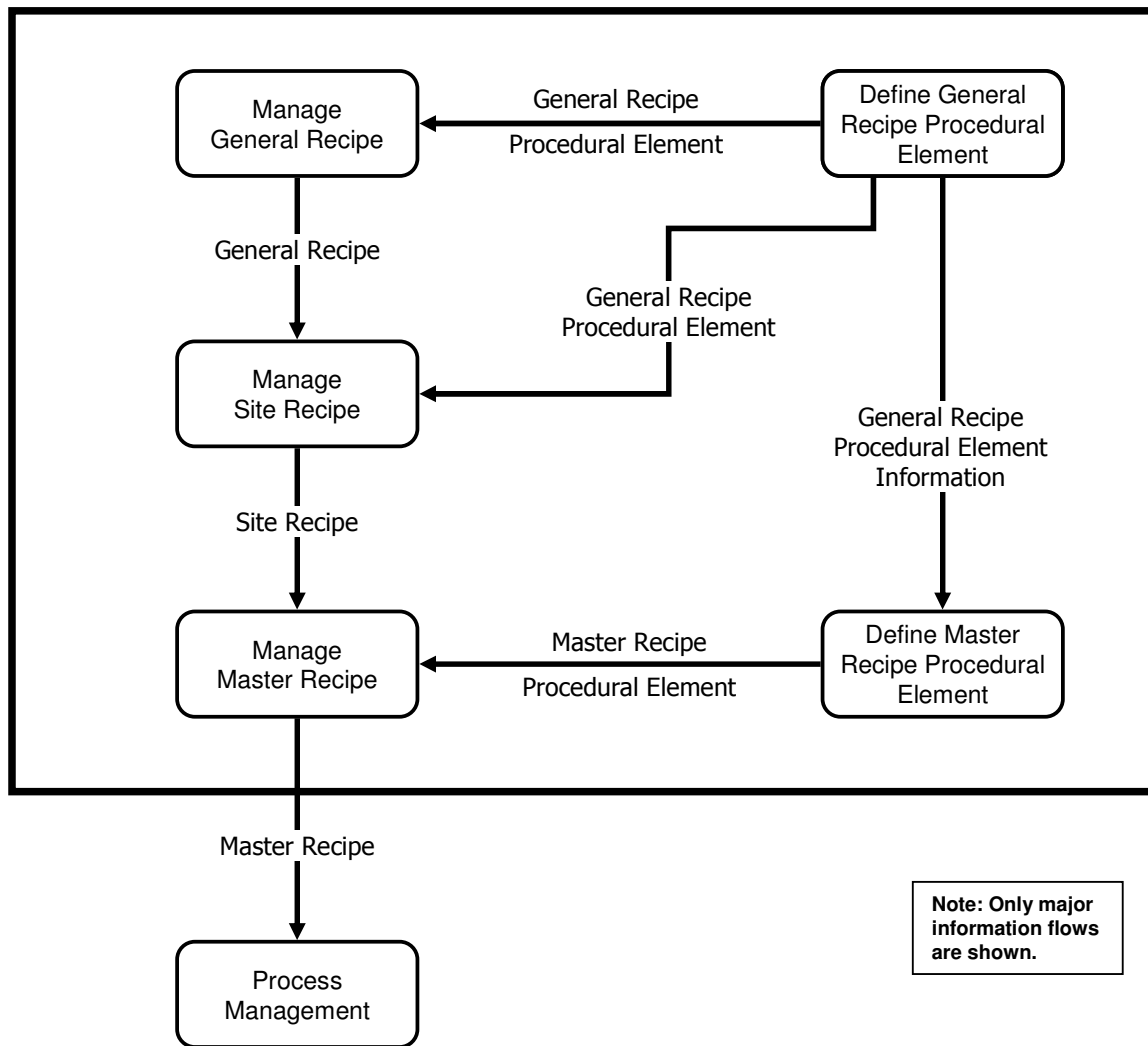


Figure 26 — Recipe management

The procedural elements defined by this control function may be process actions, process operations, process stages, and/or an entire general recipe process definition. Not all levels of procedural elements need to be defined.

This control function defines general recipe procedural elements based on the processing strategies required by the different products and described by process development. This information is then made available to the define master recipe procedural elements control function. In this way, the process intent of the general recipe procedural elements may be known at the master recipe level. The strategies have to be interpreted and transformed into procedural elements that enable the flexible and modular construction of general recipes. The broader the range of products that can utilize these modular process activity descriptions, the easier it is to create a general recipe. More importantly, modular process actions, process operations, process stages, and/or complete process definitions that are frequently reused tend to make recipe transformations at lower levels much easier to accomplish and recipes more consistent.

This procedural element information is then made available to define the master recipe procedural elements control function. In this way, the process intent of the general recipe procedural elements may be known at the master recipe level.

In connection with the definition of the individual general recipe procedural elements, the following capabilities may be required:

- Naming the individual procedural elements
- Specifying parameter variables
- Describing the intended processing functionality
- Combining lower level procedural elements and specifying the sequence of execution
- Creating, modifying, and archiving general recipe procedural elements
- Maintaining an inventory of procedural elements available
- Managing changes to procedural elements

6.2.3 Manage site recipes

Manage site recipes is the control function by which site recipes are created, maintained and stored. A site recipe is created by combining the information of the appropriate general recipe with site specific information. If additional or alternate procedural elements are required, only those defined under the define general recipe procedural elements control function are used.

6.2.4 Manage master recipes

Manage master recipes is the control function by which master recipes are created, maintained and stored. Master recipes are defined based on the specific processing requirements for the product in question. These specific processing requirements may be expressed in a general or site recipe.

The transformation of the site recipe into a master recipe may be a complex task. The creation of a process cell procedure, based on predefined procedural elements, must match the intent of the site recipe process definition. Transformation (or creation) of the content of the formula follows the same general logic that is used to map process actions to recipe phases. The batch size is fixed, or the range of batch sizes permissible for the recipe is established, if there are constraints on the degree of scalability. Formula information is adjusted accordingly. The equipment requirements are transformed into requirements that can be verified against the actual target equipment.

In connection with the definition of the individual master recipe, the following capabilities may be required:

- Selecting and combining procedural elements to create a master recipe process cell procedure
- Incorporating formula information
- Specifying equipment requirements and other information
- Creating, modifying, and archiving master recipes and maintaining the recipe headers

- Maintaining an inventory of master recipes
- Managing changes to master recipes

6.2.5 Define master recipe procedural elements

The define master recipe procedural elements control function creates, maintains and makes available for subsequent use, the procedural elements used in master recipe process cell procedures. These become the building blocks of the master recipe process cell procedure.

The master recipe procedural elements must reflect the processing capabilities required by master recipes. If these are generated from general and site recipes, then process stages, process operations, and process actions will map into unit procedures, operations, and phases. This control function defines the relationship between process actions and phases, between process operations and operations, and between process stages and unit procedures. It also defines the general scope of process cell procedures, unit procedures, operations, and phases to allow maximum consistent use of pre-defined procedural elements across the range of products to be made in the facility.

The master recipe procedural elements must, at least at the recipe phase level, be able to reference equipment procedural elements when the derived control recipe is executed. A close coordination with the engineering of the equipment procedural elements must therefore take place, ensuring that the recipe procedural elements adequately reflect the control capabilities of the target equipment. If required, any new functionality is made available through creation of new procedural elements, along with associated control and equipment modifications (see 6.1.3).

In addition to providing the building blocks for the master recipe process cell procedure, this control function may also define constraints on the configuration of master recipes, such as rules on the allowable order of recipe phases and limitations in the recipe creator's right to use recipe phases as building blocks. The determination of such constraints must be made based on many factors, such as safety, complexity of the recipe creator's task, required flexibility, and validation of individual procedural elements.

In connection with the definition of the individual procedural elements, the following capabilities may be required:

- Naming of the individual procedural elements
- Specifying parameter variables
- Describing the intended processing functionality
- Combining lower level procedural elements and specification of the sequence of execution
- Creating, modifying, and archiving master recipe procedural elements
- Maintaining an inventory of procedural elements available
- Managing changes to procedural elements

6.3 Production planning and scheduling

Production Planning and Scheduling is a high level control activity on a peer level with Recipe Management and Production Information Management. It is the decision process associated with producing a batch schedule that is provided to Process Cell Management. Although several control functions would need to be collected together to make up this control activity, most of those control functions are outside the scope of this standard. This section will consider only one of these control functions: Develop batch schedules.

The develop batch schedules control function accepts inputs from sources such as other types of schedules, master recipes, and resource databases, and, based upon a scheduling algorithm (automated or manual), develops a batch schedule (see 5.4 for a list of typical information in a batch schedule).

The following capability is typically included in this control function:

- Developing a batch schedule based on information from the appropriate source and some scheduling algorithm
- Developing a revised batch schedule on demand based on significant changes in batch progress and process cell status information provided by Process Cell Management
- Allowing for manual intervention into the scheduling process
- Determining the availability of resources as an input into the scheduling process
- Providing a procedure or method for batch sizing along with a means to organize the production of batches
- Determining the feasibility of the schedule based on the target equipment

6.4 Production information management

Production Information Management is a high level control activity on a peer level with Recipe Management and Production Planning and Scheduling. It is the control activity that is involved in collecting, storing, processing, and reporting production information.

The non-batch-related use of production information is not dealt with in this section, but in actual applications the management of batch-related information and non-batch-related information may very well be integral. Both batch-related and non-batch-related information may be used as input to higher-level control functions such as the generation of production reports to management. These activities will not be modeled in this standard.

Although several control functions would need to be collected together to make up this control activity, most of those control functions are outside the scope of this standard. This section will consider only one of these control functions: Manage batch history.

Batch history is a collection of data related to one batch. It may be organized in one or more files or tables per batch, or it may be present as a part of a database and retrievable via key fields, etc.

Batch history is built up of entries. An entry is a portion of information on the batch representing one value or a set of values describing one event, logged into the batch history in one action.

Manage batch history is the control function that typically includes the following capabilities:

- Receiving and storing information from other parts of the overall batch control application on batches
- Manipulating historical data
- Producing batch reports

The Manage batch history control function is performed regardless of the equipment used or when a batch is produced. For example, lab data often may be added after the execution of the batch.

6.4.1 Receiving and storing batch history information

The entering of data from the outside into batch history is initiated from Process Cell Management, Unit Supervision, and Process Control.

6.4.1.1 General collection and storage guidelines

All of the data for the batch history should be collected and stored in a way that includes or gives simple access to

- batch identification;
- absolute time stamp (Real time);
- identification of procedural elements with which the data is associated;
- time relative to the start or end of a batch or of the execution of a procedural element;
- equipment-independent entry identification;
- equipment utilized.

Adequate storage capacity is needed for the required number of batch histories. This should include sufficient capacity to store the batch histories of all running batches, and for finalized batches until appropriate actions have been taken (reports printed, long term backup or whatever action is specified).

To the extent that the storage time requirement exceeds the storage capacity of manage batch history, the capability must exist to export the batch histories onto long-term storage media or external systems. It must be possible to retrieve these batch histories for further extraction of data.

Reports or displays on the batch archive (number of batches in archive, amount of data, status [finalized, printed, archived in long term archive, etc.]).

6.4.1.2 Reliability of batch history entries

The requirements for reliability will vary from application to application and between the different entry types. In the following, a number of issues of reliability are described. For each type of entry, the appropriate level of reliability must be selected to match the needs of the individual application. Reliability issues include

- access control: control of access to the data-gathering system, including the configuration and the actual data collected;

- audit trail: identification of all manipulation that happened with each individual piece of information — including identification of the person or controls involved, the time and, in some cases, an explanation;
- logging reliability: specification of the required reliability of logging. Three levels may be distinguished:
 - a) Nice to have — no specific action in case of failure. Examples include data for optimization, equipment reliability statistics, etc.;
 - b) Limited holes acceptable if the failure is indicated in the batch history (logging absent from . . . to . . .);
 - c) Critical — data must be available. If it is missing, then backup procedures must be possible (electronic or manual backup, possibility of reconstruction, etc.).

The importance of exact logging of the latter type of information may be equivalent to the achieved product quality, either for financial reasons (accounting) or for product safety/responsibility reasons. Therefore the receiving function must be capable of providing feedback information on the general status of the receiving function (as well as specific confirmation feedback for each entry to the control activity that performs the logging) enabling them to perform buffering, redundancy or reintegration activities or, if required and allowed, to hold up the process.

- level of detail: This level should be well defined in the recipe, or it should be related to the process cell or parts of the process cell. It must be possible to see if an entry is absent because the corresponding event did not occur or because it is below the selected level of detail.
- logging of actual historic information: Batch history entries should, to the largest possible extent, reflect the actual physical/chemical events that influence the batch, not only what was anticipated in the recipe. That means that the character and amount of data logged will vary due to the variations in batch production.
- long-term consistency: The extent to which the interpretation of batch data relies on information outside of the batch history, such as cross reference lists between actual tags and batch entry tags or names of variables, should be well described. Such information should be stable in the long term. If changes or modifications do occur, then the versions that were relevant at the time of processing should be stored for use in data retrieval.
- speed of collection: Speed of collection should be considered a critical factor. In order to analyze the reasons for any abnormal conditions, it is important that the system be capable of recording the events and actions in the precise order in which they occurred.

6.4.1.3 Batch and material tracing

The collection of batch histories can support batch and material tracing if it has a complete overview of the batches, including the equipment utilized and the identification of raw materials.

Batch history provides backwards tracing if a certain end product batch history can be traced back to all involved processes, equipment, and ingredients (and to the involved processes, equipment, and ingredients of these ingredients). Forward tracing is available if the

consequences of a certain event or the usage of a certain raw material can be traced to all end products affected.

6.4.1.4 Logging from Process Cell Management

Process Cell Management logging should include information associated with initiating and routing the batch, and the equipment-independent information associated with the batch. This includes

- master recipe: the master recipe from which the control recipe was derived — either in copy or by reference. In case of reference, the master recipe should be maintained unchanged as long as the reference may be called.
- Process Cell Management events and control recipe information: information on any changes to and the execution of the control recipe. This includes information such as equipment allocation and start times for batches and unit procedures.
- operator comments: narrative descriptions or comments based on the operators' observations of the batch processing. This information entry should be capable of being recorded with the operator's identification.

6.4.1.5 Logging from unit supervision and process control

This data could be dedicated to a single batch or to several batches, such as data from shared resources, utility systems, etc. In the latter case the data should be available to all the required batch histories. This includes:

- continuous data: Continuous data is defined as process data that is collected independent of specific events within the batch, with the purpose of giving an accurate history of that measurement.
- pre-specified batch data: data that is specified to be logged during execution of the control recipe. The specification of this data may come from the recipe or be pre-configured.

This would include such things as total feed to a reactor or mixing time.

- predictable events: events that are expected to occur, such as start and stop times of procedural elements.
- unpredictable events: Unpredictable event data is defined as a single point entry based on an unpredictable process or physical condition within the batch. This includes such items as process alarms, equipment failures or other upset conditions. In the case of process alarms, the historical data may include the following:
 - a) Time of activation
 - b) Time of acknowledgment
 - c) Time of disappearance of the alarm condition
 - d) Alarm limit
 - e) Maximum deviation while the alarm is active

- f) Trending information while the alarm is active
- operator interventions: any operator intervention that may affect the processing of the batch. The operator intervention typically is logged with the following information:
 - a) Intervention type
 - b) Operator ID

6.4.1.6 Late entries

Late entry data is data entered after execution of the part of the control recipe procedure to which it is related, or after production of the batch. This is typically data that is related to off-line measurements or analyses. Manage batch history includes the logging of such entries, including establishing the link to the associated batch events (like sampling). The following data may be associated with late entries:

- Measured value(s)
- Operator ID
- Lab technician ID
- Time of entry
- Time of sample

6.4.2 Manipulating historical data

The following functions are typical:

- Data manipulation: altering (if legal) or supplementing archived batch data.
- Calculations: perform calculations on batch data creating new batch data related to one batch.
- Data reduction: data reduction on batch history information that is especially relevant with trend information. Loss of data in connection with data reduction should be well defined and related to the dynamics of the data, as well as the requirements of information based on this data.
- Batch tracking information: establishing or maintaining links between batch histories corresponding to the physical movements of the batches, ranging from the use of one batch as raw material to another, to the splitting or combining of batch histories due to splitting or combining of batches.

6.4.3 Producing batch reports

In this section any export of data — electronically or on paper — is designated a report.

A batch report is, in general, made on a specific request. Such a request must be possible without knowledge of equipment and time of production. This is the case when

- the batch ID is used as entry key to access the data, not a piece of equipment;
- timing is relative to identified batch events (start of batch, start of operation, etc.);

- entries are identified in generic, batch-related terms and not in equipment-specific tags.

6.4.3.1 Recipients of batch reports

Batch history data may be retrieved on request for a number of reasons:

- Production management: production overview summaries, consumption of raw materials and other resources, lot and batch tracking information
- Recipe management: recipe optimization information, comparison between recipe data and actual values, analysis of correlation across several batches, and comparison of trend information
- Process Cell Management: history of current batches and comparisons with old batches for operator display and process control optimization
- External systems:
 - a) quality control: statistical process control, compliance with product specifications, GMP (Good Manufacturing Practice) documentation
 - b) maintenance: alarms, equipment usage documentation
 - c) financial: raw material consumption, yields, produced quantities, etc.
 - d) customer support: product documentation
- Internally within manage batch history: Process Cell Management may include functions to perform the queries mentioned above and the ability to export or print them on request, at regular intervals, or after each batch.

6.4.3.2 Elements of batch reports

Some of the possible elements of a batch report include

- report header: This header contains information on the report type, batch or batches displayed in the report, descriptive text, etc.
- single elements: These data elements are displayed somewhere on the paper/screen.
- event lists: These are chronological lists of event-type entries with associated data. For example, this might include a list of alarms or a list of operator interventions.
- merging of entries in event lists: Entries with different tags and of different types may be merged into the same list.
- selection of entries into lists: Entries may be selected according to different criteria before entering lists. For example, the entries may include only high priority alarms.
- trends: These displays show one or more values on the same time axis.
 - a) single batch trend: These are trends that display data from one batch or a portion of a batch . They may display several values with individual time axis. The display may be in relative or absolute time.

- b) multi-batch trend: These are trends that compare values from several batches in one trend display. They must be with relative time-axis. Some variables may be normalized to a standard amount.
 - c) event-marking in trends: Events may be introduced in the trend display by "ticks" on trends or other indications. The tick should refer to a specific event-type entry.
- time-series: These are displays of a time-series of one or more entries in a table-like fashion. The time-deadband, which is how close in time entries with different tags have to be in order to be displayed on the same line, must be specified in time series displays.
- interpolation: Rules for interpolation of data have to be established if data with different entry-times have to be displayed on one line or if the data are used in calculations.

6.5 Process Cell Management

Process Cell Management is the collection of control functions that manages all batches and resources within a process cell. Within this control activity, control recipes are created from master recipes, each batch is defined as an entity, individual batches are initiated and supervised, resources within the process cell are managed to resolve conflicts for their use and process cell and batch data are collected. Process Cell Management interfaces with Unit Supervision, Recipe Management, Production Planning and Scheduling, and Production Information Management (see Figure 27).

At the process cell level, there are often multiple batches and multiple units, and each unit may be carrying out a unit procedure for a different batch. The progression of the procedure for each batch and the utilization of the individual pieces of equipment has to be coordinated based on information derived from the control recipe, scheduling information, and status of equipment and other common resources.

The domain of Process Cell Management is the process cell. The successful execution of a control recipe makes a batch, and Process Cell Management is finished with the batch when the control recipe process cell procedure is complete. The batch that has been produced does not have to be a final product. It may take several control recipes running in the same process cell or in different process cells and/or sites to make the finished product(s). When a batch leaves the process cell, it is no longer the responsibility of Process Cell Management associated with that process cell in terms of identification, batch tracking, etc.

Process Cell Management can be discussed in terms of the following three control functions (see Figure 27):

- Manage batches
- Manage process cell resources
- Collect batch and process cell information

6.5.1 Manage batches

This is the control function in which a control recipe is created from a copy of a master recipe, a batch is initiated based on the scheduling information and operator input, and the execution of the batch is supervised.

The following capability is typically included in this control function:

- Creating a control recipe from the master recipe, scheduling information, and input received from the operator. This may happen with widely varying lead times, such as at the instant needed in some situations and well in advance of the scheduled execution time in others. The control recipe may be created initially in its entirety, or it may be created incrementally as the information is needed.
- Assigning a unique batch identification (batch ID) to each batch and to the associated control recipe. A batch may be identified or named in many different ways, but at least one identification, referred to here as the batch ID, must be verified to be totally unique within the process cell at any given time. The batch ID may be provided by the operator, in the scheduling information, or from within Process Cell Management, but uniqueness is typically verified before it is associated with a batch.

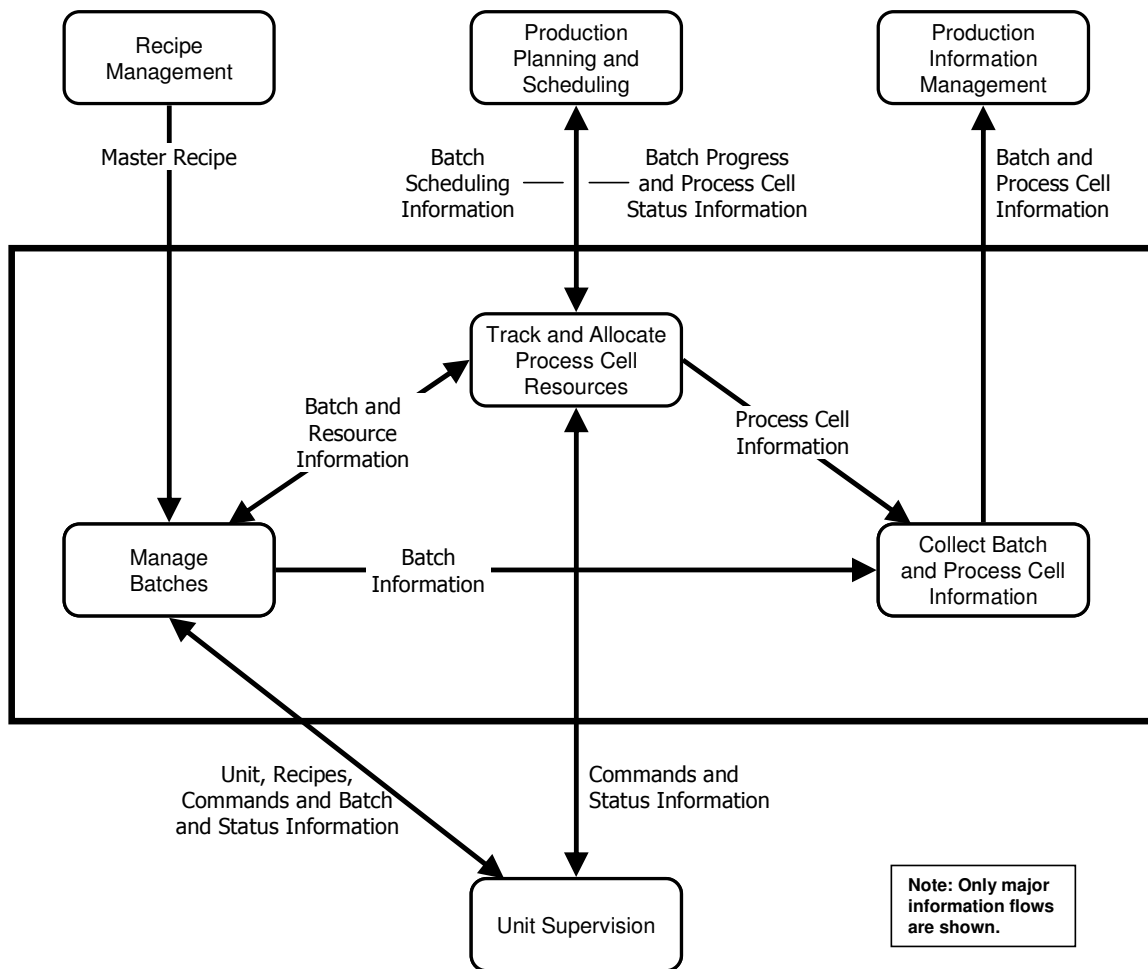


Figure 27 — Process Cell Management

- Verifying the control recipe as it is created. Verifying consists of ensuring that the control recipe is complete and is executable on the selected set of units. This includes verifying that all procedural elements are available, that formula information is valid, and that necessary resources can be expected to be available when needed.

- Sizing the control recipe to meet the batch quantity needed based on the sizing rules in the master recipe and the quantity specified in the batch scheduling information. The recipe may include the range over which it may be scaled.
- Maintaining all the current control recipes within Process Cell Management until the batches are completed.
- Assigning the start conditions as specified in the scheduling information and/or provided by the operator. Some batch start conditions that may be used, either individually or in some combination, include the following:
 - a) Start batch as soon as a unit becomes available
 - b) Start based on operator direction
 - c) Start when specific units are available
 - d) Start based on the scheduled priority of the batch
- Modifying any part of a control recipe that has not been executed. This may include the ability to modify the process cell procedure, such as adding and deleting unit procedures, operations, and/or phases, or looping back to repeat unit procedures, operations, and/or phases that have previously been executed.
- Requesting and releasing units and other equipment, changing their status to indicate use, and updating the manage process cell resources control function on the status of the batch.
- Monitoring and controlling the executing control recipe(s) including the current status of the batch, such as what unit procedures have been executed, and what unit procedure is next.
- Processing requests for state and mode changes to process cell procedures, unit procedures, operations, and phases.
- Allowing a control recipe to span multiple units in the same process cell, including distributing unit recipes to Unit Supervision in a timely manner.
- Allowing a batch to be suspended, removed from the processing equipment (packaged for temporary storage), and therefore out of the control of Process Cell Management, and later recalled to complete the batch processing.
- Maintaining batch status information. The control recipe, including all modifications, should be logged as part of the batch history as it is executed or at least when the batch leaves the process cell.
- Updating information on batches to the collect batch and process cell information control function.

6.5.2 Track and allocate process cell resources

This is an execution related control function in which process cell resources are made available for execution by allocating and reserving units and other equipment, by arbitrating multiple requests for the same equipment, and by providing a mechanism for maintaining status of both

allocated and unallocated equipment. Process cell resources also include the materials within the process cell. Process cell resource tracking and allocation must maintain information including which materials are in the process cell, which are pre-allocated by the batch schedule, the materials that are available for allocation during recipe execution, the units that contain them, and their disposition.

An assignment of resources at the process cell or unit level (resource allocation) needs to be provided in order for Process Cell Management to be able to assign the equipment or equipment options according to active recipes being executed and the batch schedule. Although limited in function to execution time allocations, limited equipment reassignment and generation of a new resource allocation at the process cell or unit level may also be needed by an operator. This new resource allocation may be necessary because of such variables as an execution-time malfunction in equipment or availability of raw materials that could not be anticipated by production planning and scheduling. Production Planning and Scheduling may require notification of this new resource allocation to allow for assessment of impact.

The following capabilities are typically included in this control function:

- Obtaining scheduling information from Production Planning and Scheduling and providing this information to the manage batches control function
- Allocating or reserving equipment as requested by the manage batches control function. Within a process cell, batches may move from unit to unit. In each unit a portion of the control recipe, corresponding to the unit procedure, is executed. The control of what equipment to allocate to the different batches, and when transfers can take place may require control at the process cell level. Some examples of how this allocation may be done are
 - according to a batch schedule designating each individual unit allocation; or
 - according to a strategy defined at the process cell level combining the equipment requirements of the control recipe and the availability and capabilities of equipment at the time of execution.
- Arbitrating, as required, multiple requests for reservation or allocation of the same equipment during control recipe execution. The rules for arbitration may be simple or complex, depending on the application. Examples of arbitration rule sets include the following:
 - Order of request (FIFO)
 - Timed requests (such as by reserving the equipment)
 - Priority of batch
 - Maximizing equipment utilization (such as by minimizing cleaning requirements, minimizing energy consumption, or maximizing throughput)
 - Operator judgment
- Keeping track of both allocated and unallocated equipment within the process cell

- Receiving status information sent by Unit Supervision and/or status information sent by Process Control related to unallocated equipment within the process cell
- Updating information on all process cell resources to the collect batch and process cell information control function
- Updating Production Planning and Scheduling with batch progress information, such as
 - batch ID;
 - batch state change events;
 - actual quantities of raw materials, products, and utilities;
 - equipment assignments; and
 - projected and actual allocation and de-allocation times of process cell resources.

6.5.3 Collect batch and process cell information

This is the control function in which information is collected about Process Cell Management events, both batch and equipment oriented, from the manage batches and manage process cell resources control functions. This information is made available to Production Information Management.

Examples of the types of information collected include the following:

- Mode and state changes
- Incremental copies of control recipes as each portion is finished
- Time that commands were sent to Unit Supervision and Process Control
- Time that unit recipes were sent to Unit Supervision
- Delays encountered due to lack of equipment availability
- Time of allocation, reservation and release of each process cell resource
- Requests and result of requests for equipment allocation or reservation which required arbitration
- Status changes in unallocated equipment
- Operator intervention

6.6 Unit supervision

Unit Supervision is the control activity that ties the recipe to equipment control via Process Control (see Figure 28). This control activity interfaces with Process Cell Management, Process Control, and Production Information Management. There are three main control functions within this control activity that are discussed in this section. They include acquiring and executing procedural elements, managing unit resources, and collecting batch and unit information.

6.6.1 Acquire and execute procedural elements

Process Cell Management supplies the unit recipe that will be executed within the unit and also supplies other batch information required to manufacture the batch.

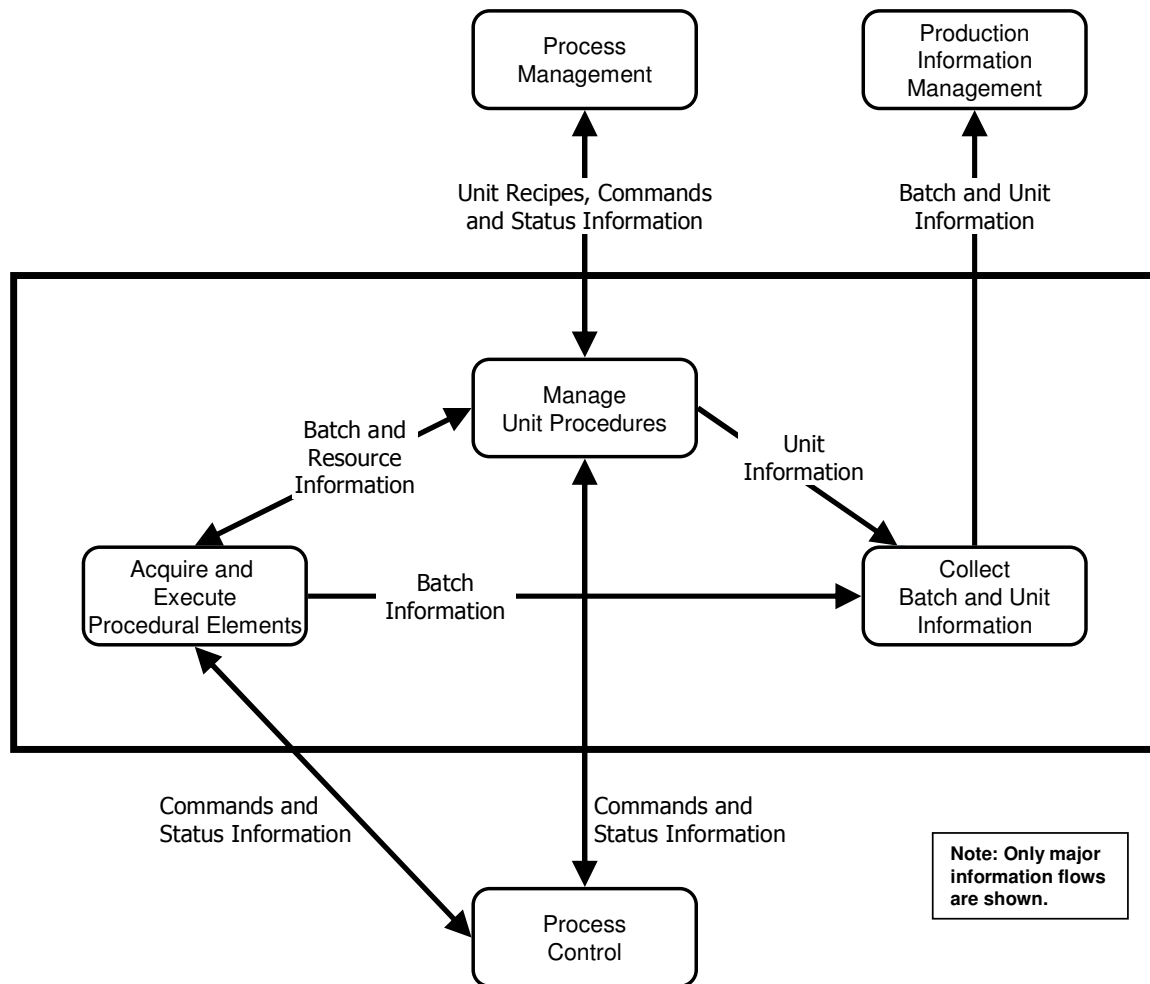


Figure 28 — Unit supervision

Unit Supervision has to be able to determine from the unit recipe the procedural logic to be run, the appropriate parameters, the equipment entities to be utilized, and other pertinent information, such as the name of the product, equipment restrictions, and the batch number.

Acquire and execute procedural elements includes the execution of unit procedures. If the unit procedure is part of equipment control in the unit, this control function associates the recipe unit procedure, including the parameters, with the equipment unit procedure.

Acquire and execute procedural elements includes the execution of operations. If the operation is part of equipment control in the unit, this control function associates the recipe operation, including the parameters, with the equipment operation. The initiation and parameterization of phases is part of the execution of an operation.

Acquire and execute procedural elements includes the initiation and/or execution of equipment phases. There are two possible conditions:

- If the phase is part of equipment control in the unit, this control function associates the recipe phase, including the parameters, with the equipment phase. Unit supervision then executes the equipment phase as part of this control function.
- If the phase is part of equipment control in an equipment module, this control function must initiate and parameterize the equipment procedural element. Execution of the equipment phase is handled by the equipment module rather than as an activity of unit supervision.

The following capabilities are typically included in this control function:

- Determining which procedural elements are to be executed
- Verifying that the procedural elements exist
- Executing unit procedures, operations, and equipment procedural element
- Associating recipe procedural elements with equipment procedural elements
- Initiating and parameterizing equipment procedural element.

6.6.2 Manage unit resources

This control function includes the management of resources that are part of the unit, management of resources that might have been acquired and have not yet been released, initiation of requests for resources that are not currently part of the unit, requests for services from other units, and providing services to another unit.

During the execution of a recipe, it may be necessary to acquire shared-use and/or exclusive-use resources that will subsequently be released. Although units cannot acquire other units, they can request services from or provide services to another unit as long as the recipe has specified compatible procedural logic for both units. The phases or operations in the units can communicate to perform a coordinated function.

Unit-to-unit coordination may be used to enable functions such as material transfers between units.

The following capabilities are typically included in this control function:

- Issuing requests to, reacting on feedback from, and interfacing with arbitration functions related to the equipment in question
- Ensuring appropriate propagation of unit and procedural element modes and states
- Enabling collection of production information relevant to the batch from external equipment

6.6.3 Collect batch and unit information

The Collect Batch and Unit Information control function makes information available to Production Information Management about Unit Supervision events, both batch and equipment oriented.

Data collection may be conditional. That is, certain data might not always be collected or might be sampled at a different time interval, depending upon information received from another control function, such as from parameters passed to the equipment procedural element.

Examples of the types of information collected include the following:

- Mode and state changes
- Timing of commands sent to Process Control
- Timing of the execution of the unit recipe procedure events
- Timing and sequence of allocation, reservation, and release of equipment entities acquired by the unit
- Status changes in unit equipment
- Values derived during execution of the unit recipe

6.7 Process control

This control activity encompasses procedural and basic control, including sequential, regulatory, and discrete control, in addition to gathering and displaying data. This control activity will be distributed among several equipment entities, including units, equipment modules and control modules. It interfaces with Production Information Management, Unit Supervision, and Personnel and Environmental Protection.

Process Control can be discussed in terms of three control functions: execute equipment procedural element, execute basic control, and collect data (see Figure 29).

6.7.1 Execute equipment phases

This is the control function in which equipment entities receive commands to perform process functions directed by the equipment procedural element, e.g. a phase. This control function is initialized by the *Acquire and execute procedural element* control function in Unit Supervision (6.6.1). By definition, coordination control and the equipment procedural element are configured as part of an equipment entity. However, parameter values may be necessary in order to execute the equipment procedure. The *Execute equipment phase* function interprets the procedure initialization command and associates the necessary parameters with the equipment procedure. The equipment procedural element may be commanded and parameterized before or during execution. Equipment entities capable of performing this control function are equipment modules and units.

NOTE — Normally this is the execution of a phase and its strategy. If the strategy to execute is driven from an equipment operation or unit procedure, it is understood that this activity is generally supported by a unit and not equipment modules.

This control function does not act directly on physical equipment. It influences the process only through the basic control in a control module.

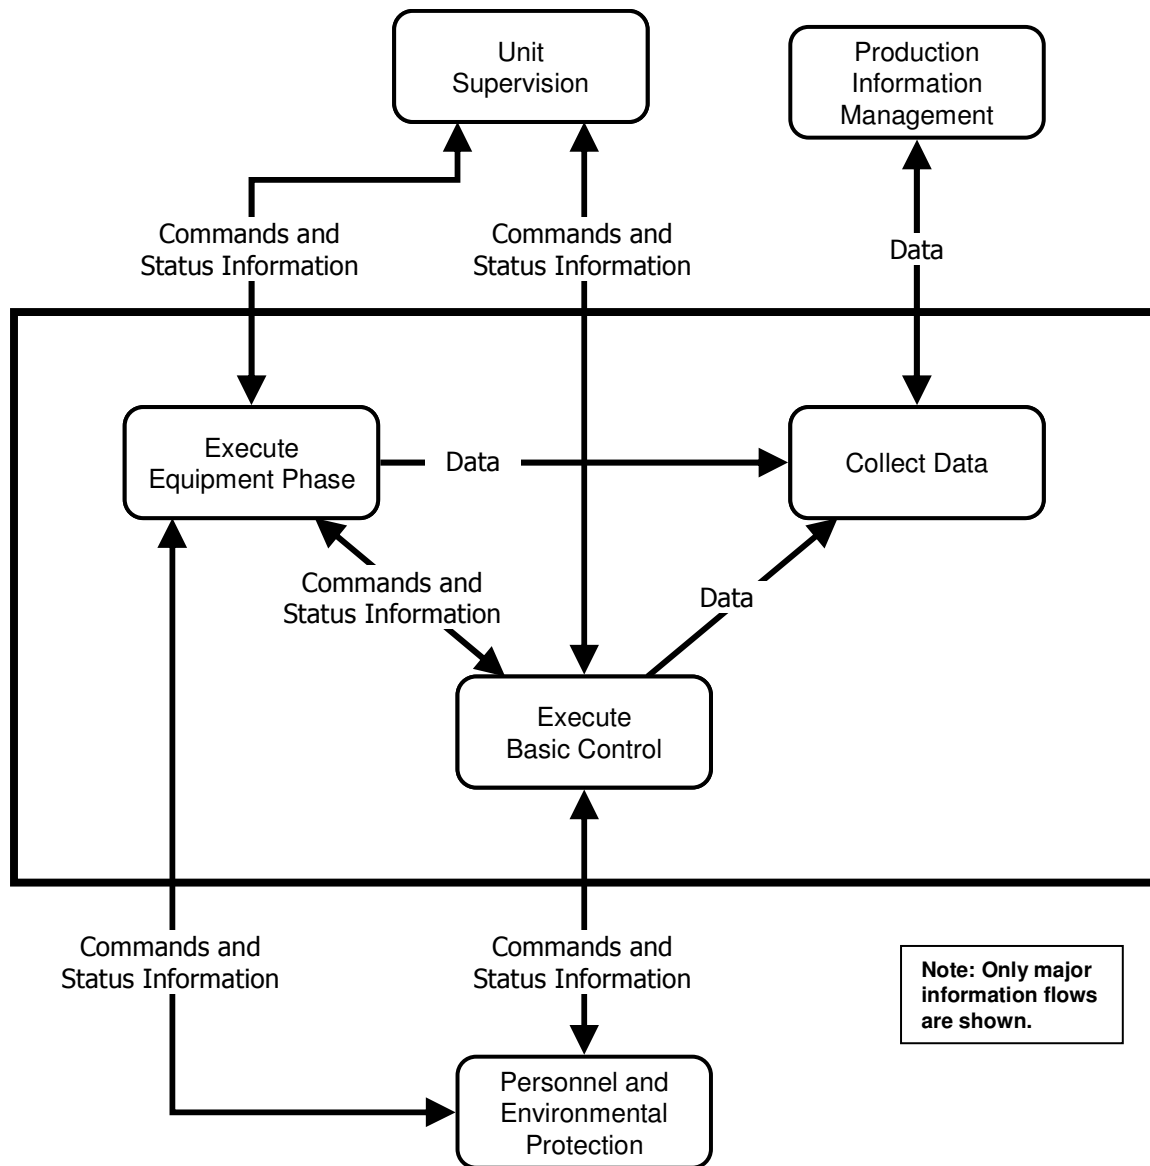


Figure 29 — Process control

This control function also includes the supervision of equipment procedural element modes and states. This includes

- the propagation of modes and states from/to any procedural element and/or equipment entity;
- the propagation of modes and states from the unit or equipment module executing the equipment procedural element; and
- manual intervention into the execution of the equipment procedural control.

6.7.2 Execute basic control

Executing basic control is a control function that causes changes in equipment and process states by sending commands to actuators and other control modules. Commands to basic control may

come from the execution of an equipment procedural control or from another control function, such as a manual command from an operator. Basic control uses input from sensors and other control functions in order to execute its function. The execution of this control function may also result in process, equipment, and other status information being provided to high level control functions. Some other basic control functions that may be included are execution of state transition sequences when required, exception handling, calculations, and treatment of operator-entered information, etc.

However, the execute basic control function shall not contain procedural or equipment procedural element control and is always configured as part of the equipment entity. This control function also includes the association of the necessary parameters with the appropriate basic control function. The only equipment entities directly capable of performing this control function are control modules. Equipment modules, units, and process cells may also be capable of performing basic control only because they contain control modules or make use of subordinate control modules.

This control function also includes the supervision of equipment entity modes and states. This includes

- the propagation of modes and states from/to any equipment entities and/or procedural elements; and
- manual intervention.

Where the equipment entity is a common resource, this control function may also be involved in the arbitration of conflicting requests and commands.

6.7.3 Collect Data

In the Collect Data control function, data from sensors, derived values, and events that occur within the domain of Process Control are collected and stored in batch history. Data collection may be conditional. That is, certain data might not always be collected or might be sampled at a different time interval, depending upon information received from another control function, such as from parameters passed to the equipment phase.

6.8 Personnel and environmental protection

The Personnel and Environmental Protection control activity provides safety for people and the environment. It is shown in the Control Activity Model in Figure 24 (see Section 6.1.1) below Process Control because no other control activity should intervene between Personnel and Environmental Protection, and the field hardware it is designed to operate with. Personnel and Environmental Protection is, by definition, separate from higher level control activities. It may map to more than one level of equipment entity if that level of organization or sophistication is required to provide adequate safety protection.

Personnel and environmental protection is included in the control activity model to emphasize the importance of these types of protection systems and to indicate the point in the model appropriate for insertion of a separate protection system of this type. A complete discussion of personnel and environmental protection, the classification of these types of systems, and the segregation of levels of interlocks within these systems is a topic of its own and beyond the scope

of this standard. More information on this topic can be obtained from some of the standards and guidelines that are under development (see References 1, 2, 3, 4, and 5 in Annex B).

Annex A (informative) Bibliography

1. ISA dS84.01: Applications of Safety Instrumented Systems for the Process Industries, Instrument Society of America.
2. IEC SC65A/WG10, 65A (Secretariat): Functional safety: safety-related systems. Part 1: General requirements, International Electrotechnical Commission.
3. IEC SC65A/WG9, 65A (Secretariat) 122: Functional safety: safety-related systems. Part 2: Requirements for Electrical/Electronic/Programmable electronic systems, International Electrotechnical Commission.
4. IEC SC65A/WG9, 65A (Secretariat) 122: Functional safety: safety-related systems. Part 3: Software requirements, International Electrotechnical Commission.
5. Guidelines for Safe Automation of Chemical Processes, Center for Chemical Process Safety, American Institute of Chemical Engineers, New York 1993.

Annex B (informative) Frequently asked questions

C.1 How do you manage unit procedures with multiple batches (one batch following another) when there are overlapping unit processing requirements without having multiple unit procedures executing in the same unit?

Two common techniques where logical boundaries are used are:

1. A technique using a First In / First Out (FIFO) assumption that all the material in the first batch into a unit is also the first to leave the vessel.

Example: A distillation column within a process cell.

Note: Use of this method results in the material in two or more batches being co-mingled. This technique should only be used where co-mingling is acceptable and where physical separation of material in different batches is not a business or process requirement.

2. A continuous transition between batches where the leading edge of a batch is used as the boundary between two batches.

Example: A textile range using recipe driven batch control to set control settings for different products.

Example: A continuous chemical plant using recipes to change grades with minimal off-spec products.

Note: As the later batch's leading edge moves through the equipment, control settings can be changed to control the second batch in the equipment differently than the first or record keeping functions may associate data from different measurement points with the different batches. The key here is the unit is never idled as it transitions from one batch to another

Note: Depending upon the nature of the material co-mingling between batches may occur.

C.2 What are good practices in executing batch control?

At all times that a batch or portion of one is contained in a Unit, there should be a procedural element (Phase or Operation) running in that Unit.

C.3 What the characteristics of Basic Control?

In contrast with procedural control which is also sequential, there are two defining characteristics that separate them and a purpose that is entirely different.

- First, basic control is always present. In a steady state condition it may be quiescent¹ but is never inactive and is always open to command and may be open to recognition of a

triggering condition. By contrast a procedure, such as a phase, has, by definition, a beginning and an end. Before it is activated it is totally inactive and does not have the capability to recognize any commands or triggering condition. It must also be capable of ending and becoming inactive.

- Second, basic control activity is defined implicitly in its design. Its various states and its response to commands and triggering conditions are implicit in the definition of its equipment and the state transitions that move it from one state to another. It is defined in terms of what it can do to or with equipment and the commands and triggering conditions that can affect the way it behaves. Its functionality is engineered and unchanging in automatic mode. All equipment and other subordinates within a control module is commanded only by the functionality designed and engineered into that single overall module. Procedural control, by contrast, is explicit and is defined in terms of the sequence of commands its designer wants to be issued while it is active in order to complete a specific task. In addition, many different procedures can (and do in practice) command the same subordinate (usually basic) control.
- The difference in purpose is also clear. The purpose of basic control is to control equipment directly to set equipment to a commanded state, a process condition to a commanded value or to cycle equipment through a finite and essentially unvarying sequence based on some triggering condition. It operates based totally on command from a procedure or procedures (manual or automated). The purpose of procedural control is to command basic control in a planned sequence designed to carry out a defined task.

In essence, basic control is basic only in the sense that it is the base line or fundamental control that must be present in order to actually control equipment. It may be complex or simple, but it is the basic kind of control that must exist if equipment is to be controlled at all. Procedural control is in addition to basic control and actually commands it to the state(s) required to carry out a the desired procedure, such as making a batch of material or, in its simplest form, accomplishing a task according to an explicit sequence or *procedure*.

- Basic control is “basic” only in the sense that it is fundamental and is the essential control that sets states and conditions in the equipment or the manufacturing process regardless of the mechanism or method used to make it function i.e. automatic, manual, mechanical, etc.
- Basic control can be simple in nature but can be and often is very complex and sophisticated i.e. model reference control, multivariable control, complex recurring sequence control, etc.
- Basic control encompasses traditional stable state control including state transitions.
- Basic control encompasses regulatory control that sets a manufacturing value or condition and regulates one or more pieces of equipment in order to maintain that condition in spite of upsets and other external forcing functions.
- Basic control encompasses repetitive control actions that, once commanded to on, causes a preordained sequence of states to be activated based on a triggering condition or signal i.e. In a very simple case - a sump pump that, once turned on or commanded to be active, will actuate the pump motor when the level in the sump exceeds a given level. A more

complex case might involve a more complex sequence of states that will be triggered in some order ending up back at the original state waiting for another triggering signal.

- Basic control has modes e.g. manual, automatic, etc.
- Basic control can sense condition vial equipment i.e. switches, sensors, etc. and can convert the sensed conditions into other forms such as engineering units, named conditions, etc.
- A characteristic of basic control is that it may have a mode of operation where it is continuously aware of its environment and may react to process without outside commands.
- Basic control is process and equipment oriented and is product independent. Other types of control may issue commands or set parameters to alter basic control's actions
- Components of basic control may issue commands to and set parameters in other basic control components.

C.4 What are typical forms of a equipment module?

- EM that contains an equipment procedural control which participates in a recipe execution (also performs coordination control)
- EM that does not execute procedural control, but performs coordination control (gathering of CMs)
- EM that executes procedural control aside from recipe direction

C.5 What are typical forms of a control module?

—

Annex C (informative) Assessment of Conformance to ISA-88 Part 1

The following assessment checklist is intended to be used as a measure of conformance of systems and applications toward the intent of this part of the standard.

Editor's Note: "Truth Statement" Comments for Draft 3 were placed here in the draft for review, comment and discussion as a starting point for the conformance assessment measures.

Clause 4.1 Processes, batches and batch processes

1. A process is a sequence of chemical, physical or biological activities for the conversion, transport or storage of material or energy. (4.1)
2. Aspects of this standard apply to discrete parts manufacturing and continuous processes. (4.1)
3. Batch processes lead to the production of finite quantities of material (batches) by subjecting quantities of input materials to a defined order of processing actions using one or more pieces of equipment. (4.1.3)
4. The product produced by a batch process is called a batch. (4.1.3)
5. Batch processes are discontinuous processes. (4.1.3)
6. Batch processes have characteristics of both discrete and continuous processes. (4.1.3)
7. The process consists of one or more process stages which are organized as an ordered set, which can be serial, parallel, or both. (4.1.4)
8. A process stage is a part of a process that usually operates independently from other process stages. (4.1.4)
9. Each process stage consists of an ordered set of one or more process operations. (4.1.5)
10. Process operations represent major processing activities. (4.1.5)
11. Each process operation can be subdivided into an ordered set of one or more process actions that carry out the processing required by the process operation. (4.1.6)
12. Process actions describe minor processing activities that are combined to make up a process operation. (4.1.6)

Clause 4.2 Physical Model

1. The physical model has seven levels. (4.2)
2. The top three levels are enterprise, site, and area. These three levels are not modeled further in this document. (4.2)

3. The lower four levels of this model, process cell, unit, equipment module and control equipment refer to specific equipment types. (4.2)
4. The physical model presented is complete as indicated, but may be collapsed or expanded. (4.2)
5. The unit and the control module level may not be omitted from the physical model. (4.2)
6. An enterprise is a collection of one or more sites. (4.2.1)
7. A site is a physical, geographical, or logical grouping determined by the enterprise. (4.2.2)
8. An area is a physical, geographical, or logical grouping determined by the site (4.2.3)
9. The Process Cell as described in this standard corresponds to the Work Center as described in IEC/ISO 62264 and ANSI/ISA 95. (4.2.4)
10. While the Work Center may be specialized for many different types of manufacturing, the Work Center defined as a Process Cell is described only in batch processing terms. (4.2.4)
11. A process cell is a logical grouping of equipment that includes the equipment required for production of one or more batches. (4.2.4)
12. The process cell defines the span of logical control of one set of process equipment within an area. (4.2.4)
13. The existence of the process cell allows for production scheduling on a process cell basis, and also allows for process cell-wide control strategies to be designed. (4.2.4)
14. A process cell contains all of the units, equipment modules, and control modules required to make one or more batches. (4.2.4)
15. A train is composed of all units and other equipment that may be utilized by a specific batch. (4.2.4)
16. A batch does not always use all the equipment in a train. (4.2.4)
17. More than one batch and more than one product may use a train simultaneously. (4.2.4)
18. The order of equipment actually used or expected to be used by a batch is called the path. (4.2.4)
19. Although a process cell may contain more than one train, no train may contain equipment outside the boundaries of the process cell. (4.2.4)
20. Batch units execute only one unit procedure at a time. (4.2.5)
21. A batch unit shall have a procedural element to direct it's activities when it is associated with a batch. (4.2.5)
22. Batch units can only be controlled by one control recipe at a time. Units can only operate on one batch at a time. (4.2.5)
23. A batch unit can not acquire another unit. (4.2.5)

24. Batch units operate independently of one another. (4.2.5)
25. Batch units may perform coordinated functions with other units. (4.2.5)
26. A batch unit may sometimes take on the attributes of other S95 type units. E.g. A batch unit may process material and then act as a storage unit. (4.2.5)
27. For an <S95> production unit (for continuous processing activities), multiple unit procedures may be executed at the same time on a single continuous unit. (4.2.5 - Questionable truth yet to be discussed)
28. For an <S95> storage unit, ... (4.2.5 - Questionable truth yet to be discussed)
29. It is good practice to represent the batch processing activity within a unit with a single term. Following the concept of a chemical engineering unit operation, this would often relate to the operation in the Procedure Model. (4.2.5 - Questionable truth yet to be discussed)
30. A batch unit does not necessarily contain fixed physical equipment entities, but may acquired resources dynamically. For example, it may be a temporary collection of Equipment Modules and Control Modules assembled for the duration of a specific batch. (4.2.5 - Questionable truth yet to be discussed)
31. Physically, the equipment module may be made up of control modules and subordinate equipment modules. (4.2.6)
32. An equipment module may be part of a unit or a stand-alone equipment grouping within a process cell. (4.2.6)
33. If engineered as a stand-alone equipment grouping, it can be an exclusive-use resource or a shared-use resource. (4.2.6)
34. An equipment module can carry out a finite number of specific minor processing activities such as dosing and weighing. (4.2.6)
35. It combines all necessary physical processing and control equipment required to perform those activities. (4.2.6)
36. A control module is a collection of sensors, actuators, other control modules, and associated processing equipment that, from the point of view of control, is operated as a single entity. (4.2.7)
37. A control module can also be made up of other control modules. (4.2.7)
38. Control modules may be part of an equipment module or may be directly subordinate to units. (4.2.7)
39. The Physical Model does not imply that a control module can be both directly part of a unit and part of an equipment module at the same time. (4.2.7)
40. When an individual control module is directly part of a unit, it is not then also part of any equipment module. (4.2.7)

Clause 4.3 Process Cell Classification

1. Classification by number of products. (4.3.1)
2. A process cell is classified as single-product or multi-product based on the number of products planned for production in that process cell. (4.3.1)
3. A single product process cell produces the same product in each batch. (4.3.1)
4. Variations in process cell procedures and parameters are possible. (4.3.1)
5. A multi-product process cell produces different products utilizing different methods of production or control. There are two possibilities: (4.3.1)
6. All products are produced with the same process cell procedure using different formula values (varying materials and/or process parameters). (4.3.1)
7. The products are produced using different process cell procedures. (4.3.1)
8. A single-path structure is a group of units through which a batch passes sequentially. (4.3.2)
9. A multiple-path structure is consists of multiple single-path structures in parallel with no product transfer between them. (4.3.2)
10. The paths may be either fixed or variable. (4.3.2)
11. When the paths are fixed, the same units are used in the same sequence. (4.3.2)
12. When the path is variable, the sequence may be determined at the beginning of the batch or it may be determined as the batch is being produced. (4.3.2)

Clause 5.1 Types of control

1. There are four types of control involved in batch control:
 - a. Basic control dedicated to maintaining a steady or controlled state (e.g. PID, on/off, interlock, ...) in equipment
 - b. Principle control dedicated to performing a sequence of equipment based actions as part of equipment control
 - c. Procedural control dedicated to defining a sequence of process based actions as part of a recipe
 - d. Coordination control dedicated to the coordination of procedural, principle, and basic control including controlling execution states and allocation and assignment of resources
2. There are two primary roles being supported:
 - a. Those that develop processes and recipes – e.g. Process engineers
 - b. Those that develop control applications (code) – e.g. Control engineers or programmers
3. The relationship between the roles and types of control are:
 - a. Basic control is usually implemented by control application developers
 - b. Principle control is usually implemented by control application developers

- c. Procedural control is usually implemented by process developers
- d. Coordination control is usually implemented by control application developers or is available from commercial off the shelf software

Clause 5.2 Procedural elements

1. Procedural control follows a well defined hierarchy of: Process cell procedure, Unit Procedure, Operation, and Phase.

Clause 5.3 Equipment Entities

1. The control part of any equipment entity can be satisfied by human activity, automation or a combination of both.
2. The data that describes the status of any equipment entity is defined, published and available to all equipment entities that have a need for that information.
3. The command and control required to interact with any equipment entity is defined and published to all equipment entities that have a need to interact with that equipment entity.
4. Provide control of physical equipment through human or automation actions as defined by a control strategy.
5. Physical equipment can only be controlled by the action of basic control through a control module.
6. Control modules can only be commanded by equipment control executing in equipment modules, units, or cells.
7. Equipment Modules can only be commanded by control executing in other equipment modules, units or cells.
8. Units and cells are the only equipment entities that can execute procedural control.
9. Control modules can command and control other control modules forming a hierarchy of command and control to satisfy a complex control requirement defining the scope of a compound control module.
10. Equipment modules can command and control other equipment modules forming a hierarchy of command and control to satisfy a complex control requirement defining the scope of a compound equipment module.
11. Outside equipment entities interacting with a compound module can only interact with the highest level component in the compound structure.
12. Control and equipment modules have a single contained and exposed method of implementing the control strategy for the module.
13. Units and cells can address more than a single control strategy; each strategy shall focus on satisfying that strategy by interaction with other equipment entities. (example strategies, arbitration and coordination of equipment entities, execution of procedural control, Cell and Unit mode management)

Clause 5.4 Recipes

1. A recipe is an entity that contains the minimum set of information that uniquely defines the manufacturing requirements for a specific product.

- a. The recipe contains neither scheduling nor equipment control.
2. There are four fundamental types of recipes: general, site, master, and control.
 - a. Other recipe types may exist as required.
3. There is a substantial difference between general/site recipes and master/control recipes.
 - a. The general and site recipes describe the technique (how to do it in principle).
 - b. Master and control recipes describe the task (how to do it with actual resources).
4. The general recipe is an enterprise level recipe that serves as the basis for lower-level recipes.
 - a. The general recipe provides a means for communicating processing requirements to multiple manufacturing locations
 - c. General recipe process definitions are structured using the levels described in the process model
 - d. General recipe process definition information is expressed in three levels of breakdown: Process Stages, Process Operations, and Process Actions
 - e. The process stage, process operation, and process action are not constrained by unit boundaries in any real plant
5. The site recipe is specific to a particular site
 - a. It is not specific to a particular set of process cell equipment
 - b. Site recipe process definitions are structured using the levels described in the process model
6. The master recipe is that level of recipe that is targeted to a process cell or a subset of the process cell equipment
 - a. The recipe process cell procedure portion of the master recipe may contain recipe unit procedures, recipe operations, and recipe phases
 - b. The master recipe level is a required recipe level
 - c. Whether the batch manufacturing equipment is operated manually or fully automatically, the master recipe exists either as an identifiable set of written instructions or as an electronic entity
7. The control recipe starts as a copy of a specific version of a master recipe and is then modified as necessary with scheduling and operational information to be specific to a single batch
 - a. At the control recipe creation time, there is a 1:1 correspondence between recipe unit procedures in the master recipe and recipe unit procedures in the control recipe, between recipe operations in the master recipe and recipe operations in the control recipe, and between recipe phases in the master recipe and recipe phases in the control recipe

- b. The process cell procedure of a control recipe consists of recipe unit procedures, recipe operations and recipe phases that relate directly to those defined by the master recipe
- 8. Recipes contain five categories of information
 - a. The administrative information in the recipe is referred to as the header.
 - b. The formula is a category of recipe information that includes process inputs, process parameters, and process outputs.
 - 1. A process input is the identification and quantity of a raw material or other resource required to make the product
 - 2. A process parameter details information (such as temperature, pressure, or time) that is pertinent to the product but does not fall into the classification of input or output
 - 3. A process output is the identification and quantity of a material and/or energy expected to result from one execution of the recipe
 - c. Equipment requirements constrain the choice of the equipment that will eventually be used to implement a specific part of the process cell procedure
 - d. At the control recipe level, the equipment requirements are the same as, or a subset of, the allowable equipment in the master recipe
 - e. The recipe process cell procedure defines the strategy for carrying out a process
 - f. The recipe process cell procedure may consist of a hierarchy of recipe procedural elements or reference an associated equipment procedural element.
- 9. A recipe entity is the combination of a recipe procedural element with associated recipe information (e.g. header, formula, equipment requirements, and other information).
 - a. General, site, master, and control recipes are recipe entities
- 10. Recipe transportability ensures that recipe information movement is possible between batch control implementations at the same recipe level
 - a. The general recipe is transportable from where it was created to any site
 - b. The site recipe is intended to be used within a specific site and is transportable within that site.
 - c. The master recipe is transportable to another process cell, recognizing that the master recipe has been customized for a particular set of process cell equipment
 - d. The control recipe is not transportable

Clause 5.5 Connecting recipe entities and equipment entities

5.5.1 Connecting recipe procedural elements, equipment procedural elements, and principle control

1. Logical (but not necessarily physical) separation shall exist between recipe procedural control, equipment procedural control, principle control, and basic control.
2. Automatic control of equipment by recipes shall be affected through bidirectional linkages between control recipe procedural elements, equipment procedural control, and principle control, ultimately affecting equipment through principle control commands to basic control.
3. Linkages between control recipe procedural elements and equipment procedural elements shall support bidirectional transfer of attribute data, issuance of state and mode commands by the recipe element, and receipt of equipment element status information by the recipe element.
4. Any recipe procedural element that links to an equipment procedural element shall neither contain nor reference other procedural elements.
5. A recipe procedural element shall not be permitted to link to more than one equipment procedural element or to one at a different hierarchical level in the procedural model.
6. An equipment procedural element that is linked to a recipe procedural element shall not be available for linkage to any other recipe procedural element or for receiving commands from any other equipment procedural element.
7. Linkages between recipe procedural elements and equipment procedural elements shall be permitted to exist simultaneously, including at multiple levels of the procedural model, as long as the above rules are not violated.
8. Implementation of the full hierarchical structure of the procedural control model shall be supported for both recipe and equipment procedural control.
9. Linkages between equipment procedural elements and principle control shall support bidirectional transfer of attribute data, issuance of state and mode commands by the procedural element, and receipt of equipment element status information by the procedural element.
10. Any equipment procedural element that links to a principle control element shall neither contain nor reference other procedural elements.
11. A principle control element that is linked to an equipment procedural element shall not be available for linkage to any other procedural element.

5.5.2 Using recipe procedural elements in master recipes

12. Master recipes shall be constructed from building blocks that comprise recipe entities stored in a library.
13. Master recipe building blocks shall be user-configurable with sufficient information to enable necessary linkages of child control recipes to corresponding equipment procedural elements.

5.5.3 Collapsing the procedural model

14. Implementation of the procedural control model collapsed to exclude any or all hierarchical levels except the recipe process cell procedure level of shall be supported for both recipes and equipment control.

5.5.4 Expanding the procedural model

15. Implementation of the procedural control hierarchy expanded to include additional hierarchical levels of shall be supported for both recipes and equipment control.

Clause 5.6 Production plans and schedules

1. Production plans and schedules state the production requirements for the enterprise, sites, areas, and process cells
2. There are a number of different types of plans and schedules within an enterprise
3. Every plan or schedule has a time horizon (e.g. minutes, hours, shifts, or days)
4. The batch schedule is based on the specific resources and requirements of the process cell
5. A batch schedule contains the possible paths or equipment assignments allowed for a batch.
6. Batch schedules are able to contain:
 - a. Product name
 - b. Master recipe name
 - c. Quantity (with engineering units) of product
 - d. Equipment and materials permitted to be used, such as path and raw material
 - e. Projected mode of operation
 - f. Order of initiation and priority
 - g. Lot ID (if preassigned)
 - h. Batch ID (if preassigned)
 - i. Projected start time and end time
 - j. Disposition of the finished batch
 - k. Specific customer requirements
7. A campaign is a series of batches. (Editor's note: Put under 5.6.1 instead?)

Clause 5.7 Production information

1. Production information is information generated in the course of production
2. The type of information needed varies between different parts of the enterprise

3. Production information may be batch specific or it may be common to several or all of the batches produced

5.7.3 Batch History

4. All recorded information pertaining to a batch is referred to as the batch history
5. Batch history includes batch specific and common (non-batch specific) information
6. Batch history must be stored in a way that makes it possible to associate the data with that batch (or batches) to which it relates and the processing that has taken place
7. Batch history data must be associated with the actual execution of the appropriate procedural elements, where relevant.

5.7.4 Batch Reports

8. The extraction of data from batch history related to one or more batches is called a batch report

Clause 5.8 Allocation and arbitration

1. Allocation is a form of coordination control that makes assignment of equipment resources to a batch or a unit as they are needed to complete or to continue required processing.
2. When more than one request for a single resource is made, arbitration is needed to determine which requester will be granted the resource

5.8.1 Allocation

3. All recorded information pertaining to a batch is referred to as the batch history
4. A common resource may be either exclusive-use or shared-use
5. If the resource is designated as exclusive-use, only one unit may use the resource at a time
6. If the common resource is designated as shared, several units may use the resource at the same time.

5.8.2 Arbitration

7. If there are multiple requesters for a resource, arbitration is required so that proper allocations can be made
8. Arbitration resolves contention for a resource according to some predetermined algorithm and provides definitive routing or allocation direction

9. Arbitration includes resource reservation and preemption
10. Reservation allows a claim to be placed on a resource prior to actual allocation
11. Preemption occurs when a higher priority batch is allowed to cancel or interrupt the use of a resource assigned to a lower priority batch

Clause 5.9 Modes and states

1. The status of equipment entities and of procedural elements are described by their modes and states.
2. Modes specify the manner in which state transitions take place
3. States specify the current status
4. Other resources, such as materials, may also have states

5.9.1 Modes

5. Equipment entities and procedural elements have modes
6. The mode of an equipment entity is based on procedural elements or equipment entities utilizing basic control functions.
7. A mode determines how equipment entities and procedural elements respond to commands and how they operate
8. For procedural elements, the mode determines the way the transitions are treated
9. For equipment entities containing basic control functions, the mode determines how their states may be manipulated
10. A change of mode in one equipment entity type or procedural element type may cause corresponding changes in other types.

5.9.2 States

11. Equipment entities and procedural elements have states
12. A change of state in one equipment entity type or procedural element type may cause corresponding changes in other types

Clause 5.10 Exception handling

1. An event which occurs outside the normal or desired behavior of batch control is called an exception

2. Handling of exceptions can occur at all of the levels in the control activity model and may be part of procedural, basic, and coordination control
3. Exception handling is an integral part of all control and typically constitutes a very large portion of the control definition
4. From the standpoint of control, exception handling is no different from desired control strategies in that an event is detected, evaluated, and a response generated
5. Exception response functions may affect the modes and states of equipment entities and of procedural elements

Clause 6.1 Control Activities

1. The Control Activity Model is not intended to show all relationships. (6.1.1)
2. The control activities discussed in this section need to store information in a way that provides a usable, accessible data source to external activities. (6.1.2.1)
3. Each control activity should have the ability to access relevant reference information as needed to fulfill its function. Reference information may be enterprise-wide, site-wide, area-wide, or process cell-wide. (6.1.2.1)

Clause 6.2 Recipe Management

1. Manage general recipes is the control function by which general recipes are created, maintained and stored. (6.2.1)
2. The define general recipe procedural elements control function creates, maintains and makes available for subsequent use, the procedural elements that are used as building blocks in general recipe and site recipe process definitions. (6.2.2)
3. The procedural elements defined by this control function may be process actions, process operations, process stages, and/or an entire general recipe process definition. Not all levels of procedural elements need to be defined. (6.2.2)
4. Manage site recipes is the control function by which site recipes are created, maintained and stored. (6.2.3)
5. A site recipe is created by combining the information of the appropriate general recipe with site specific information. (6.2.3)
6. If additional or alternate procedural elements are required, only those defined under the define general recipe procedural elements control function are used. (6.2.3)
7. Manage master recipes is the control function by which master recipes are created, maintained and stored. (6.2.4)
8. Master recipes are defined based on the specific processing requirements for the product in question. (6.2.4)

9. Specific processing requirements in a master recipe may be expressed in a general or site recipe. (6.2.4)
10. A master recipe may be created by the transformation of the site recipe. (6.2.4)
11. The define master recipe procedural elements control function creates, maintains and makes available for subsequent use, the procedural elements used in master recipe process cell procedures. These become the building blocks of the master recipe process cell procedure. (6.2.5)
12. The master recipe procedural elements must reflect the processing capabilities required by master recipes. (6.2.5)
13. The master recipe procedural elements must, at least at the recipe phase level, be able to reference equipment procedural elements when the derived control recipe is executed. (6.2.5)
14. In addition to providing the building blocks for the master recipe process cell procedure, this control function may also define constraints on the configuration of master recipes. (6.2.5)

Clause 6.3 Production Planning and Scheduling

1. A batch schedule shall accept data inputs from sources such as other types of schedules, master recipes and resource databases.
2. A batch schedule shall be developed using a scheduling algorithm which acts upon the data input. This scheduling algorithm may be manual or automatic.
3. The calculated batch schedule shall be revised on demand based upon updated information on batch progress and process cell status.
4. Manual intervention into the scheduling process shall be possible.
5. It shall be possible to specify a procedure or method to determine the batch sizes and quantity of batches to be produced.

Clause 6.4 Production Information Management

1. Batch history shall be collected and organized on an individual batch basis.
2. Batch history shall consist of a collection of entries. An entry shall represent one value or a set of values describing one event associated with the batch.
3. The batch history function shall also include the receipt and storage of information associated to the batch from other sources that may be part of the overall batch control application.
4. The batch history function shall also provide the facility to manipulate historical data and produce batch reports.
5. The batch history function shall provide the facility to archive data associated with historical batches.
6. The batch history function shall provide the facility to delete data associated with historical batches.
7. The batch history function shall provide the facility to manage archived data for historical batches including the retrieval and restoration of the data for examination and reporting in the future.
8. The reliability and integrity of the batch history data shall be ensured.

6.5 Process Cell Management

1. The scope of process cell management is a single process cell.
2. Process cell management is responsible for coordinating the execution of all batches and resources within a process cell.
3. Process cell management is finished with a batch when the control recipe process cell procedure is complete.
4. When a batch leaves a process cell, it is no longer part of the control and management domain of the process cell management in that cell.
5. Process cell management has the ability to process multiple batches and coordinate multiple units and pieces of equipment at the same time.
6. Process cell management coordinates the progression of the process cell procedure for each batch and the utilization of equipment based on information in the control recipe, scheduling information and equipment status.

6.5.1 Manage batches

The following capability is included in this control function.

7. Creating a control recipe from the master recipe, scheduling information, and input received from the operator.

8. Assigning a unique batch identification (batch ID) to each batch and to the associated control recipe.
9. Verifying the control recipe as it is created.
10. Sizing the control recipe to meet the batch quantity needed based on the sizing rules in the master recipe and the quantity specified in the batch scheduling information.
11. Maintaining all the current control recipes within Process Cell Management until the batches are completed.
12. Assigning the start conditions as specified in the scheduling information and/or provided by the operator. Start conditions that shall be supported include:
 - a. Start batch as soon as a unit becomes available
 - b. Start based on operator direction
 - c. Start when specific units are available
 - d. Start based on the scheduled priority of the batch
13. Modifying any part of a control recipe that has not been executed.
14. Requesting and releasing units and other equipment, changing their status to indicate use, and updating the manage process cell resources control function on the status of the batch.
15. Monitoring and controlling the executing control recipe(s) including the current status of the batch, such as what unit procedures have been executed, and what unit procedure is next.
16. Processing requests for state and mode changes to process cell procedures, unit procedures, operations, and phases.
17. Allowing a control recipe to span multiple units in the same process cell, including distributing unit recipes to Unit Supervision in a timely manner.
18. Allowing a batch to be suspended, removed from the processing equipment (packaged for temporary storage), and therefore out of the control of Process Cell Management, and later recalled to complete the batch processing.
19. Maintaining batch status information.
20. Updating information on batches to the collect batch and process cell information control function.

6.5.2 Manage process cell resources

The following capability is included in this control function.

21. Obtaining scheduling information from Production Planning and Scheduling and providing this information to the manage batches control function.
22. Allocating or reserving equipment as requested by the manage batches control function. Allocation may be done are

- a. according to a batch schedule designating each individual unit allocation; or
 - b. according to a strategy defined at the process cell level combining the equipment requirements of the control recipe and the availability and capabilities of equipment.
- 23. Arbitrating, as required, multiple requests for reservation or allocation of the same equipment. Arbitration rule sets include the following:
 - a. Order of request (FIFO)
 - b. Timed requests (such as by reserving the equipment)
 - c. Priority of batch
 - d. Maximizing equipment utilization (such as by minimizing cleaning requirements, minimizing energy consumption, or maximizing throughput)
 - e. Operator judgment
- 24. Managing unallocated equipment within the process cell.
- 25. Receiving status information sent by Unit Supervision and/or status information sent by Process Control related to unallocated equipment within the process cell.
- 26. Updating information on all process cell resources to the collect batch and process cell information control function.
- 27. Updating Production Planning and Scheduling with batch progress information, including
 - a. batch ID;
 - b. batch state change events;
 - c. actual quantities of raw materials, products, and utilities;
 - d. equipment assignments; and
 - e. projected and actual allocation and de-allocation times of process cell resources.

6.5.3 Collect batch and process cell information

The following capability is included in this control function.

28. Collect the following information for the Production Information Management activity.

- a. Mode and state changes
- b. Incremental copies of control recipes as each portion is finished
- c. Time that commands were sent to Unit Supervision and Process Control
- d. Time that unit recipes were sent to Unit Supervision
- e. Delays encountered due to lack of equipment availability
- f. Time of allocation, reservation and release of each process cell resource
- g. Requests and result of requests for equipment allocation or reservation which required arbitration

- h. Status changes in unallocated equipment
- i. Operator intervention

6.6 Unit supervision

1. Unit supervision is responsible for translating control recipe directions into equipment control actions.
2. Unit supervision executes the unit procedures provided by Process Cell Management.
3. Unit supervision associates the correct equipment procedural element with the recipe procedural element and may do so at the unit procedure, operation, or phase level.
4. Unit supervision acquires and releases resources necessary to execute a unit procedure.
5. Unit supervision can not acquire another unit, but can request services from or provide services to another unit.

6.6.1 Acquire and execute procedural elements

The following capability is included in this control function.

6. Determining which procedural elements are to be executed.
7. Verifying that the procedural elements exist.
8. Executing unit procedures, operations, and equipment procedural element.
9. Associating recipe procedural elements with equipment procedural elements.
10. Initiating and parameterizing equipment procedural element.

6.6.2 , Manage unit resources

The following capability is included in this control function.

11. Unit supervision may issue requests to, react on feedback from, and interface with arbitration functions related to the equipment in question.
12. Unit supervision ensures appropriate propagation of unit and procedural element modes and states.
13. Unit supervision enables the collection of production information relevant to the batch from external equipment.

6.6.3 Collect batch and unit information

The following capability is included in this control function.

14. Collect the following information for the Production Information Management activity.
 - a. Mode and state changes
 - b. Timing of commands sent to Process Control
 - c. Timing of the execution of the unit recipe procedure events

- d. Timing and sequence of allocation, reservation, and release of equipment entities acquired by the unit
- e. Status changes in unit equipment
- f. Values derived during execution of the unit recipe

6.7 Process control

1. Process control in the equipment can execute the following equipment procedural elements: equipment phase, equipment operation, equipment unit procedure.
2. Process control activity can execute basic control including the execution of equipment phases.
3. Equipment can contain equipment phases, equipment operations, equipment unit procedures which may never be related to a recipe procedural element.
4. Operations are composed of references to procedural control elements and does not contain equipment logic.
5. Equipment procedural elements have procedural states and modes.
6. Process control activity does not have the capability to execute equipment or recipe unit procedures or operations.
7. The structure of operations and unit procedures are the same no matter if they are recipe or equipment based.
8. The recipe and equipment procedural models are collapsible with the functions of the collapsed levels assuming the capabilities of the omitted levels.
9. Equipment procedural elements can communicate to one or more equipment modules or control modules.
10. In order to execute a recipe procedural element which has process impact, a corresponding equipment procedural element must exist.
11. All equipment procedural elements can command basic control.

6.8 Personnel and environmental protection

1. None.

Developing and promulgating technically sound consensus standards and recommended practices is one of ISA's primary goals. To achieve this goal the Standards and Practices Department relies on the technical expertise and efforts of volunteer committee members, chairmen, and reviewers.

ISA is an American National Standards Institute (ANSI) accredited organization. ISA administers United States Technical Advisory Groups (USTAGs) and provides secretariat support for International Electrotechnical Commission (IEC) and International Organization for Standardization (ISO) committees that develop process measurement and control standards. To obtain additional information on the Society's standards program, please write:

ISA
Attn: Standards Department
67 Alexander Drive
P.O. Box 12277
Research Triangle Park, NC 27709

ISBN